



# Air Conditioning Technical Data RXM-R





---

# TABLE OF CONTENTS

## RXM-R

---

1	<b>Features</b>	4
	RXM-R	4
2	<b>Specifications</b>	5
3	<b>Electrical data</b>	28
4	<b>Capacity tables</b>	35
	Cooling/Heating Capacity Tables	35
5	<b>Dimensional drawings</b>	55
6	<b>Centre of gravity</b>	57
7	<b>Piping diagrams</b>	59
8	<b>Wiring diagrams</b>	61
	Wiring Diagrams - Single Phase	61
9	<b>Sound data</b>	63
	Sound Pressure Spectrum	63
10	<b>Operation range</b>	67

# 1 Features

## 1 - 1 RXM-R

- › Choosing for an R-32 product, reduces the environmental impact with 68% compared to R-410A and leads directly to lower energy consumption thanks to its high energy efficiency
- › Outdoor units are neat, sturdy and can easily be mounted on a roof or terrace or simply placed against an outside wall
- › Outdoor units are fitted with a swing compressor, renowned for its low noise and high energy efficiency
- › Outdoor units for pair application
- › Anti-corrosion treated outdoor heat exchanger fin

**1**

Outdoor  
unit silent  
operation

## 2 Specifications

### 1 - 1 RXM-R

Technical Specifications					RXM25R	RXM35R	RXM50R	RXM60R
Casing	Colour				Ivory white			
Dimensions	Unit	Height	mm	550			734	
		Width	mm	765			870	
		Depth	mm	285			373	
	Packed unit	Height	mm	612			820	
		Width	mm	906			1,050	
		Depth	mm	402			480	
Weight	Unit	kg		32			49.0	
	Packed unit	kg		34			53	
Packing	Weight		kg	-			4	
Heat exchanger	Length		mm	805			920	
	Rows	Quantity		2				
	Fin pitch		mm	1.4			1.40	
	Stages	Quantity		24			32	
	Passes	Quantity		3.1			2.2	
	Tube type				ø7 Hi-XD			7.0 Hi-XD
	Fin		Type		Waffle fin (PE)			
	Type		Propeller fan					
	Fan	Air flow rate	Cooling	Nom.	m <sup>3</sup> /min	28.3	36.0	46.6
				cfm	999	1,271	1,645	
Heating		Nom.	m <sup>3</sup> /min	28.3		44.1		
			cfm	999		1,557		
Fan motor	Model		DFC05A3VA				D55F-31	
	Output		W	50		55		
	Speed	Cooling	High	rpm	860	920	760	
			Nom.	rpm	800	860	740	
			Low	rpm	400		640	
	Heating	High	rpm	860		720		
		Nom.	rpm	800		720		
		Low	rpm	400		660		
Compressor	Model		1YC25GXD#C				2YC40JXD#C	
	Oil Amount		cm <sup>3</sup>	-		650		
	Type		Hermetically sealed swing compressor					
	Output		W	800		1,300.0		
	Oil Type						FW68DA	
Operation range	Cooling	Ambient	Min.	°CDB	-10			
Operation range	Cooling	Ambient	Max.	°CDB	50 (1) / 46 (2)		50 (4) / 46 (5)	
			Min.	°CDB	-20 (1) / -15 (2)		-20 (4) / -15 (5)	
	Heating	Ambient	Max.	°CDB	24			
Sound power level	Heating	Nom.	dB(A)	59	61	62.0	63.0	
Sound pressure level	Cooling	Nom.	dB(A)	46	49		48.0	
	Heating	Nom.	dB(A)	47	49		49.0	
Refrigerant	Type		R-32					
	Charge		kg	0.76		1.15		
	Charge		TCO <sub>2</sub> Eq	0.52		0.780		
	Control		Expansion valve				-	
	GWP		675				675.0	
Piping connections	Liquid	OD	mm	6.35				
		Gas	OD	mm	9.50		12.7	
	Drain	OD	mm	18		16		
	Piping length	OU - IU	Max.	m	20		30	
		System	Chargeless	m	10		-	
	Additional refrigerant charge		kg/m	0.02 (for piping length exceeding 10m)				
	Level difference	IU - OU	Max.	m	15		20.0	
	Heat insulation		Both liquid and gas pipes					
Capacity control	Method		Variable (inverter)					

Technical Specifications					RXM25R	RXM35R	RXM50R	RXM20R	RXM42R	RXM60R	RXM71R
Casing	Colour				Ivory white						
Dimensions	Unit	Height	mm	550	734	550			734		
		Width	mm	765	870	765		870		954	
		Depth	mm	285	373	285		373		401	
	Packed unit	Height	mm	612	820	612			820		
		Width	mm	906	1,050	906			1,050		
		Depth	mm	402	480	402			480		
Weight	Unit	kg		32	49.0	32		49.0		55	
	Packed unit	kg		34	53	34		53		60	
Packing	Weight		kg	-	4	-		4		5	

# 2 Specifications

## 1 - 1 RXM-R

2

Technical Specifications					RXM25R	RXM35R	RXM50R	RXM20R	RXM42R	RXM60R	RXM71R		
Heat exchanger	Length	mm	805		920		805		920				
	Rows	Quantity	2										
	Fin pitch	mm	1.4		1.40		1.4		1.40				
	Stages	Quantity	24		32		24		32				
	Passes	Quantity	3.1		2.2		3.1		2.2				
	Tube type		ø7 Hi-XD		7.0 Hi-XD		ø7 Hi-XD		7.0 Hi-XD		ø7 Hi-XD		
Fan	Fin	Type	Waffle fin (PE)										
	Type		Propeller fan										
	Air flow rate	Cooling	Nom.	m <sup>3</sup> /min	28.3	36.0	46.6	36.0	46.6		-		
					cfm	999	1,271	1,645	1,271	1,645		1,730	
	Heating	Nom.	m <sup>3</sup> /min	-									
				cfm	999	1,271	1,645	1,271	1,645		1,730		
	Medium	m <sup>3</sup> /min	-										
			cfm	999	1,271	1,645	1,271	1,645		1,730			
Fan motor	Model		DFC05A3VA		D55F-31		DFC05A3VA		D55F-31		D90B-37		
	Output	W	50		55		50		55		128		
	Speed	Cooling	High	rpm	860	920	760	920	760		880		
				Nom.	rpm	800	860	740	800	740		780	
	Low	rpm	400		640		400		640		700		
		Nom.	rpm	860		720		860		720		780	
	Heating	High	rpm	800		720		800		690	720	740	
			Nom.	rpm	400		660		400		500	660	680
	Compressor	Model		1YC25GXD#C		2YC40JXD#C		1YC25GXD#C		2YC40JXD#C		2YC71DXD#C	
		Oil Amount	cm <sup>3</sup>	-		650		-		650		900	
Type			Hermetically sealed swing compressor										
Output		W	800		1,300.0		800		1,300.0		2,400.0		
Compressor	Oil Type		-		FW68DA		-		FW68DA				
Operation range	Cooling	Ambient	Min.	°CDB		-10							
			Max.	°CDB		50 (1) / 46 (2)		50 (4) / 46 (5)		50 (1) / 46 (2)		50 (4) / 46 (5)	46
	Heating	Ambient	Min.	°CDB		-20 (1) / -15 (2)		-20 (4) / -15 (5)		-20 (1) / -15 (2)		-20 (4) / -15 (5)	-15
			Max.	°CDB		24							
Sound power level	Heating	Nom.	dBa	59	61	62.0	59	62.0	63.0	67.0			
Sound pressure level	Cooling	Nom.	dBa	46	49	48.0	46	48.0		47.0			
	Heating	Nom.	dBa	47	49	49.0	47	48.0	49.0	48.0			
Refrigerant	Type		R-32										
	Charge	kg	0.76		1.15		0.76		1.10		1.15		
	Charge	TCO2Eq	0.52		0.780		0.52		0.750		0.780		
	Control		Expansion valve		-		Expansion valve		-				
	GWP		675		675.0		675		675.0				
Piping connections	Liquid	OD	mm	6.35									
	Gas	OD	mm	9.50		12.7		9.50		12.7	15.9		
	Drain	OD	mm	18		16		18		16	18		
	Piping length	OU - IU	Max.	System	m		20		20		30		
				Chargeless	m		10		10		-		
	Additional refrigerant charge		kg/m	0.02 (for piping length exceeding 10m)									
	Level difference	IU - OU	Max.	m	15		20.0		15		20.0		
	Heat insulation			Both liquid and gas pipes									
Capacity control	Method		Variable (inverter)										

Standard accessories: Drain plug; Quantity: 1;

Standard accessories: Installation manual; Quantity: 1;

Standard accessories: Refrigerant charge label; Quantity: 1;

Standard accessories: Multilingual fluorinated greenhouse gases labels; Quantity: 1;

Standard accessories: Drain cap (1); Quantity: 6;

Standard accessories: Drain cap (2); Quantity: 3;

Electrical Specifications					RXM25R	RXM35R	RXM50R	RXM60R
Power supply	Phase		1~					
	Frequency	Hz	50					
	Voltage	V	220-240					
Wiring connections	For power supply	Quantity	3					
		Remark	Earth wire included					
	For connection with indoor	Quantity	4					
	Remark	Earth wire included						
Current - 50Hz	Maximum fuse amps (MFA)	A	13		16			

Electrical Specifications					RXM25R	RXM35R	RXM50R	RXM20R	RXM42R	RXM60R	RXM71R
Power supply	Phase		1~								
	Frequency	Hz	50								
	Voltage	V	220-240								

# 2 Specifications

## 1 - 1 RXM-R

Electrical Specifications			RXM25R	RXM35R	RXM50R	RXM20R	RXM42R	RXM60R	RXM71R
Wiring connections	For power supply	Quantity	3						
		Remark	Earth wire included						
	For connection with indoor	Quantity	4						
		Remark	Earth wire included						
Current - 50Hz	Maximum fuse amps (MFA)	A	13	16	10	13	16	20	

(1)Only possible in combination with CTXM\*N2V1B, ATXM\*N2V1B, FTXM\*N2V1B |

(2)Only possible in combination with CTXM\*M2V1B, ATXM\*M2V1B, FTXM\*M2V1B, FVXM\*FV1B, FCAG\*AVEB, FFA\*A2VEB9,FBA\*A2VEB9, FHA\*AVEB9, FDXM\*F3V1B9, FNA\*A2VEB9, ADEA\*A2VEB- |

See separate drawing for operation range |

See separate drawing for electrical data |

Contains fluorinated greenhouse gases

Technical specifications			FDXM25F9 + RXM25R	FDXM35F9 + RXM35R	FDXM50F9 + RXM50R	FDXM60F9 + RXM60R	
Cooling capacity	Min.	kW	1.30	1.40	1.70		
	Min.	Btu/h	4,435	4,800	5,800		
	Min.	kcal/h	1,117	1,204	1,462		
	Nom.	kW	2.40	3.40	5.00	6.00	
	Nom.	Btu/h	8,189	11,600	17,100	20,500	
	Nom.	kcal/h	2,064	2,923	4,299	5,159	
	Max.	kW	3.00	3.80	5.30	6.50	
	Max.	Btu/h	10,236	13,000	18,100	22,200	
	Max.	kcal/h	2,579	3,267	4,557	5,589	
Heating capacity	Min.	kW	1.30	1.40	1.70		
	Min.	Btu/h	4,435	4,800	5,800		
	Min.	kcal/h	1,117	1,200	1,500		
	Nom.	kW	3.20	4.00	5.80	7.00	
	Nom.	Btu/h	10,919	13,600	19,800	23,900	
	Nom.	kcal/h	2,752	3,439	4,987	6,019	
	Max.	kW	4.50	5.00	6.00	7.10	
	Max.	Btu/h	15,354	17,100	20,500	24,200	
	Max.	kcal/h	3,869	4,299	5,159	6,105	
Power input	Cooling	Nom. kW	0.64	1.14	1.63	2.05	
	Heating	Nom. kW	0.80	1.15	1.87	2.18	
Nominal efficiency	EER		3.77	2.98	3.06	2.93	
	COP		4.00	3.48	3.10	3.21	
	Annual energy consumption	kWh	318	570	817	1,024	
	Energy labeling	Cooling Heating Directive	A A	C B	B D	C C	
Space cooling	Energy efficiency class		A+	A	A+	A	
	Capacity Pdesign	kW	2.40	3.40	5.00	6.00	
	SEER		5.68	5.26	5.77	5.56	
	Annual energy consumption	kWh/a	148	226	303	378	
Space heating (Average climate)	Energy efficiency class		A+		A		
	Capacity Pdesign	kW	2.60	2.90	4.00	4.60	
	SCOP/A		4.24	3.88	3.93	3.80	
	SCOPnet/A		4.27	3.91	3.95	3.83	
	Pdh Heating capacity at -10°	kW	2.16	2.41	3.54	3.94	
	Annual energy consumption	kWh/a	858	1,046	1,424	1,693	
	Required back up heating cap at design conditions	kW	0.44	0.49	0.46	0.66	
Space heating (Warm climate)	Energy efficiency class		A+++	A++		A+	
	Capacity Pdesignh	kW	1.40	1.57	2.16	2.48	
	SCOP		5.38	4.88	4.41	4.47	
	SCOPnet		5.46	4.95	4.46	4.51	
	Annual energy consumption	kWh/a	365	450	685	777	
	Required back up heating cap at design conditions	kW			0.00		
Space cooling	A Condi- tion (35°C - 27/19)	Pdc EERd	kW	2.40	3.40	5.00	6.00
				3.77	2.98	3.06	2.93
		Power input	kW	0.64	1.14	1.63	2.05
	B Condi- tion (30°C - 27/19)	Pdc EERd	kW	1.76	2.50	3.69	4.43
				5.38	4.08	4.96	4.64
		Power input	kW	0.33	0.61	0.74	0.95
	C Condi- tion (25°C - 27/19)	Pdc EERd	kW	1.27	1.61	2.37	2.85
				8.92	8.05	8.21	6.96
		Power input	kW	0.14	0.20	0.29	0.41
	D Condi- tion (20°C - 27/19)	Pdc EERd	kW	1.31	1.46		2.26
				10.90	9.65	9.47	10.44
		Power input	kW	0.12	0.15	0.24	0.22

## 2 Specifications

### 1 - 1 RXM-R

Technical specifications				FDXM25F9 + RXM25R	FDXM35F9 + RXM35R	FDXM50F9 + RXM50R	FDXM60F9 + RXM60R
Space heating (Average climate)	TOL	Tol (temperature operating limit) °C		-15			
		Pdh (declared heating cap) kW	1.93	2.15	3.54	3.72	
		COPd (declared COP)	2.20	2.01	1.89	1.91	
		Power input kW	0.88	1.07	1.87	1.95	
	TBivalent	Tbiv (bivalent temperature) °C		-7			
		Pdh (declared heating cap) kW	2.30	2.57	3.54	4.07	
		COPd (declared COP)	2.81	2.60	2.87	2.58	
		Power input kW	0.82	0.99	1.23	1.58	
	A Con- dition (-7°C)	Pdh (declared heating cap) kW	2.30	2.57	3.54	4.07	
		COPd (declared COP)	2.81	2.60	2.87	2.58	
		Power input kW	0.82	0.99	1.23	1.58	
	B Condi- tion (2°C)	Pdh (declared heating cap) kW	1.40	1.57	2.16	2.48	
		COPd (declared COP)	4.21	3.84	4.10	3.92	
		Power input kW	0.33	0.41	0.53	0.63	
	C Condi- tion (7°C)	Pdh (declared heating cap) kW	1.00	1.02		1.62	
COPd (declared COP)		5.54	4.94	4.56	4.52		
Power input kW		0.18	0.21		0.36		
D Con- dition (12°C)	Pdh (declared heating cap) kW	1.17	1.19		1.92		
	COPd (declared COP)	6.84	6.08	5.49	5.46		
	Power input kW						
Space heating (Average climate)	D Con- dition (12°C)	Power input kW	0.17	0.20		0.35	
Power consump- tion in other than active mode	Crank- case heater mode	Cooling PCK kW	-	0.000		-	
		Heating PCK kW	-	0.000		-	
	Off mode	Cooling POFF kW	14.0	0.014		-	
		Heating POFF kW	14.0	0.014		-	
	Standby mode	Cooling PSB kW	14.0	0.014		-	
		Heating PSB kW	14.0	0.014		-	
	Thermo- stat-off mode	Cooling PTO kW	7.0	0.007		-	
		Heating PTO kW	7.0	0.007		-	
	Space heating (Warm climate)	TOL	Tol (temperature operating limit) °C		-15		
Pdh (declared heating cap) kW			1.93	2.15	3.54	3.72	
COPd (declared COP)			2.20	2.01	1.89	1.91	
		Power input kW	0.88	1.07	1.87	1.95	
TBivalent		Tbiv (bivalent temperature) °C		2			
		Pdh (declared heating cap) kW	1.40	1.57	2.16	2.48	
		COPd (declared COP)	4.21	3.84	4.10	3.92	
		Power input kW	0.33	0.41	0.53	0.63	
B Condi- tion (2°C)		Pdh (declared heating cap) kW	1.40	1.57	2.16	2.48	
		COPd (declared COP)	4.21	3.84	4.10	3.92	
		Power input kW	0.33	0.41	0.53	0.63	
C Condi- tion (7°C)		Pdh (declared heating cap) kW	1.00	1.02		1.62	
		COPd (declared COP)	5.54	4.94	4.56	4.52	
		Power input kW	0.18	0.21		0.36	
D Con- dition (12°C)		Pdh (declared heating cap) kW	1.17	1.19		1.92	
	COPd (declared COP)	6.84	6.08	5.49	5.46		
	Power input kW	0.17	0.20		0.35		
Power consump- tion in other than active mode	Thermo- stat-off mode	PTO Heating W	-			9	
		PTO Cooling W	-			9	
	Standby mode	Cooling PSB W	-			15	
		Heating PSB W	-			15	
	Off mode	POFF W	-			15	
Cooling	Cdc (Degradation cooling)		0.25				
Heating	Cdh (Degradation heating)		0.25				
Cooling function included			Yes				
Heating function included			Yes				
Average climate included			Yes				
Cold season included			No				
Warm season included			Yes				
Ecolabel logo			No			-	



## 2 Specifications

### 1 - 1 RXM-R

Technical specifications					FDXM25F9 + RXM25R	FDXM35F9 + RXM35R	FDXM50F9 + RXM50R	FDXM60F9 + RXM60R
Eurovent	Sound power level outdoor	Cooling	Nom.	dBa	59	61	62	63
	Sound power level indoor	Cooling	Nom.	dBa	53		55	56
	Piping length	Cooling	Measuring condition	m	5.0	5.00		

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m. |

See separate drawing for operation range |

See separate drawing for electrical data

Technical specifications					FFA25A9 + RXM25R	FFA35A9 + RXM35R	FFA50A9 + RXM50R	FFA60A9 + RXM60R
Cooling capacity	Nom.			kW	2.50	3.40	5.00	5.70
	Nom.			Btu/h	8,530	11,600	17,100	19,400
	Nom.			kcal/h	2,150	2,923	4,299	4,884
Heating capacity	Nom.			kW	3.20	4.20	5.80	7.00
	Nom.			Btu/h	10,919	14,300	19,800	23,900
	Nom.			kcal/h	2,752	3,611	4,987	6,019
Power input	Cooling	Nom.		kW	0.55	0.89	1.54	1.86
	Heating	Nom.		kW	0.82	1.20	1.66	2.05
Nominal efficiency	EER				4.57	3.81	3.24	3.05
	COP				3.90	3.50	3.49	3.41
	Annual energy consumption			kWh	273	446	772	931
	Energy labeling Directive	Cooling	Heating		A	A	B	B
Space cooling	Energy efficiency class				A++		A+	
	Capacity Pdesign			kW	2.50	3.40	5.00	5.70
	SEER				6.17	6.38	5.98	5.76
	Annual energy consumption			kWh/a	142	186	293	346
Space heating (Average climate)	Energy efficiency class				A+		A	A+
	Capacity Pdesign			kW	2.31	3.10	3.84	3.96
	SCOP/A				4.24	4.10	3.90	4.04
	SCOPnet/A				4.27	4.19	3.92	4.06
	Pdh Heating capacity at -10°			kW	2.03	2.04	3.40	3.50
	Annual energy consumption			kWh/a	762	1,058	1,378	1,373
	Required back up heating cap at design conditions			kW	0.28	1.06	0.44	0.46
	Energy efficiency class				A+++		A++	
Space heating (Warm climate)	Capacity Pdesignh			kW	1.24		2.09	2.14
	SCOP				5.29	5.10	4.79	4.74
	SCOPnet				5.37	5.18	4.83	4.79
	Annual energy consumption			kWh/a	329	341	611	631
	Required back up heating cap at design conditions			kW	0.00			
Space cooling	A Condi- tion (35°C - 27/19)	Pdc		kW	2.50	3.40	5.00	5.70
	EERd				4.57	3.81	3.24	3.05
	Power input			kW	0.55	0.89	1.54	1.86
	B Condi- tion (30°C - 27/19)	Pdc		kW	1.84	2.51	3.69	4.20
EERd				6.60	5.79	5.38	5.34	
Power input			kW	0.28	0.43	0.69	0.79	
Space cooling	C Condi- tion (25°C - 27/19)	Pdc		kW	1.41	1.45	2.37	2.71
	EERd				9.11	9.13	7.85	7.24
	Power input			kW	0.16		0.30	0.37
	D Condi- tion (20°C - 27/19)	Pdc		kW	1.24	1.26	2.15	2.27
EERd				11.95	11.99	10.67	9.66	
Power input			kW	0.10	0.11	0.20	0.23	

## 2 Specifications

### 1 - 1 RXM-R

2

Technical specifications				FFA25A9 + RXM25R	FFA35A9 + RXM35R	FFA50A9 + RXM50R	FFA60A9 + RXM60R		
Space heating (Average climate)	TOL	Tol (temperature operating limit) °C		-15					
		Pdh (declared heating cap) kW		2.03		3.40		3.50	
		COPd (declared COP)		2.23		2.10		1.99	2.05
	Power input		0.91		0.97		1.71		
	TBivalent	Tbiv (bivalent temperature) °C		-7					
		Pdh (declared heating cap) kW		2.04		3.40		3.51	
		COPd (declared COP)		3.00		2.89		2.62	2.84
	Power input		0.68		0.71		1.30		1.24
	A Con- dition (-7°C)	Pdh (declared heating cap) kW		2.04		3.40		3.51	
		COPd (declared COP)		3.00		2.89		2.62	2.84
		Power input		0.68		0.71		1.30	
	B Condi- tion (2°C)	Pdh (declared heating cap) kW		1.24		2.09		2.14	
		COPd (declared COP)		4.16		4.00		3.97	4.12
		Power input		0.30		0.31		0.53	
	C Condi- tion (7°C)	Pdh (declared heating cap) kW		1.03		1.47		1.49	
COPd (declared COP)		5.57		5.37		4.81	4.74		
Power input		0.19		0.31		0.31			
D Con- dition (12°C)	Pdh (declared heating cap) kW		1.21		1.71		1.74		
	COPd (declared COP)		6.90		6.65		5.94	5.88	
	Power input		0.18		0.29		0.30		
Power consump- tion in other than active mode	Crank- case heater mode	Cooling	PCK	kW	-	0.000	-		
		Heating	PCK	kW	-	0.000	-		
	Off mode	Cooling	POFF	kW	14.0	0.014	-		
		Heating	POFF	kW	14.0	0.014	-		
	Standby mode	Cooling	PSB	kW	14.0	0.014	-		
		Heating	PSB	kW	14.0	0.014	-		
	Thermo- stat-off mode	Cooling	PTO	kW	7.0	0.007	-		
		Heating	PTO	kW	7.0	0.007	-		
	Space heating (Warm climate)	TOL	Tol (temperature operating limit) °C		-15				
			Pdh (declared heating cap) kW		2.03		3.40		3.50
COPd (declared COP)			2.23		2.10		1.99	2.05	
Space heating (Warm climate)	Power input		0.91		0.97		1.71		
	TBivalent	Tbiv (bivalent temperature) °C		2					
		Pdh (declared heating cap) kW		1.24		2.09		2.14	
		COPd (declared COP)		4.16		4.00		3.97	4.12
	Power input		0.30		0.31		0.53		0.52
	B Condi- tion (2°C)	Pdh (declared heating cap) kW		1.24		2.09		2.14	
		COPd (declared COP)		4.16		4.00		3.97	4.12
		Power input		0.30		0.31		0.53	
	C Condi- tion (7°C)	Pdh (declared heating cap) kW		1.03		1.47		1.49	
		COPd (declared COP)		5.57		5.37		4.81	4.74
		Power input		0.19		0.31		0.31	
	D Con- dition (12°C)	Pdh (declared heating cap) kW		1.21		1.71		1.74	
		COPd (declared COP)		6.90		6.65		5.94	5.88
		Power input		0.18		0.29		0.30	
	Power consump- tion in other than active mode	Thermo- stat-off mode	PTO	Heating	W	-	-	7	
			Cooling	W	-	-	7		
Standby mode		Cooling	PSB	W	-	-	15		
		Heating	PSB	W	-	-	15		
Off mode		POFF	W	-	-	15			
Cooling	Cdc (Degradation cooling)			0.25					
Heating	Cdh (Degradation heating)			0.25					
Cooling function included				Yes					
Heating function included				Yes					
Average climate included				Yes					
Cold season included				No					
Warm season included				Yes					
Ecolabel logo				No		-			

## 2 Specifications

### 1 - 1 RXM-R

Technical specifications					FFA25A9 + RXM25R	FFA35A9 + RXM35R	FFA50A9 + RXM50R	FFA60A9 + RXM60R
Eurovent	Sound power level outdoor	Cooling	Nom.	dBa	59	61	62	63
	Sound power level indoor	Cooling	Nom.	dBa	48	51	56	60
	Piping length	Cooling	Measuring condition	m	5.0	5.00		

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |  
 Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m. |  
 See separate drawing for operation range |  
 See separate drawing for electrical data

Technical specifications				FNA25A9 + RXM25R	FNA35A9 + RXM35R	FNA50A9 + RXM50R	FNA60A9 + RXM60R
Cooling capacity	Nom.		kW	2.60	3.40	5.00	6.00
	Nom.		Btu/h	8,872	11,600	17,100	20,500
	Nom.		kcal/h	2,236	2,923	4,299	5,159
Heating capacity	Nom.		kW	3.20	4.00	5.80	7.00
	Nom.		Btu/h	10,919	13,600	19,800	23,900
	Nom.		kcal/h	2,752	3,439	4,987	6,019
Power input	Cooling	Nom.	kW	0.68	1.10	1.48	2.22
	Heating	Nom.	kW	0.80	1.15	1.74	2.25
Nominal efficiency	EER			3.80	3.09	3.38	2.70
	COP			4.00	3.48	3.34	3.11
	Annual energy consumption		kWh	342	550	740	1,111
	Energy labeling	Cooling Heating Directive		A A	B B	A C	D D
Space cooling (Average climate)	Energy efficiency class				A+		A
	Capacity Pdesign		kW	2.60	3.40	5.00	6.00
	SEER			5.68	5.70	5.77	5.56
	Annual energy consumption		kWh/a	160	209	303	378
Space heating (Warm climate)	Energy efficiency class				A++		A++
	Capacity Pdesign		kW	2.80	2.90	4.00	4.60
	SCOP/A			4.24	4.05	4.09	4.16
	SCOPnet/A			4.28	4.08	4.12	4.19
	Pdh Heating capacity at -10°		kW	2.16	2.41	3.54	3.94
	Annual energy consumption		kWh/a	924	1,002	1,368	1,547
	Required back up heating cap at design conditions		kW	0.64	0.49	0.46	0.66
	Energy efficiency class				A+++		A++
Space heating (Average climate)	Capacity Pdesign		kW	1.51	1.57	2.16	2.48
	SCOP			5.43	5.10	4.88	5.02
	SCOPnet			5.50	5.17	4.93	5.08
	Annual energy consumption		kWh/a	389	431	620	691
Space heating (Warm climate)	Required back up heating cap at design conditions		kW	0.00			
	Energy efficiency class				A+++		A++
Space cooling (Average climate)	A Condi- tion (35°C - 27/19)	Pdc EERd Power input	kW	2.60 3.80 0.68	3.40 3.09 1.10	5.00 3.38 1.48	6.00 2.70 2.22
	B Condi- tion (30°C - 27/19)	Pdc EERd Power input	kW	1.92 5.17 0.37	2.50 4.41 0.57	3.69 5.02 0.74	4.43 4.64 0.95
	C Condi- tion (25°C - 27/19)	Pdc EERd Power input	kW	1.27 8.97 0.14	1.61 9.38 0.17	2.37 7.23 0.33	2.85 7.20 0.40
	D Condi- tion (20°C - 27/19)	Pdc EERd Power input	kW	1.33 10.18 0.13	1.46 10.14 0.14	1.74 10.72 0.16	2.34 10.44 0.22

## 2 Specifications

### 1 - 1 RXM-R

2

Technical specifications				FNA25A9 + RXM25R	FNA35A9 + RXM35R	FNA50A9 + RXM50R	FNA60A9 + RXM60R	
Space heating (Average climate)	TOL	Tol (temperature operating limit) °C		-15				
		Pdh (declared heating cap) kW	1.93	2.15	3.54	3.72		
		COPd (declared COP)	2.20	2.21	1.88	1.78		
		Power input kW		0.88	0.97	1.88	2.09	
	TBivalent	Tbiv (bivalent temperature) °C		-7				
		Pdh (declared heating cap) kW	2.48	2.57	3.54	4.07		
		COPd (declared COP)	2.80	2.71	2.90	2.82		
		Power input kW		0.89	0.95	1.22	1.44	
	A Con- dition (-7°C)	Pdh (declared heating cap) kW		2.48	2.57	3.54	4.07	
		COPd (declared COP)		2.80	2.71	2.90	2.82	
		Power input kW		0.89	0.95	1.22	1.44	
	B Condi- tion (2°C)	Pdh (declared heating cap) kW		1.51	1.57	2.16	2.48	
		COPd (declared COP)		4.18	4.01	4.13	4.22	
		Power input kW		0.36	0.39	0.52	0.59	
	C Condi- tion (7°C)	Pdh (declared heating cap) kW		1.00	1.02	1.66	1.59	
COPd (declared COP)		5.51	5.16	5.08				
Power input kW		0.18	0.20	0.33	0.31			
D Con- dition (12°C)	Pdh (declared heating cap) kW		1.17	1.19	1.96	1.95		
	COPd (declared COP)		6.80	6.35	6.16	6.19		
	Power input kW		0.17	0.19	0.32			
Power consump- tion in other than active mode	Crank- case heater mode	Cooling PCK kW	-	0.000	-	-		
		Heating PCK kW	-	0.000	-	-		
	Off mode	Cooling POFF kW	14.0	0.014	-	-		
		Heating POFF kW	14.0	0.014	-	-		
	Standby mode	Cooling PSB kW	14.0	0.014	-	-		
		Heating PSB kW	14.0	0.014	-	-		
	Thermo- stat-off mode	Cooling PTO kW	7.0	0.007	-	-		
		Heating PTO kW	7.0	0.007	-	-		
	Space heating (Warm climate)	TOL	Tol (temperature operating limit) °C		-15			
Pdh (declared heating cap) kW			1.93	2.15	3.54	3.72		
COPd (declared COP)			2.20	2.21	1.88	1.78		
Space heating (Warm climate)	TOL	Power input kW		0.88	0.97	1.88	2.09	
		TBivalent	Tbiv (bivalent temperature) °C		2			
			Pdh (declared heating cap) kW	1.51	1.57	2.16	2.48	
	COPd (declared COP)		4.18	4.01	4.13	4.22		
		Power input kW		0.36	0.39	0.52	0.59	
	B Condi- tion (2°C)	Pdh (declared heating cap) kW		1.51	1.57	2.16	2.48	
		COPd (declared COP)		4.18	4.01	4.13	4.22	
		Power input kW		0.36	0.39	0.52	0.59	
	C Condi- tion (7°C)	Pdh (declared heating cap) kW		1.00	1.02	1.66	1.59	
		COPd (declared COP)		5.51	5.16	5.08		
		Power input kW		0.18	0.20	0.33	0.31	
	D Con- dition (12°C)	Pdh (declared heating cap) kW		1.17	1.19	1.96	1.95	
		COPd (declared COP)		6.80	6.35	6.16	6.19	
		Power input kW		0.17	0.19	0.32		
	Power consump- tion in other than active mode	Thermo- stat-off mode	PTO Heating W	-	-	9	9	
Cooling W			-	-	9	9		
Standby mode		Cooling PSB W	-	-	15	15		
		Heating PSB W	-	-	15	15		
Off mode		POFF W	-	-	15	15		
Cooling	Cdc (Degradation cooling)		0.25					
Heating	Cdh (Degradation heating)		0.25					
Cooling function included	Yes							
Heating function included	Yes							
Average climate included	Yes							
Cold season included	No							
Warm season included	Yes							
Ecolabel logo	No		-					

## 2 Specifications

### 1 - 1 RXM-R

Technical specifications					FNA25A9 + RXM25R	FNA35A9 + RXM35R	FNA50A9 + RXM50R	FNA60A9 + RXM60R
Eurovent	Sound power level outdoor	Cooling	Nom.	dBa	59	61	62	63
	Sound power level indoor	Cooling	Nom.	dBa	53		56	
	Piping length	Cooling	Measuring condition	m	5.0	5.00		

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m. |

See separate drawing for operation range |

See separate drawing for electrical data

Technical specifications				FCAG35B + RXM35R	FCAG50B + RXM50R	FCAG60B + RXM60R
Cooling capacity	Nom.		kW	3.50	5.00	5.70
	Nom.		Btu/h	11,900	17,100	19,400
	Nom.		kcal/h	3,009	4,299	4,884
Heating capacity	Nom.		kW	4.20	6.00	7.00
	Nom.		Btu/h	14,300	20,500	23,900
	Nom.		kcal/h	3,611	5,159	6,019
Power input	Cooling	Nom.	kW	0.94	1.40	1.72
	Heating	Nom.	kW	1.11	1.62	2.07
Nominal efficiency	EER			3.72	3.58	3.31
	COP			3.77	3.70	3.38
	Annual energy consumption		kWh	470	698	858
	Energy labeling	Cooling Heating	Directive	A		C
Space cooling	Energy efficiency class			A++		
	Capacity	Pdesign	kW	3.50	5.00	5.70
	SEER			6.35	6.54	6.40
	Annual energy consumption		kWh/a	193	268	312
Space heating (Average climate)	Energy efficiency class			A++	A+	
	Capacity	Pdesign	kW	3.32	4.36	4.71
	SCOP/A			4.90	4.30	4.20
	SCOPnet/A			4.96	4.33	4.22
	Pdh Heating capacity at -10°		kW	2.60	3.86	4.12
	Annual energy consumption		kWh/a	948	1,418	1,569
	Required back up heating cap at design conditions		kW	0.72	0.50	0.59
	Energy efficiency class			A+++		
Space heating (Warm climate)	Capacity	Pdesignh	kW	1.79	2.35	2.53
	SCOP			6.27	5.22	5.32
	SCOPnet			6.36	5.31	5.41
	Annual energy consumption		kWh/a	400	630	669
	Required back up heating cap at design conditions		kW	0.00		
Space cooling	A Condi- tion (35°C - 27/19)	Pdc EERd	kW	3.50	5.00	5.70
				3.72	3.58	3.31
		Power input	kW	0.94	1.40	1.72
	B Condi- tion (30°C - 27/19)	Pdc EERd	kW	2.60	3.69	4.20
				5.33	5.17	4.70
		Power input	kW	0.49	0.71	0.89
Space cooling	C Condi- tion (25°C - 27/19)	Pdc EERd	kW	1.68	2.37	2.71
				9.52	8.52	7.91
		Power input	kW	0.18	0.28	0.34
	D Condi- tion (20°C - 27/19)	Pdc EERd	kW	1.49	1.87	1.62
				12.25	10.69	12.13
		Power input	kW	0.12	0.17	0.13

## 2 Specifications

### 1 - 1 RXM-R

2

Technical specifications					FCAG35B + RXM35R	FCAG50B + RXM50R	FCAG60B + RXM60R	
Space heating (Average climate)	TOL	Tol (temperature operating limit) °C			-15			
		Pdh (declared heating cap) kW	2.04	3.86	4.04			
		COPd (declared COP)	2.50	2.04	2.08			
		Power input kW	0.82	1.89	1.94			
	TBivalent	Tbiv (bivalent temperature) °C			-7			
		Pdh (declared heating cap) kW	2.94	3.86	4.17			
		COPd (declared COP)	3.10	2.81	2.56			
		Power input kW	0.95	1.37	1.63			
	A Con- dition (-7°C)	Pdh (declared heating cap) kW	2.94	3.86	4.17			
		COPd (declared COP)	3.10	2.81	2.56			
		Power input kW	0.95	1.37	1.63			
	B Condi- tion (2°C)	Pdh (declared heating cap) kW	1.79	2.35	2.56			
		COPd (declared COP)	4.98	4.39	4.31			
		Power input kW	0.36	0.54	0.59			
	C Condi- tion (7°C)	Pdh (declared heating cap) kW	1.15	1.54	1.64			
		COPd (declared COP)	6.20	5.31	5.28			
		Power input kW	0.19	0.29	0.31			
	D Con- dition (12°C)	Pdh (declared heating cap) kW	1.24	1.79	1.46			
		COPd (declared COP)	7.88	6.47	6.51			
		Power input kW	0.16	0.28	0.22			
Power consump- tion in other than active mode	Crank- case heater mode	Cooling PCK kW	0.000	-	-			
		Heating PCK kW	0.000	-	-			
	Off mode	Cooling POFF kW	0.014	-	-			
		Heating POFF kW	0.014	-	-			
	Standby mode	Cooling PSB kW	0.014	-	-			
		Heating PSB kW	0.014	-	-			
	Thermo- stat-off mode	Cooling PTO kW	0.007	-	-			
		Heating PTO kW	0.007	-	-			
	Space heating (Warm climate)	TOL	Tol (temperature operating limit) °C			-15		
			Pdh (declared heating cap) kW	2.04	3.86	4.04		
COPd (declared COP)			2.50	2.04	2.08			
Power input kW			0.82	1.89	1.94			
Space heating (Warm climate)	TBivalent	Tbiv (bivalent temperature) °C			2			
		Pdh (declared heating cap) kW	1.79	2.35	2.54			
		COPd (declared COP)	4.98	4.39	4.31			
		Power input kW	0.36	0.54	0.59			
	B Condi- tion (2°C)	Pdh (declared heating cap) kW	1.79	2.35	2.54			
		COPd (declared COP)	4.98	4.39	4.31			
		Power input kW	0.36	0.54	0.59			
	C Condi- tion (7°C)	Pdh (declared heating cap) kW	1.15	1.54	1.64			
		COPd (declared COP)	6.20	5.31	5.28			
		Power input kW	0.19	0.29	0.31			
	D Con- dition (12°C)	Pdh (declared heating cap) kW	1.24	1.79	1.46			
		COPd (declared COP)	7.88	6.47	6.51			
		Power input kW	0.16	0.28	0.22			
	Power consump- tion in other than active mode	Thermo- stat-off mode	PTO Heating W	-	15	-		
			Cooling W	-	5	-		
		Standby mode	Cooling PSB W	-	8	-		
Heating PSB W			-	8	-			
Off mode	POFF W	-	8	-				
Cooling	Cdc (Degradation cooling)			0.25				
Heating	Cdh (Degradation heating)			0.25				
Cooling function included					Yes			
Heating function included					Yes			
Average climate included					Yes			
Cold season included					No			
Warm season included					Yes			
Eurovent	Sound power level outdoor	Cooling Nom.	dBa	61	62	63		
		Cooling Nom.	dBa	49		51		
	Piping length	Cooling Measuring con- dition	m	5.00				

## 2 Specifications

### 1 - 1 RXM-R

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |  
 Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m. |  
 See separate drawing for operation range |  
 See separate drawing for electrical data

Technical specifications			FBA35A9 + RXM35R	FBA50A9 + RXM50R	FBA60A9 + RXM60R	
Cooling capacity	Nom.	kW	3.40	5.00	5.70	
	Nom.	Btu/h	11,600	17,100	19,400	
	Nom.	kcal/h	2,923	4,299	4,884	
Heating capacity	Nom.	kW	4.00	5.50	7.00	
	Nom.	Btu/h	13,600	18,800	23,900	
	Nom.	kcal/h	3,439	4,729	6,019	
Power input	Cooling Nom.	kW	0.85	1.41	1.64	
	Heating Nom.	kW	1.00	1.44	1.89	
Nominal efficiency	EER		4.02	3.55	3.48	
	COP		4.02	3.83	3.71	
	Annual energy consumption	kWh	423	704	819	
	Energy labeling	Cooling		A		
	Energy labeling	Heating		A		
Space cooling	Energy efficiency class		A++		A+	
	Capacity Pdesign	kW	3.40	5.00	5.70	
	SEER		6.23	6.27	5.91	
	Annual energy consumption	kWh/a	191	279	336	
Space heating (Average climate)	Energy efficiency class			A+		
	Capacity Pdesign	kW	2.90	4.40	4.60	
	SCOP/A		4.07	4.06	4.01	
	SCOPnet/A		4.11	4.08	4.03	
	Pdh Heating capacity at -10°	kW	2.41	3.73	3.99	
	Annual energy consumption	kWh/a	996	1,517	1,607	
	Required back up heating cap at design conditions	kW	0.49	0.67	0.61	
Space heating (Warm climate)	Energy efficiency class		A+++		A+	
	Capacity Pdesign	kW	1.57	2.37	2.44	
	SCOP		5.12	4.48	4.43	
	SCOPnet		5.19	4.49	4.44	
	Annual energy consumption	kWh/a	429	741	770	
Space cooling	Required back up heating cap at design conditions	kW		0.00		
	A Condi- tion (35°C - 27/19)	Pdc EERd	kW	3.40	5.00	5.70
				4.02	3.55	3.48
		Power input	kW	0.85	1.41	1.64
	B Condi- tion (30°C - 27/19)	Pdc EERd	kW	2.51	3.69	4.20
				5.54	5.26	5.05
Space cooling		Power input	kW	0.45	0.70	0.83
	C Condi- tion (25°C - 27/19)	Pdc EERd	kW	1.73	2.37	2.71
				8.13	8.41	7.97
		Power input	kW	0.21	0.28	0.34
	D Condi- tion (20°C - 27/19)	Pdc EERd	kW	1.61	1.98	2.13
				9.06	10.52	8.54
Space heating (Average climate)		Power input	kW	0.18	0.19	0.25
	TOL	Tol (temperature operating limit)	°C		-15	
		Pdh (declared heating cap)	kW	2.15	3.47	3.85
		COPd (declared COP)		2.37	1.95	2.11
		Power input	kW	0.91	1.78	1.82
	TBivalent	Tbiv (bivalent temperature)	°C		-7	
		Pdh (declared heating cap)	kW	2.57	3.90	4.09
		COPd (declared COP)		2.73	3.09	3.01
		Power input	kW	0.94	1.26	1.36
	A Con- dition (-7°C)	Pdh (declared heating cap)	kW	2.57	3.90	4.09
		COPd (declared COP)		2.73	3.09	3.01
		Power input	kW	0.94	1.26	1.36
	B Condi- tion (2°C)	Pdh (declared heating cap)	kW	1.57	2.37	2.44
		COPd (declared COP)		4.03	4.20	4.18
		Power input	kW	0.39	0.56	0.58
	C Condi- tion (7°C)	Pdh (declared heating cap)	kW	1.02	1.61	1.60
		COPd (declared COP)		5.18	4.55	4.41
		Power input	kW	0.20	0.35	0.36
	D Con- dition (12°C)	Pdh (declared heating cap)	kW	1.19	1.58	1.79
		COPd (declared COP)		6.38	5.23	5.32
	Power input	kW	0.19	0.30	0.34	

## 2 Specifications

### 1 - 1 RXM-R

2

Technical specifications					FBA35A9 + RXM35R	FBA50A9 + RXM50R	FBA60A9 + RXM60R
Power consumption in other than active mode	Crank-case heater mode	Cooling	PCK	kW	0.000		-
		Heating	PCK	kW	0.000		-
	Off mode	Cooling	POFF	kW	0.007		-
		Heating	POFF	kW	0.007		-
	Standby mode	Cooling	PSB	kW	0.007		-
		Heating	PSB	kW	0.007		-
	Thermo-stat-off mode	Cooling	PTO	kW	0.007		-
		Heating	PTO	kW	0.007		-
Space heating (Warm climate)	TOL	Tol (temperature operating limit) °C				-15	
		Pd <sub>h</sub> (declared heating cap) kW			2.15	3.47	3.85
		COP <sub>d</sub> (declared COP)			2.37	1.95	2.11
Space heating (Warm climate)	TBivalent	Power input kW			0.91	1.78	1.82
		T <sub>biv</sub> (bivalent temperature) °C				2	
		Pd <sub>h</sub> (declared heating cap) kW			1.57	2.37	2.48
	COP <sub>d</sub> (declared COP)			4.03	4.20	4.18	
	Power input kW			0.39	0.56	0.59	
	B Condition (2°C)	Pd <sub>h</sub> (declared heating cap) kW			1.57	2.37	2.44
		COP <sub>d</sub> (declared COP)			4.03	4.20	4.18
		Power input kW			0.39	0.56	0.58
	C Condition (7°C)	Pd <sub>h</sub> (declared heating cap) kW			1.02	1.61	1.60
		COP <sub>d</sub> (declared COP)			5.18	4.55	4.41
		Power input kW			0.20	0.35	0.36
	D Condition (12°C)	Pd <sub>h</sub> (declared heating cap) kW			1.19	1.58	1.79
		COP <sub>d</sub> (declared COP)			6.38	5.23	5.32
		Power input kW			0.19	0.30	0.34
	Power consumption in other than active mode	Thermo-stat-off mode	PTO	Heating	W	-	
Cooling				W	-		2
Standby mode		Cooling	PSB	W	-		13
		Heating	PSB	W	-		13
Off mode	POFF		W	-		13	
Cooling	C <sub>dc</sub> (Degradation cooling)					0.25	
Heating	C <sub>dh</sub> (Degradation heating)					0.25	
Cooling function included						Yes	
Heating function included						Yes	
Average climate included						Yes	
Cold season included						No	
Warm season included						Yes	
Eurovent	Sound power level outdoor	Cooling	Nom.	dB <sub>A</sub>	61	62	63
		Heating	Nom.	dB <sub>A</sub>			
	Sound power level indoor	Cooling	Nom.	dB <sub>A</sub>		60	56
Piping length	Cooling	Measuring condition		m		5.00	

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |  
 Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m. |

See separate drawing for operation range |

See separate drawing for electrical data

Technical specifications					FHA35A9 + RXM35R	FHA50A9 + RXM50R	FHA50A9 + RXM50R	FHA60A9 + RXM60R	FHA60A9 + RXM60R
Cooling capacity	Nom.		kW		3.40	5.00		5.70	
	Nom.		Btu/h		11,600	17,100		19,400	
	Nom.		kcal/h		2,923	4,299		4,884	
Heating capacity	Nom.		kW		4.00	6.00		7.20	
	Nom.		Btu/h		13,600	20,500		24,600	
	Nom.		kcal/h		3,439	5,159		6,191	
Power input	Cooling	Nom.	kW		0.91	1.56		1.73	
	Heating	Nom.	kW		0.98	1.79		2.17	
Nominal efficiency	EER				3.73	3.21		3.29	
	COP				4.08	3.35		3.32	
	Annual energy consumption kWh				456	779		866	
	Energy labeling Directive	Cooling				A			
Heating				A	C				



## 2 Specifications

### 1 - 1 RXM-R

Technical specifications		FHA35A9 + RXM35R	FHA50A9 + RXM50R	FHA50A9 + RXM50R	FHA60A9 + RXM60R	FHA60A9 + RXM60R
Space cooling	Energy efficiency class	A++			A+	
	Capacity Pdesign	kW	3.40	5.00		5.70
	SEER		6.24	5.92		6.08
	Annual energy consumption	kWh/a	191	295		328
Space heating (Average climate)	Energy efficiency class	A+			A	
	Capacity Pdesign	kW	3.10	4.35		4.71
	SCOP/A		4.43	3.86		3.87
	SCOPnet/A		4.47	3.88		3.89
	Pdh Heating capacity at -10°	kW	2.64	3.85		4.08
	Annual energy consumption	kWh/a	979	1,577		1,704
	Required back up heating cap at design conditions	kW	0.46	0.50		0.63
Space heating (Warm climate)	Energy efficiency class	A+++		A+		A++
	Capacity Pdesignh	kW	1.67	2.35		2.54
	SCOP		5.72	4.59		4.61
	SCOPnet		5.83	4.64		4.67
	Annual energy consumption	kWh/a	409	716		771
	Required back up heating cap at design conditions	kW		0.00		
Space cooling	A Condi- Pdc	kW	3.40	5.00		5.70
	tion (35°C EERd		3.73	3.21		3.29
	- 27/19) Power input	kW	0.91	1.56		1.73
	B Condi- Pdc	kW	2.51	3.69		4.20
tion (30°C EERd		5.28	5.04		4.88	
- 27/19) Power input	kW	0.48	0.73		0.86	
Space cooling	C Condi- Pdc	kW	1.68	2.37		2.71
	tion (25°C EERd		9.59	8.25		8.34
	- 27/19) Power input	kW	0.18	0.29		0.33
	D Condi- Pdc	kW	1.64	2.31		2.26
tion (20°C EERd		11.71	10.39		10.97	
- 27/19) Power input	kW	0.14	0.22		0.21	
Space heating (Average climate)	TOL Tol (temperature operating limit)	°C		-15		
	Pdh (declared heating cap)	kW	2.47	3.85		3.92
	COPd (declared COP)		2.23		1.97	
	Power input	kW	1.11	1.95		1.99
	TBivalent Tbiv (bivalent temperature)	°C		-7		
	Pdh (declared heating cap)	kW	2.74	3.85		4.12
	COPd (declared COP)		2.94	2.61		2.64
	Power input	kW	0.93	1.48		1.56
	A Con- Pdh (declared heating cap)	kW	2.74	3.85		4.17
	dition COPd (declared COP)		2.94	2.61		2.64
	(-7°C) Power input	kW	0.93	1.48		1.56
	B Condi- Pdh (declared heating cap)	kW	1.67	2.35		2.54
	tion (2°C) COPd (declared COP)		4.32	3.95		3.96
	Power input	kW	0.39	0.59		0.64
	C Condi- Pdh (declared heating cap)	kW	1.14	1.54		1.63
	tion (7°C) COPd (declared COP)		5.83	4.62		4.60
	Power input	kW	0.20	0.33		0.35
	D Con- Pdh (declared heating cap)	kW	1.34	1.80		1.74
	dition COPd (declared COP)		7.24		5.65	
	(12°C) Power input	kW	0.19	0.32		0.31
Power consumption in other than active mode	Crank- Cooling PCK	kW	0.000		-	
	case Heating PCK	kW	0.000		-	
	heater mode					
	Off mode Cooling POFF	kW	0.014		-	
	Heating POFF	kW	0.014		-	
	Standby mode Cooling PSB	kW	0.014		-	
	Heating PSB	kW	0.014		-	
	Thermo- Cooling PTO	kW	0.010		-	
stat-off Heating PTO	kW	0.010		-		
mode						
Space heating (Warm climate)	TOL Tol (temperature operating limit)	°C		-15		
	Pdh (declared heating cap)	kW	2.47	3.85		3.92
	COPd (declared COP)		2.23		1.97	

## 2 Specifications

### 1 - 1 RXM-R

2

Technical specifications					FHA35A9 + RXM35R	FHA50A9 + RXM50R	FHA50A9 + RXM50R	FHA60A9 + RXM60R	FHA60A9 + RXM60R
Space heating (Warm climate)	TOL	Power input	kW		1.11		1.95		1.99
	TBivalent	Tbiv (bivalent temperature)	°C		2				
		Pdh (declared heating cap)	kW		1.67		2.35		2.54
		COPd (declared COP)			4.32		3.95		3.96
	B Condition (2°C)	Power input	kW		0.39		0.59		0.64
		Pdh (declared heating cap)	kW		1.67		2.35		2.54
		COPd (declared COP)			4.32		3.95		3.96
	C Condition (7°C)	Power input	kW		0.39		0.59		0.64
		Pdh (declared heating cap)	kW		1.14		1.54		1.63
		COPd (declared COP)			5.83		4.62		4.60
	D Condition (12°C)	Power input	kW		0.20		0.33		0.35
		Pdh (declared heating cap)	kW		1.34		1.80		1.74
		COPd (declared COP)			7.24			5.65	
Power consumption in other than active mode	Thermostat-off mode	PTO	Heating	W	-			10	
			Cooling	W	-			10	
	Standby mode	Cooling	PSB		W	-			15
				Heating	PSB	W	-		
	Off mode	POFF			W	-			15
Cooling	Cdc (Degradation cooling)						0.25		
Heating	Cdh (Degradation heating)						0.25		
Cooling function included							Yes		
Heating function included							Yes		
Average climate included							Yes		
Cold season included							No		
Warm season included							Yes		
Eurovent	Sound power level outdoor	Cooling	Nom.	dBA	61		62		63
					53			54	
	Piping length	Cooling	Measuring condition	m			5.00		

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m. |

See separate drawing for operation range |

See separate drawing for electrical data

Technical specifications					FVXM25A + RXM25R	FVXM35A + RXM35R	FVXM50A + RXM50R
Cooling capacity	Min.			kW	1.30		1.40
	Min.			Btu/h	4,400		4,800
	Min.			kcal/h	1,118		1,204
	Nom.			kW	2.40	3.40	5.00
	Nom.			Btu/h	8,200	11,600	17,100
	Nom.			kcal/h	2,064	2,923	4,299
	Max.			kW	3.50	4.00	5.80
	Max.			Btu/h	11,900	13,600	19,800
	Max.			kcal/h	3,009	3,439	4,987
Cooling capacity - Low sound mode (Stb. 2020, 189)	Min.			kcal/h		-	
	Max.			kcal/h		-	
Heating capacity	Min.			kW	1.30		1.40
	Min.			Btu/h	4,400		4,800
	Min.			kcal/h	1,100		1,200
	Nom.			kW	3.40	4.50	5.80
	Nom.			Btu/h	11,600	15,400	19,800
	Nom.			kcal/h	2,923	3,869	4,987
	Max.			kW	4.70	5.80	8.10
	Max.			Btu/h	16,000	19,800	27,600
	Max.			kcal/h	4,041	4,987	6,965
Power input	Cooling	Nom.		kW	0.54	0.85	1.31
		Heating	Nom.	kW	0.75	1.15	1.52
Nominal efficiency	EER				4.47	4.01	3.81
	COP				4.55	3.90	3.81
	Annual energy consumption			kWh	268	424	656
	Energy labeling	Cooling				A	
	labeling	Heating				A	
Directive							

## 2 Specifications

### 1 - 1 RXM-R

Technical specifications			FVXM25A + RXM25R	FVXM35A + RXM35R	FVXM50A + RXM50R		
Space cooling	Energy efficiency class		A+++		A++		
	Capacity Pdesign	kW	2.40	3.40	5.00		
	SEER		8.55	8.11	7.30		
	Annual energy consumption		kWh/a	98	147	240	
Space heating (Average climate)	Capacity Pdesign		kW	2.30	2.80	4.10	
	Energy efficiency class		A++		A+		
	SCOP/A		4.65	4.63	4.31		
	SCOPnet/A			4.67	4.35		
	Pdh Heating capacity at -10°		kW	2.03	2.34	3.58	
Space heating (Average climate)	Annual energy consumption		kWh/a	693	847	1,330	
	Required back up heating cap at design conditions		kW	0.27	0.46	0.52	
Space heating (Warm climate)	Capacity Pdesignh		kW	1.24	1.51	2.21	
	Energy efficiency class		A+++		A++		
	SCOP			5.50	5.71	4.85	
	SCOPnet			5.61	5.80	4.94	
	Annual energy consumption		kWh/a	316	370	638	
	Required back up heating cap at design conditions		kW		0.00		
Space cooling	A Condi- tion (35°C - 27/19)	Pdc	kW	2.40	3.40	5.00	
		EERd		4.47	4.01	3.81	
		Power input	kW	0.54	0.85	1.31	
	B Condi- tion (30°C - 27/19)	Pdc	kW	1.77	2.51	3.69	
		EERd		6.50	5.82	5.49	
		Power input	kW	0.27	0.43	0.67	
	C Condi- tion (25°C - 27/19)	Pdc	kW	1.23	1.62	2.37	
		EERd		10.51	9.63	8.59	
		Power input	kW	0.12	0.17	0.28	
	D Condi- tion (20°C - 27/19)	Pdc	kW	1.18	1.12	2.20	
		EERd		14.90	15.17	12.51	
		Power input	kW	0.08	0.07	0.18	
Space heating (Average climate)	TOL	Tol (temperature operating limit)		°C		-15	
		Pdh (declared heating cap)	kW	2.01	2.12	3.49	
		COPd (declared COP)		2.24	1.94	1.82	
		Power input		kW	0.90	1.09	1.92
	TBivalent	Tbiv (bivalent temperature)		°C		-7	
		Pdh (declared heating cap)	kW	2.04	2.48	3.63	
		COPd (declared COP)		3.46	3.24	3.16	
		Power input		kW	0.59	0.77	1.15
	A Con- dition (-7°C)	Pdh (declared heating cap)	kW	2.04	2.48	3.63	
		COPd (declared COP)		3.46	3.24	3.16	
		Power input	kW	0.59	0.77	1.15	
	B Condi- tion (2°C)	Pdh (declared heating cap)	kW	1.24	1.51	2.21	
		COPd (declared COP)		4.67	4.58	4.45	
		Power input	kW	0.27	0.33	0.50	
	C Condi- tion (7°C)	Pdh (declared heating cap)	kW	1.02	1.03	1.67	
		COPd (declared COP)		5.67	5.80	5.15	
		Power input	kW		0.18	0.32	
	Space heating (Average climate)	D Con- dition (12°C)	Pdh (declared heating cap)	kW	1.06	1.18	1.84
COPd (declared COP)				7.16	7.13	5.98	
Power input			kW	0.15	0.17	0.31	
Space heating (Warm climate)	TOL	Tol (temperature operating limit)		°C		-15	
		Pdh (declared heating cap)	kW	2.01	2.12	3.49	
		COPd (declared COP)		2.24	1.94	1.82	
		Power input		kW	0.90	1.09	1.92
	TBivalent	Tbiv (bivalent temperature)		°C		2	
		Pdh (declared heating cap)	kW	1.24	1.51	2.21	
		COPd (declared COP)		4.67	4.58	4.45	
		Power input		kW	0.27	0.33	0.50
	B Condi- tion (2°C)	Pdh (declared heating cap)	kW	1.24	1.51	2.21	
		COPd (declared COP)		4.67	4.58	4.45	
		Power input	kW	0.27	0.33	0.50	
	C Condi- tion (7°C)	Pdh (declared heating cap)	kW	1.02	1.03	1.67	
		COPd (declared COP)		5.67	5.80	5.15	
		Power input	kW		0.18	0.32	
	D Con- dition (12°C)	Pdh (declared heating cap)	kW	1.06	1.18	1.84	
		COPd (declared COP)		7.16	7.13	5.98	
		Power input	kW	0.15	0.17	0.31	

## 2 Specifications

### 1 - 1 RXM-R

2

Technical specifications					FVXM25A + RXM25R	FVXM35A + RXM35R	FVXM50A + RXM50R
Power consumption in other than active mode	Off mode	POFF		W	1		
	Standby mode	Cooling	PSB	W	1		
		Heating	PSB	W	1		
	Thermostat-off mode	PTO	Cooling		W	6	
Heating				W	8		15
Cooling	Cdc (Degradation cooling)				0.25		
Heating	Cdh (Degradation heating)				0.25		
Cooling function included					Yes		
Heating function included					Yes		
Average climate included					Yes		
Cold season included					No		
Warm season included					Yes		
Eurovent	Sound power level outdoor	Cooling	Nom.	dBA	59	61	62
					52	53	61
	Piping length	Cooling	Measuring condition		m	5.00	

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m. |

See separate drawing for operation range |

See separate drawing for electrical data

Technical specifications					FVXM25F + RXM25R	FVXM35F + RXM35R	FVXM50F + RXM50R					
Indoor unit					FVXM25FV1B	FVXM35FV1B	FVXM50FV1B9					
Outdoor unit					RXM25R5V1B	RXM35R5V1B	RXM50R5V1B					
Cooling capacity	Min.		kW		1.30		1.40					
					Btu/h	4,435		4,776				
					kcal/h	1,117		1,203				
	Nom.		kW		2.50	3.50	5.00					
					Btu/h	8,530	11,943	17,061				
					kcal/h	2,150	3,009	4,299				
	Max.		kW		3.00	3.80	5.60					
					Btu/h	10,236	12,966	19,107				
					kcal/h	2,579	3,267	4,815				
Cooling capacity - Low sound mode (Stb. 2020, 189)	Min.		kcal/h		-	-						
	Max.		kcal/h		-	-						
Heating capacity	Min.		kW		1.30		1.40					
					Btu/h	4,435		4,776				
					kcal/h	1,117		1,203				
	Nom.		kW		3.40	4.50	5.80					
					Btu/h	11,601	15,355	19,790				
					kcal/h	2,923	3,869	4,987				
	Max.		kW		4.50	5.00	8.10					
					Btu/h	15,354	17,060	27,638				
					kcal/h	3,869	4,299	6,964				
Power input	Cooling	Nom.	kW		0.60	1.09	1.55					
	Heating	Nom.	kW		0.77	1.19	1.60					
Nominal efficiency	EER				4.20	3.21	3.23					
	COP				4.42	3.78	3.63					
	Annual energy consumption				kWh	298	545	773				
	Energy labeling Directive	Cooling				A						
		Heating				A						
Space cooling	Energy efficiency class					A++						
	Capacity	Pdesign		kW	2.50	3.50	5.00					
					SEER	7.20	6.43	6.80				
					Annual energy consumption	kWh/a	120	190	257			
Space heating (Average climate)	Capacity	Pdesign		kW	2.40	2.90	4.20					
					Energy efficiency class				A+			
					SCOP/A		4.56		4.00			
Space heating (Average climate)	SCOPnet/A				4.59	4.03	4.01					
	PdH Heating capacity at -10°			kW	2.23	2.40	2.23					
					Annual energy consumption				kWh/a	737	1,015	1,471
					Required back up heating cap at design conditions				kW	0.17	0.50	1.97

## 2 Specifications

### 1 - 1 RXM-R

Technical specifications					FVXM25F + RXM25R	FVXM35F + RXM35R	FVXM50F + RXM50R		
Space heating (Warm climate)	Capacity	Pdesignh	kW		1.29	1.56	2.27		
	Energy efficiency class				A+++				
	SCOP				5.81	5.44	4.96		
	SCOPnet				5.93	5.52	5.01		
	Annual energy consumption				311	402	641		
	Required back up heating cap at design conditions				0.00				
Space cooling	A Condi- tion (35°C -27/19)	Pdc EERd	kW		2.50 4.20	3.50 3.21	5.00 3.23		
	Power input				0.60	1.09	1.55		
	B Condi- tion (30°C -27/19)	Pdc EERd	kW		1.84 6.36	2.58 4.75	3.68 5.07		
	Power input				0.29	0.54	0.73		
	C Condi- tion (25°C -27/19)	Pdc EERd	kW		1.17 8.43	1.68 7.62	2.38 8.44		
	Power input				0.14	0.22	0.28		
	D Condi- tion (20°C -27/19)	Pdc EERd	kW		0.98 11.48	0.95 11.50	2.29 11.88		
	Power input				0.09	0.08	0.19		
	Space heating (Average climate)	TOL	Tol (temperature operating limit)		°C	-15			
		PdH (declared heating cap)				kW	2.09	2.12	3.96
		COPd (declared COP)					2.24	1.94	1.82
		Power input				kW	0.93	1.09	2.18
		TBivalent	Tbiv (bivalent temperature)		°C	-7			
			PdH (declared heating cap)				kW	2.12	2.57
COPd (declared COP)					3.25	2.40	2.20		
Power input				kW	0.65	1.07	1.69		
A Con- dition (-7°C)		PdH (declared heating cap)				kW	2.12	2.57	3.72
		COPd (declared COP)					3.25	2.40	2.20
		Power input				kW	0.65	1.07	1.69
B Condi- tion (2°C)		PdH (declared heating cap)				kW	1.29	1.56	2.27
		COPd (declared COP)					4.39	4.03	4.32
		Power input				kW	0.29	0.39	0.53
C Condi- tion (7°C)		PdH (declared heating cap)				kW	0.83	1.03	1.80
		COPd (declared COP)					5.79	5.11	5.13
		Power input				kW	0.14	0.20	0.35
D Con- dition (12°C)		PdH (declared heating cap)				kW	0.78	1.08	1.91
		COPd (declared COP)					7.27	7.24	6.25
		Power input				kW	0.11	0.15	0.31
Space heating (Warm climate)	TOL	Tol (temperature operating limit)		°C	-15				
	PdH (declared heating cap)				kW	2.09	2.12	3.96	
	COPd (declared COP)					2.24	1.94	1.82	
	Power input				kW	0.93	1.09	2.18	
	TBivalent	Tbiv (bivalent temperature)		°C	2				
		PdH (declared heating cap)				kW	1.29	1.56	2.27
		COPd (declared COP)					4.39	4.03	4.32
		Power input				kW	0.29	0.39	0.53
	B Condi- tion (2°C)	PdH (declared heating cap)				kW	1.29	1.56	2.27
		COPd (declared COP)					4.39	4.03	4.32
		Power input				kW	0.29	0.39	0.53
	C Condi- tion (7°C)	PdH (declared heating cap)				kW	0.83	1.03	1.80
		COPd (declared COP)					5.79	5.11	5.13
		Power input				kW	0.14	0.20	0.35
	D Con- dition (12°C)	PdH (declared heating cap)				kW	0.78	1.08	1.91
		COPd (declared COP)					7.27	7.24	6.25
		Power input				kW	0.11	0.15	0.31
	Power consump- tion in other than active mode	Off mode				POFF	W	2.0	
		Standby mode	Cooling	PSB		W	2.0		
			Heating	PSB		W	2.0		
Thermo- stat-off mode		PTO	Cooling	W		8.0			
		Heating	W		8.0				
Cooling	Cdc (Degradation cooling)				0.25				
Heating	Cdh (Degradation heating)				0.25				
Cooling function included					Yes				
Heating function included					Yes				
Average climate included					Yes				
Cold season included					No				
Warm season included					Yes				
Ecolabel logo					No				

## 2 Specifications

### 1 - 1 RXM-R

2

Technical specifications					FVXM25F + RXM25R	FVXM35F + RXM35R	FVXM50F + RXM50R
Eurovent	Sound power level outdoor	Cooling	Nom.	dB(A)	59	61	62
	Sound power level indoor	Cooling	Nom.	dB(A)	52		57
Eurovent	Piping length	Cooling	Measuring condition	m	5.0		

See separate drawing for electrical data |

See separate drawing for operation range |

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Technical specifications				FTXM20R + RXM20R	FTXM25R + RXM25R	FTXM35R + RXM35R	FTXM42R + RXM42R	FTXM50R + RXM50R	FTXM60R + RXM60R
Cooling capacity	Min.		kW	1.30		1.40	1.70		
	Min.		Btu/h	4,400		4,800	5,800		
	Min.		kcal/h	1,118		1,204	1,462		
	Nom.		kW	2.00	2.50	3.40	4.20	5.00	6.00
	Nom.		Btu/h	6,800	8,500	11,600	14,300	17,100	20,500
	Nom.		kcal/h	1,720	2,150	2,923	3,611	4,299	5,159
	Max.		kW	2.60	3.20	4.00	5.00	6.00	7.00
	Max.		Btu/h	8,900	10,900	13,600	17,100	20,500	23,900
	Max.		kcal/h	2,236	2,752	3,439	4,299	5,159	6,019
Cooling capacity - Low sound mode (Stb. 2020, 189)	Min.		kcal/h	-					
	Max.		kcal/h	-					
Heating capacity	Min.		kW	1.30		1.40	1.70		
	Min.		Btu/h	4,400		4,800	5,800		
	Min.		kcal/h	1,100		1,200	1,500		
	Nom.		kW	2.50	2.80	4.00	5.40	5.80	7.00
	Nom.		Btu/h	8,500	9,600	13,600	18,400	19,800	23,900
	Nom.		kcal/h	2,150	2,408	3,439	4,643	4,987	6,019
	Max.		kW	3.50	4.70	5.20	6.00	7.70	8.00
	Max.		Btu/h	11,900	16,000	17,700	20,500	26,300	27,300
	Max.		kcal/h	3,009	4,041	4,471	5,159	6,621	6,879
Power input	Cooling	Nom.	kW	0.44	0.56	0.80	0.97	1.36	1.77
	Heating	Nom.	kW	0.50	0.56	0.99	1.31	1.45	1.94
Nominal efficiency	EER			4.57	4.50	4.23	4.33	3.68	3.39
	COP			5.00		4.04	4.12	4.00	3.61
	Annual energy consumption		kWh	219	278	402	485	679	885
	Energy labeling Directive	Cooling Heating		A A					
Space cooling	Energy efficiency class			A+++			A++		
	Capacity Pdesign		kW	2.00	2.50	3.40	4.20	5.00	6.00
	SEER			8.65			7.85	7.41	6.90
	Annual energy consumption		kWh/a	81	101	137	187	236	304
Space heating (Average climate)	Capacity Pdesign		kW	2.30	2.40	2.50	4.00	4.60	4.80
	Energy efficiency class			A+++			A++		A+
	SCOP/A			5.10			4.71		4.30
	SCOPnet/A			5.13	5.14		4.76	4.75	4.34
	Pdh Heating capacity at -10°		kW	2.24	2.30	2.35	3.67	3.85	3.99
Space heating (Average climate)	Annual energy consumption		kWh/a	631	659	686	1,189	1,368	1,562
	Required back up heating cap at design conditions		kW	0.06	0.10	0.15	0.33	0.75	0.81
Space heating (Warm climate)	Capacity Pdesignh		kW	1.24	1.29	1.35	2.15	2.48	2.63
	Energy efficiency class			A+++					
	SCOP			6.19	6.15	6.18	6.15	5.82	5.51
	SCOPnet			6.32	6.25	6.28	6.24	5.93	5.60
	Annual energy consumption		kWh/a	280	296	306	490	596	668
	Required back up heating cap at design conditions		kW	0.00					

# 2 Specifications

## 1 - 1 RXM-R

Technical specifications				FTXM20R + RXM20R	FTXM25R + RXM25R	FTXM35R + RXM35R	FTXM42R + RXM42R	FTXM50R + RXM50R	FTXM60R + RXM60R	
Space cooling	A Condi- tion (35°C - 27/19)	Pdc	kW	2.00	2.50	3.40	4.20	5.00	6.00	
		EERd		4.57	4.50	4.23	4.33	3.68	3.39	
	B Condi- tion (30°C - 27/19)	Pdc	kW	0.44	0.56	0.80	0.97	1.36	1.77	
		EERd		1.48	1.85	2.51	3.16	3.69	4.43	
	C Condi- tion (25°C - 27/19)	Pdc	kW	6.73	6.52	6.26	6.18	5.85	4.82	
		EERd		0.22	0.28	0.40	0.51	0.63	0.92	
	D Condi- tion (20°C - 27/19)	Pdc	kW	1.10	1.19	1.62	2.05	2.37	2.85	
		EERd		10.52	10.17	10.18	9.24	8.43	8.09	
		Pdc	kW	0.10	0.12	0.16	0.22	0.28	0.35	
		EERd		1.05	1.17	1.04	1.82	1.83	1.93	
	Pdc	kW	16.53	16.51	16.32	12.40	13.00	13.26		
	EERd		0.06	0.07	0.06	0.15	0.14	0.15		
Space heating (Average climate)	TOL	Tol (temperature operating limit) °C		-20						
		Pdh (declared heating cap) kW	2.14			2.67	3.12			
		COPd (declared COP)	2.29		2.50	1.99	2.04			
		Power input kW	0.93		0.86	1.34	1.53			
	TBivalent	Tbiv (bivalent temperature) °C		-7						
		Pdh (declared heating cap) kW	2.04	2.13	2.22	3.76	4.07	4.26		
		COPd (declared COP)	3.51	3.60	3.55	3.16	2.95	2.68		
		Power input kW	0.58	0.59	0.63	1.19	1.38	1.59		
	A Con- dition (-7°C)	Pdh (declared heating cap) kW	2.04	2.13	2.22	3.76	4.07	4.26		
		COPd (declared COP)	3.51	3.60	3.55	3.16	2.95	2.68		
		Power input kW	0.58	0.59	0.63	1.19	1.38	1.59		
	B Condi- tion (2°C)	Pdh (declared heating cap) kW	1.24	1.29	1.35	2.16	2.48	2.63		
		COPd (declared COP)	5.16	5.14	5.11	4.54	4.80	4.31		
		Power input kW	0.24	0.25	0.26	0.48	0.52	0.61		
	C Condi- tion (7°C)	Pdh (declared heating cap) kW	0.96	0.94	0.93	1.43	1.70	1.67		
		COPd (declared COP)	6.34	6.26	6.25	6.32	6.02	5.64		
Power input kW		0.15		0.23	0.28	0.30				
Space heating (Average climate)	D Con- dition (12°C)	Pdh (declared heating cap) kW	0.99	1.08		1.54	1.98	1.96		
		COPd (declared COP)	7.99	7.85	7.72	7.69	7.18	6.82		
		Power input kW	0.12	0.14		0.20	0.28	0.29		
		TOL	Tol (temperature operating limit) °C		-20					
Space heating (Warm climate)	TOL	Tol (temperature operating limit) °C		-20						
		Pdh (declared heating cap) kW	2.14			2.67	3.12			
		COPd (declared COP)	2.29		2.50	1.99	2.04			
		Power input kW	0.93		0.86	1.34	1.53			
	TBivalent	Tbiv (bivalent temperature) °C		2						
		Pdh (declared heating cap) kW	1.24	1.29	1.35	2.16	2.48	2.63		
		COPd (declared COP)	5.16	5.14	5.11	4.54	4.80	4.31		
		Power input kW	0.24	0.25	0.26	0.48	0.52	0.61		
	B Condi- tion (2°C)	Pdh (declared heating cap) kW	1.24	1.29	1.35	2.16	2.48	2.63		
		COPd (declared COP)	5.16	5.14	5.11	4.54	4.80	4.31		
		Power input kW	0.24	0.25	0.26	0.48	0.52	0.61		
	C Condi- tion (7°C)	Pdh (declared heating cap) kW	0.96	0.94	0.93	1.43	1.70	1.67		
		COPd (declared COP)	6.34	6.26	6.25	6.32	6.02	5.64		
		Power input kW	0.15		0.23	0.28	0.30			
	D Con- dition (12°C)	Pdh (declared heating cap) kW	0.99	1.08		1.54	1.98	1.96		
		COPd (declared COP)	7.99	7.85	7.72	7.69	7.18	6.82		
		Power input kW	0.12	0.14		0.20	0.28	0.29		
		TOL	Tol (temperature operating limit) °C		-20					
Power consump- tion in other than active mode	Off mode	POFF	W				1			
	Standby mode	Cooling	PSB	W				1		
		Heating	PSB	W				1		
	Thermo- stat-off mode	PTO	Cooling	W	6		7	12		
			Heating	W	7		13	14		
Cooling	Cdc (Degradation cooling)						0.25			
Heating	Cdh (Degradation heating)						0.25			
Cooling function included							Yes			
Heating function included							Yes			
Average climate included							Yes			
Cold season included							No			
Warm season included							Yes			

## 2 Specifications

### 1 - 1 RXM-R

2

Technical specifications					FTXM20R + RXM20R	FTXM25R + RXM25R	FTXM35R + RXM35R	FTXM42R + RXM42R	FTXM50R + RXM50R	FTXM60R + RXM60R
Eurovent	Sound power level outdoor	Cooling	Nom.	dBa	59	58	61	62		63
	Sound power level indoor	Cooling	Nom.	dBa	57		58	60	58	60
	Piping length	Cooling	Measuring condition	m	5.00					

Technical specifications				FTXM71R + RXM71R	
Cooling capacity	Min.		kW	2.30	
	Min.		Btu/h	7,800	
	Min.		kcal/h	1,978	
	Nom.		kW	7.10	
	Nom.		Btu/h	24,200	
	Nom.		kcal/h	6,105	
	Max.		kW	8.50	
	Max.		Btu/h	29,000	
	Max.		kcal/h	7,309	
Cooling capacity - Low sound mode (Stb. 2020, 189)	Min.		kcal/h	-	
	Max.		kcal/h	-	
Heating capacity	Min.		kW	2.30	
	Min.		Btu/h	7,800	
	Min.		kcal/h	2,000	
	Nom.		kW	8.20	
	Nom.		Btu/h	28,000	
	Nom.		kcal/h	7,051	
	Max.		kW	10.20	
	Max.		Btu/h	34,800	
	Max.		kcal/h	8,770	
Power input	Cooling	Nom.	kW	2.34	
	Heating	Nom.	kW	2.57	
Nominal efficiency	EER			3.03	
	COP			3.19	
	Annual energy consumption		kWh	1,172	
	Energy labeling	Cooling		B	
	Directive	Heating		D	
Space cooling	Energy efficiency class			A++	
	Capacity	Pdesign	kW	7.10	
	SEER			6.20	
	Annual energy consumption		kWh/a	401	
Space heating (Average climate)	Capacity	Pdesign	kW	6.20	
	Energy efficiency class			A+	
	SCOP/A			4.10	
	SCOPnet/A			4.13	
Space heating (Average climate)	Pdh Heating capacity at -10°		kW	5.01	
	Annual energy consumption		kWh/a	2,117	
	Required back up heating cap at design conditions		kW	1.19	
Space heating (Warm climate)	Capacity	Pdesignh	kW	3.34	
	Energy efficiency class			A+++	
	SCOP			5.74	
	SCOPnet			5.81	
	Annual energy consumption		kWh/a	814	
	Required back up heating cap at design conditions		kW	0.00	
Space cooling	A Condi- tion (35°C - 27/19)	Pdc EERd	kW	7.10	
		Power input	kW	3.03	
	B Condi- tion (30°C - 27/19)	Pdc EERd	kW	5.24	
		Power input	kW	4.88	
	C Condi- tion (25°C - 27/19)	Pdc EERd	kW	1.07	
		Power input	kW	3.37	
	D Condi- tion (20°C - 27/19)	Pdc EERd	kW	7.39	
		Power input	kW	0.46	
			kW	2.60	
			kW	9.69	
			kW	0.27	



## 2 Specifications

### 1 - 1 RXM-R

Technical specifications				FTXM71R + RXM71R		
Space heating (Average climate)	TOL	Tol (temperature operating limit) °C		-15		
		Pd <sub>h</sub> (declared heating cap) kW		4.23		
		COP <sub>d</sub> (declared COP)		1.75		
	Power input kW		2.42			
	TBivalent	T <sub>biv</sub> (bivalent temperature) °C		-7		
		Pd <sub>h</sub> (declared heating cap) kW		5.49		
		COP <sub>d</sub> (declared COP)		2.14		
	Power input kW		2.57			
	A Con- dition (-7°C)	Pd <sub>h</sub> (declared heating cap) kW		5.49		
		COP <sub>d</sub> (declared COP)		2.14		
	B Condi- tion (2°C)	Pd <sub>h</sub> (declared heating cap) kW		2.57		
		COP <sub>d</sub> (declared COP)		3.34		
Power input kW		4.18				
C Condi- tion (7°C)	Pd <sub>h</sub> (declared heating cap) kW		0.80			
	COP <sub>d</sub> (declared COP)		2.32			
	Power input kW		5.80			
Space heating (Average climate)	D Con- dition (12°C)	Pd <sub>h</sub> (declared heating cap) kW		2.38		
		COP <sub>d</sub> (declared COP)		7.17		
		Power input kW		0.33		
Space heating (Warm climate)	TOL	Tol (temperature operating limit) °C		-15		
		Pd <sub>h</sub> (declared heating cap) kW		4.23		
		COP <sub>d</sub> (declared COP)		1.75		
	Power input kW		2.42			
	TBivalent	T <sub>biv</sub> (bivalent temperature) °C		2		
		Pd <sub>h</sub> (declared heating cap) kW		3.34		
		COP <sub>d</sub> (declared COP)		4.18		
	Power input kW		0.80			
	B Condi- tion (2°C)	Pd <sub>h</sub> (declared heating cap) kW		3.34		
		COP <sub>d</sub> (declared COP)		4.18		
	Power input kW		0.80			
	C Condi- tion (7°C)	Pd <sub>h</sub> (declared heating cap) kW		2.32		
		COP <sub>d</sub> (declared COP)		5.80		
	Power input kW		0.40			
	D Con- dition (12°C)	Pd <sub>h</sub> (declared heating cap) kW		2.38		
		COP <sub>d</sub> (declared COP)		7.17		
		Power input kW		0.33		
	Power consump- tion in other than active mode	Off mode	POFF	W	1	
Standby mode		Cooling	PSB	W	1	
		Heating	PSB	W	1	
Thermo- stat-off mode		PTO	Cooling	W	12	
			Heating	W	13	
Cooling	C <sub>dc</sub> (Degradation cooling)		0.25			
Heating	C <sub>dh</sub> (Degradation heating)		0.25			
Cooling function included				Yes		
Heating function included				Yes		
Average climate included				Yes		
Cold season included				No		
Warm season included				Yes		
Eurovent	Sound power level outdoor	Cooling	Nom.	dB <sub>A</sub>	66	
		Cooling	Nom.	dB <sub>A</sub>	62	
	Piping length	Cooling	Measuring con- dition	m	5.00	

See separate drawing for operation range |

See separate drawing for electrical data |

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Technical specifications	FTXM20N + RXM20R	FTXM25N + RXM25R	FTXM35N + RXM35R
Indoor unit	FTXM20N2V1B	FTXM25N2V1B	FTXM35N2V1B
Outdoor unit	RXM20R5V1B	RXM25R5V1B	RXM35R5V1B

## 2 Specifications

### 1 - 1 RXM-R

2

Technical specifications			FTXM20N + RXM20R	FTXM25N + RXM25R	FTXM35N + RXM35R	
Cooling capacity	Min.	kW	1.30		1.40	
	Min.	Btu/h	4,400		4,800	
	Min.	kcal/h	1,118		1,204	
	Nom.	kW	2.00	2.50	3.40	
	Nom.	Btu/h	6,800	8,500	11,600	
	Nom.	kcal/h	1,720	2,150	2,923	
	Max.	kW	2.60	3.20	4.00	
	Max.	Btu/h	8,900	10,900	13,600	
	Max.	kcal/h	2,236	2,752	3,439	
Cooling capacity - Low sound mode (Stb. 2020, 189)	Min.				-	
	Max.				-	
Heating capacity	Min.	kW	1.30		1.40	
	Min.	Btu/h	4,400		4,800	
	Min.	kcal/h	1,100		1,200	
	Nom.	kW	2.50	2.80	4.00	
	Nom.	Btu/h	8,500	9,600	13,600	
	Nom.	kcal/h	2,150	2,408	3,439	
	Max.	kW	3.50	4.70	5.20	
	Max.	Btu/h	11,900	16,000	17,700	
	Max.	kcal/h	3,009	4,041	4,471	
Power input	Cooling	Nom. kW	0.44	0.56	0.80	
	Heating	Nom. kW	0.50	0.56	0.99	
Nominal efficiency	EER		4.57	4.50	4.23	
	COP		5.00		4.04	
	Annual energy consumption	kWh	219	278	402	
	Energy labeling Directive	Cooling Heating			A A	
Space cooling	Energy efficiency class				A+++	
	Capacity Pdesign	kW	2.00	2.50	3.40	
	SEER				8.65	
	Annual energy consumption	kWh/a	81	101	138	
Space heating (Average climate)	Capacity Pdesign	kW	2.30	2.40	2.50	
	Energy efficiency class				A+++	
	SCOP/A				5.10	
Space heating (Average climate)	SCOPnet/A				5.14	
	Pdh Heating capacity at -10°	kW	2.24	2.30	2.35	
	Annual energy consumption	kWh/a	632	659	687	
	Required back up heating cap at design conditions	kW	0.06	0.10	0.15	
Space heating (Warm climate)	Capacity Pdesignh	kW	1.24	1.29	1.35	
	Energy efficiency class				A+++	
	SCOP		6.19	6.15	6.18	
	SCOPnet		6.31	6.26	6.30	
	Annual energy consumption	kWh/a	280	294	305	
	Required back up heating cap at design conditions	kW			0.00	
Space cooling	A Condi- tion (35°C - 27/19)	Pdc EERd Power input	kW	2.00 4.57 0.44	2.50 4.50 0.56	3.40 4.23 0.80
	B Condi- tion (30°C - 27/19)	Pdc EERd Power input	kW	1.47 6.88 0.21	1.84 6.60 0.28	2.51 6.25 0.40
	C Condi- tion (25°C - 27/19)	Pdc EERd Power input	kW	1.18 10.52 0.11	1.18 10.03 0.12	1.61 10.19 0.16
	D Condi- tion (20°C - 27/19)	Pdc EERd Power input	kW	1.05 16.53 0.06	1.05 16.37 0.06	1.07 16.36 0.07

# 2 Specifications

## 1 - 1 RXM-R

Technical specifications					FTXM20N + RXM20R	FTXM25N + RXM25R	FTXM35N + RXM35R
Space heating (Average climate)	TOL	Tol (temperature operating limit) °C			-20		
		Pd <sub>h</sub> (declared heating cap) kW			2.14		
		COP <sub>d</sub> (declared COP)			2.29		2.49
	Power input kW			0.93		0.86	
	TBivalent	Tbiv (bivalent temperature) °C			-7		
		Pd <sub>h</sub> (declared heating cap) kW			2.03	2.12	2.21
		COP <sub>d</sub> (declared COP)			3.64	3.60	3.50
		Power input kW			0.56	0.59	0.63
	A Con- dition (-7°C)	Pd <sub>h</sub> (declared heating cap) kW			2.03	2.12	2.21
		COP <sub>d</sub> (declared COP)			3.64	3.60	3.50
		Power input kW			0.56	0.59	0.63
	B Condi- tion (2°C)	Pd <sub>h</sub> (declared heating cap) kW			1.24	1.29	1.34
COP <sub>d</sub> (declared COP)			5.10		5.13		
Power input kW			0.24	0.25	0.26		
C Condi- tion (7°C)	Pd <sub>h</sub> (declared heating cap) kW			0.93	0.94	0.95	
	COP <sub>d</sub> (declared COP)			6.28		6.22	
Space heating (Average climate)	C Condi- tion (7°C)	Power input kW			0.15		
		Pd <sub>h</sub> (declared heating cap) kW			0.97	0.98	1.09
	D Con- dition (12°C)	COP <sub>d</sub> (declared COP)			7.99		7.81
		Power input kW			0.12		0.14
Space heating (Warm climate)	TOL	Tol (temperature operating limit) °C			-20		
		Pd <sub>h</sub> (declared heating cap) kW			2.14		2.59
		COP <sub>d</sub> (declared COP)			2.29		2.49
		Power input kW			0.93		1.04
	TBivalent	Tbiv (bivalent temperature) °C			2		
		Pd <sub>h</sub> (declared heating cap) kW			1.24	1.29	1.34
		COP <sub>d</sub> (declared COP)			5.10		5.13
		Power input kW			0.24	0.25	0.26
	B Condi- tion (2°C)	Pd <sub>h</sub> (declared heating cap) kW			1.24	1.29	1.34
		COP <sub>d</sub> (declared COP)			5.10		5.13
		Power input kW			0.24	0.25	0.26
	C Condi- tion (7°C)	Pd <sub>h</sub> (declared heating cap) kW			0.93	0.94	0.95
		COP <sub>d</sub> (declared COP)			6.28		6.22
		Power input kW				0.15	
	D Con- dition (12°C)	Pd <sub>h</sub> (declared heating cap) kW			0.97	0.98	1.09
		COP <sub>d</sub> (declared COP)			7.99		7.81
		Power input kW			0.12		0.14
	Power consump- tion in other than active mode	Off mode	POFF	W	1		
Standby mode		Cooling	PSB	1			
		Heating	PSB	1			
Thermo- stat-off mode		PTO	Cooling	W	6		
			Heating	W	7		
Cooling	Cdc (Degradation cooling)			0.25			
Heating	Cdh (Degradation heating)			0.25			
Cooling function included				Yes			
Heating function included				Yes			
Average climate included				Yes			
Cold season included				No			
Warm season included				Yes			
Ecolabel logo				No			
Eurovent	Sound power level outdoor	Cooling	Nom.	dB <sub>A</sub>	59	58	61
		Cooling	Nom.	dB <sub>A</sub>		57	58
Eurovent	Piping length	Cooling	Measuring condition	m	5.00		

See separate drawing for operation range |

See separate drawing for electrical data |

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

# 3 Electrical data

## 3 - 1 Electrical Data

3

Unit combination restrictions		Power supply				COMP		OFM		IFM		
Outdoor unit	Indoor unit	Hz	Voltage	Voltage range	MCA	MFA	RHz	RLA	kW	FLA	kW	FLA
RXM20N5V1B9	FTXM20R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	8,93	10	32,5	1,7	0,048	0,320	0,029	0,30
		50	230					1,6				
		50	240					1,6				
RXM25N5V1B9	FTXM25R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	9,71	13	46,0	2,3	0,040	0,280	0,025	0,30
		50	230					2,2				
		50	240					2,1				
RXM35N5V1B9	FTXM35R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	9,76	13	60,0	3,3	0,048	0,320	0,030	0,30
		50	230					3,2				
		50	240					3,0				
ARXM25N5V1B9	ATXM25R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	9,71	13	46,0	2,3	0,040	0,280	0,025	0,30
		50	230					2,2				
		50	240					2,1				
ARXM35N5V1B9	ATXM35R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	9,76	13	60,0	3,3	0,048	0,320	0,030	0,30
		50	230					3,2				
		50	240					3,0				
RXM20N5V1B9	FTXM20R5V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	8,93	10	32,5	1,7	0,048	0,320	0,029	0,30
		50	230					1,6				
		50	240					1,6				
RXM25N5V1B9	FTXM25R5V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	9,71	13	46,0	2,3	0,040	0,280	0,025	0,30
		50	230					2,2				
		50	240					2,1				
RXM35N5V1B9	FTXM35R5V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	9,76	13	60,0	3,3	0,048	0,320	0,030	0,30
		50	230					3,2				
		50	240					3,0				
ARXM25N5V1B9	ATXM25R5V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	9,71	13	46,0	2,3	0,040	0,280	0,025	0,30
		50	230					2,2				
		50	240					2,1				
ARXM35N5V1B9	ATXM35R5V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	9,76	13	60,0	3,3	0,048	0,320	0,030	0,30
		50	230					3,2				
		50	240					3,0				
RXM20R5V1B	FTXM20N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	8,84	10	35,0	2,0	0,048	0,320	0,022	0,22
		50	230					2,1				
		50	240					2,2				
RXM25R5V1B	FTXM25N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	9,63	13	46,0	2,6	0,040	0,280	0,022	0,22
		50	230					2,7				
		50	240					2,8				
RXM35R5V1B	FTXM35N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	9,70	13	60,0	4,2	0,048	0,320	0,027	0,25
		50	230					4,4				
		50	240					4,6				
ARXM25R5V1B	ATXM25N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	9,63	13	46,0	2,6	0,040	0,280	0,022	0,22
		50	230					2,7				
		50	240					2,8				
ARXM35R5V1B	ATXM35N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	9,70	13	60,0	4,2	0,048	0,320	0,027	0,25
		50	230					4,4				
		50	240					4,6				

Symbols  
MCA: Minimum Circuit Ampere [A]  
MFA: Maximum Fuse Ampere [A]  
RLA: Rated load amps [A]  
OFM: Outdoor fan motor  
IFM: Indoor fan motor  
FLA: Full load amps [A]  
kW: Fan motor rated output [kW]  
RHz: Rated operating frequency [Hz]

Notes  
1) The ·RLA· is based on the following conditions.  
Outdoor temperature ·35·°C DB  
Indoor temperature ·27·°C DB / ·19·°C WB  
2) Select the wire size according to the MCA.  
3) The maximum allowable voltage that is unbalanced between phases is ·2·%.  
4) Use a circuit breaker instead of a fuse.

4D130653

### 3 Electrical data

#### 3 - 1 Electrical Data

**RXM20-42R**

Unit combination restrictions		Power supply				COMP		OFM		IFM		
Indoor unit	Outdoor unit	Hz	Voltage	Voltage range	MCA	MFA	RHz	RLA	kW	FLA	kW	FLA
RXM20R5V1B	FTXM20R2V1B	50	220	Maximum ·50-Hz ·264-V	8,93	10	32,5	1,7	0,048	0,320	0,029	0,30
		50	230					1,6				
		50	240	Minimum ·50-Hz ·198-V				1,6				
RXM25R5V1B	FTXM25R2V1B	50	220	Maximum ·50-Hz ·264-V	9,71	13	46,0	2,3	0,040	0,280	0,025	0,30
		50	230					2,2				
		50	240	Minimum ·50-Hz ·198-V				2,1				
RXM25R5V1B	FFA25A2VEB9	50	220	Maximum ·50-Hz ·264-V	10,79	13	40,0	2,3	0,040	0,280	0,050	0,20
		50	230					2,5				
		50	240	Minimum ·50-Hz ·198-V				2,6				
RXM25R5V1B	FDXM25F3V1B9	50	220	Maximum ·50-Hz ·264-V	10,92	13	39,0	2,1	0,040	0,280	0,034	0,30
		50	230					2,2				
		50	240	Minimum ·50-Hz ·198-V				2,3				
RXM25R5V1B	FNA25A2VEB9	50	220	Maximum ·50-Hz ·264-V	11,17	13	43,0	2,3	0,040	0,280	0,034	0,50
		50	230					2,4				
		50	240	Minimum ·50-Hz ·198-V				2,5				
RXM35R5V1B	FTXM35R2V1B	50	220	Maximum ·50-Hz ·264-V	9,76	13	60,0	3,3	0,048	0,320	0,030	0,30
		50	230					3,2				
		50	240	Minimum ·50-Hz ·198-V				3,0				
RXM35R5V1B	FCAG35BVEB	50	220	Maximum ·50-Hz ·264-V	10,92	13	63,0	3,6	0,048	0,320	0,048	0,30
		50	230					3,8				
		50	240	Minimum ·50-Hz ·198-V				4,0				
RXM35R5V1B	FBA35A2VEB9	50	220	Maximum ·50-Hz ·264-V	12,29	13	56,0	3,3	0,048	0,320	0,089	1,40
		50	230					3,5				
		50	240	Minimum ·50-Hz ·198-V				3,6				
RXM35R5V1B	FHA35AVEB9	50	220	Maximum ·50-Hz ·264-V	11,29	13	64,0	3,8	0,048	0,320	0,090	0,60
		50	230					4,0				
		50	240	Minimum ·50-Hz ·198-V				4,2				
RXM35R5V1B	FFA35A2VEB9	50	220	Maximum ·50-Hz ·264-V	10,79	13	64,0	3,6	0,048	0,320	0,050	0,20
		50	230					3,8				
		50	240	Minimum ·50-Hz ·198-V				4,0				
RXM35R5V1B	FDXM35F3V1B9	50	220	Maximum ·50-Hz ·264-V	10,92	13	65,0	3,6	0,048	0,320	0,034	0,30
		50	230					3,8				
		50	240	Minimum ·50-Hz ·198-V				3,9				
RXM35R5V1B	FNA35A2VEB9	50	220	Maximum ·50-Hz ·264-V	11,17	13	65,0	3,6	0,048	0,320	0,034	0,50
		50	230					3,8				
		50	240	Minimum ·50-Hz ·198-V				3,9				
ARXM25R5V1B	ATXM25R2V1B	50	220	Maximum ·50-Hz ·264-V	9,71	13	46,0	2,3	0,040	0,280	0,025	0,30
		50	230					2,2				
		50	240	Minimum ·50-Hz ·198-V				2,1				
ARXM35R5V1B	ATXM35R2V1B	50	220	Maximum ·50-Hz ·264-V	9,76	13	60,0	3,3	0,048	0,320	0,030	0,30
		50	230					3,2				
		50	240	Minimum ·50-Hz ·198-V				3,0				
RXM42R2V1B	FTXM42R2V1B	50	220	Maximum ·50-Hz ·264-V	10,36	13	47,5	4,3	0,056	0,370	0,034	0,30
		50	230					4,1				
		50	240	Minimum ·50-Hz ·198-V				4,0				
RXM20R5V1B	FTXM20R5V1B	50	220	Maximum ·50-Hz ·264-V	8,93	10	32,5	1,7	0,048	0,320	0,029	0,30
		50	230					1,6				
		50	240	Minimum ·50-Hz ·198-V				1,6				
RXM25R5V1B	FTXM25R5V1B	50	220	Maximum ·50-Hz ·264-V	9,71	13	46,0	2,3	0,040	0,280	0,025	0,30
		50	230					2,2				
		50	240	Minimum ·50-Hz ·198-V				2,1				
RXM35R5V1B	FTXM35R5V1B	50	220	Maximum ·50-Hz ·264-V	9,76	13	60,0	3,3	0,048	0,320	0,030	0,30
		50	230					3,2				
		50	240	Minimum ·50-Hz ·198-V				3,0				
RXM42R2V1B	FTXM42R5V1B	50	220	Maximum ·50-Hz ·264-V	10,36	13	47,5	4,3	0,056	0,370	0,034	0,30
		50	230					4,1				
		50	240	Minimum ·50-Hz ·198-V				4,0				
ARXM25R5V1B	ATXM25R5V1B	50	220	Maximum ·50-Hz ·264-V	9,71	13	46,0	2,3	0,040	0,280	0,025	0,30
		50	230					2,2				
		50	240	Minimum ·50-Hz ·198-V				2,1				
ARXM35R5V1B	ATXM35R5V1B	50	220	Maximum ·50-Hz ·264-V	9,76	13	60,0	3,3	0,048	0,320	0,030	0,30
		50	230					3,2				
		50	240	Minimum ·50-Hz ·198-V				3,0				
RXM25R5V1B	FVXM25A2V1B	50	220	Maximum ·50-Hz ·264-V	9,54	13	41,0	2,6	0,040	0,280	0,037	0,14
		50	230					2,5				
		50	240	Minimum ·50-Hz ·198-V				2,4				
RXM35R5V1B	FVXM35A2V1B	50	220	Maximum ·50-Hz ·264-V	9,58	13	62,0	3,8	0,048	0,320	0,037	0,14
		50	230					3,7				
		50	240	Minimum ·50-Hz ·198-V				3,6				

The ·RLA· is based on the following conditions.

Outdoor temperature ·35·°C DB

Indoor temperature ·27·°C DB / ·19·°C WB

Select the wire size according to the MCA.

The maximum allowable voltage that is unbalanced between phases is ·2·%.

Use a circuit breaker instead of a fuse.

**Symbols**

MCA: Minimum Circuit Ampere [A]

MFA: Maximum Fuse Ampere [A]

RLA: Rated load amps [A]

OFM: Outdoor fan motor

IFM: Indoor fan motor

RHz: Rated operating frequency [Hz]

FLA: Full Load Ampere [A]

kW: Fan motor rated output [kW]

**4D130519B**

# 3 Electrical data

## 3 - 1 Electrical Data

3

**RXM42R**

Unit combination restrictions		Power supply					COMP		OFM		IFM	
Outdoor unit	Indoor unit	Hz	Voltage	Voltage range	MCA	MFA	RHz	RLA	kW	FLA	kW	FLA
RXM42R5V1B	FTXM42R2V1B	50	220	Maximum -50-Hz -264-V	10.36	13	47.5	4.3	0.056	0.370	0.034	0.30
		50	230					4.1				
		50	240	Minimum -50-Hz -198-V				4.0				
RXM42R5V1B	FTXM42R5V1B	50	220	Maximum -50-Hz -264-V	10.36	13	47.5	4.3	0.056	0.370	0.034	0.30
		50	230					4.1				
		50	240	Minimum -50-Hz -198-V				4.0				

**SYMBOLS**

MCA: Minimum Circuit Ampere [A]  
 MCA: Minimum Circuit Ampere [A]  
 MFA: Maximum Fuse Ampere [A]  
 RLA: Rated load amps [A]  
 OFM: Outdoor fan motor  
 IFM: Indoor fan motor  
 FLA: Full Load Ampere [A]  
 kW: Fan motor rated output [kW]  
 RHz: Rated operating frequency [Hz]

**NOTES:**

- The ·RLA· is based on the following conditions.  
 Outdoor temperature ·35·° C DB  
 Indoor temperature ·27·° C DB / ·19·° C WB
- Select the wire size according to the MCA.
- The maximum allowable voltage that is unbalanced between phases is ·2·%.
- Use a circuit breaker instead of a fuse.

**3D133950**

### 3 Electrical data

#### 3 - 1 Electrical Data

##### RXM42-71R

Unit combination restrictions		Power supply				COMP		OFM		IFM		
Outdoor unit	Indoor unit	Hz	Voltage	Voltage range	MCA	MFA	RHz	RLA	kW	FLA	kW	FLA
ARXM50R2V1B	ADEA50A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,42	16	55	5,2	0,056	0,37	0,089	1,40
		50	230					5,0				
		50	240					4,8				
ARXM60R2V1B	ADEA60A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,86	16	66	6,2	0,056	0,37	0,070	1,30
		50	230					6,0				
		50	240					5,7				
ARXM71R2V1B	ADEA71A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,83	16	81	8,2	0,056	0,37	0,070	1,30
		50	230					7,8				
		50	240					7,5				
ARXM71R2V1B	FCAG71BVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14,93	16	81	8,1	0,056	0,37	0,054	0,40
		50	230					7,7				
		50	240					7,4				
ARXM71R2V1B	FBA71A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,83	16	81	8,2	0,056	0,37	0,070	1,30
		50	230					7,8				
		50	240					7,5				
ARXM71R2V1B	FAA71AUVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14,93	16	83	8,3	0,056	0,37	0,048	0,40
		50	230					7,9				
		50	240					7,6				
RXM42R2V1B	FTXM42R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	10,36	13	48	4,3	0,056	0,37	0,034	0,30
		50	230					4,1				
		50	240					4,0				
RXM42R2V1B	FTXM42R5V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	10,36	13	48	4,3	0,056	0,37	0,034	0,30
		50	230					4,1				
		50	240					4,0				
RXM50R2V1B	FTXM50R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14,54	16	54	4,7	0,056	0,37	0,046	0,60
		50	230					4,5				
		50	240					4,3				
ARXM50R2V1B	ATXM50R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14,54	16	54	4,7	0,056	0,37	0,046	0,60
		50	230					4,5				
		50	240					4,3				
RXM50R2V1B	FCAG50BVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14,21	16	58	5,2	0,056	0,37	0,048	0,30
		50	230					5,0				
		50	240					4,8				
RXM50R2V1B	FBA50A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,42	16	55	5,2	0,056	0,37	0,089	1,40
		50	230					5,0				
		50	240					4,8				
RXM50R2V1B	FHA50AVEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14,54	16	64	5,5	0,056	0,37	0,090	0,60
		50	230					5,3				
		50	240					5,2				
RXM50R2V1B	FFA50A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14,32	16	62	5,6	0,056	0,37	0,050	0,40
		50	230					5,4				
		50	240					5,3				
RXM50R2V1B	FDXM50F3V1B9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14,87	16	55	4,9	0,056	0,37	0,060	0,90
		50	230					4,7				
		50	240					4,5				
RXM50R2V1B	FNA50A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14,43	16	55	4,9	0,056	0,37	0,060	0,50
		50	230					4,7				
		50	240					4,5				
RXM50R2V1B	FVXM50FV1B9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14,32	16	60	5,4	0,056	0,37	0,048	0,10
		50	230					5,2				
		50	240					5,0				
RXM60R2V1B	FTXM60R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,09	16	70	6,6	0,056	0,37	0,046	0,60
		50	230					6,3				
		50	240					6,0				
RXM60R2V1B	FCAG60BVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14,76	16	71	6,5	0,056	0,37	0,048	0,30
		50	230					6,3				
		50	240					6,2				
RXM60R2V1B	FBA60A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,86	16	66	6,1	0,056	0,37	0,070	1,30
		50	230					6,0				
		50	240					5,8				
RXM60R2V1B	FHA60AVEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,09	16	62	5,5	0,056	0,37	0,091	0,60
		50	230					5,3				
		50	240					5,1				
RXM60R2V1B	FFA60A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,09	16	70	6,5	0,056	0,37	0,050	0,60
		50	230					6,3				
		50	240					6,2				
RXM60R2V1B	FDXM60F3V1B9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,42	16	73	6,7	0,056	0,37	0,060	0,90
		50	230					6,5				
		50	240					6,4				
RXM60R2V1B	FNA60A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,09	16	73	6,7	0,056	0,37	0,060	0,60
		50	230					6,5				
		50	240					6,4				
RXM71R2V1B	FTXM71R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	19,78	20	54	9,4	0,128	0,38	0,052	0,60
		50	230					8,9				
		50	240					8,6				

Notes

- 1) The ·RLA· is based on the following conditions.  
Outdoor temperature ·35·°C DB  
Indoor temperature ·27·°C DB / ·19·°C WB
- 2) Select the wire size according to the MCA.
- 3) The maximum allowable voltage that is unbalanced between phases is ·2·%.
- 4) Use a circuit breaker instead of a fuse.

Symbols

- MCA: Minimum Circuit Ampere [A]
- MFA: Maximum Fuse Ampere [A]
- RLA: Rated load amps [A]
- OFM: Outdoor fan motor
- IFM: Indoor fan motor
- FLA: Full load amps [A]
- kW: Fan motor rated output [kW]
- RHz: Rated operating frequency [Hz]

4D131055

### 3 Electrical data

#### 3 - 1 Electrical Data

3

#### ARXM50-71R RXM42-71R

Unit combination restrictions		Power supply					COMP		OFM		IFM	
Outdoor unit	Indoor unit	Hz	Voltage	Voltage range	MCA	MFA	RHz	RLA	kW	FLA	kW	FLA
ARXM50R5V1B	ADEA50A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15.42	16	55	5.2	0.056	0.37	0.089	1.40
		50	230					5.0				
		50	240					4.8				
ARXM60R5V1B	ADEA60A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15.86	16	66	6.2	0.056	0.37	0.070	1.30
		50	230					6.0				
		50	240					5.7				
ARXM71R5V1B	ADEA71A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15.83	16	81	8.2	0.056	0.37	0.070	1.30
		50	230					7.8				
		50	240					7.5				
ARXM71R5V1B	FCAG71BVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14.93	16	81	8.1	0.056	0.37	0.054	0.40
		50	230					7.7				
		50	240					7.4				
ARXM71R5V1B	FBA71A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15.83	16	81	8.2	0.056	0.37	0.070	1.30
		50	230					7.8				
		50	240					7.5				
ARXM71R5V1B	FAA71AUVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14.93	16	83	8.3	0.056	0.37	0.048	0.40
		50	230					7.9				
		50	240					7.6				
RXM42R5V1B	FTXM42R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	10.36	13	48	4.3	0.056	0.37	0.034	0.30
		50	230					4.1				
		50	240					4.0				
RXM42R5V1B	FTXM42R5V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	10.36	13	48	4.3	0.056	0.37	0.034	0.30
		50	230					4.1				
		50	240					4.0				
RXM50R5V1B	FTXM50R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14.54	16	54	4.7	0.056	0.37	0.046	0.60
		50	230					4.5				
		50	240					4.3				
ARXM50R5V1B	ATXM50R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14.54	16	54	4.7	0.056	0.37	0.046	0.60
		50	230					4.5				
		50	240					4.3				
RXM50R5V1B	FCAG50BVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14.21	16	58	5.2	0.056	0.37	0.048	0.30
		50	230					5.0				
		50	240					4.8				
RXM50R5V1B	FBA50A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15.42	16	55	5.2	0.056	0.37	0.089	1.40
		50	230					5.0				
		50	240					4.8				
RXM50R5V1B	FHA50AVEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14.54	16	64	5.5	0.056	0.37	0.090	0.60
		50	230					5.3				
		50	240					5.2				
RXM50R5V1B	FFA50A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14.32	16	62	5.6	0.056	0.37	0.050	0.40
		50	230					5.4				
		50	240					5.3				
RXM50R5V1B	FDXM50F3V1B9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14.87	16	55	4.9	0.056	0.37	0.060	0.90
		50	230					4.7				
		50	240					4.5				
RXM50R5V1B	FNA50A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14.43	16	55	4.9	0.056	0.37	0.060	0.50
		50	230					4.7				
		50	240					4.5				
RXM50R5V1B	FVXM50FV1B9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14.32	16	60	5.4	0.056	0.37	0.048	0.10
		50	230					5.2				
		50	240					5.0				
RXM60R5V1B	FTXM60R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15.09	16	70	6.6	0.056	0.37	0.046	0.60
		50	230					6.3				
		50	240					6.0				
RXM60R5V1B	FCAG60BVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14.76	16	71	6.5	0.056	0.37	0.048	0.30
		50	230					6.3				
		50	240					6.2				
RXM60R5V1B	FBA60A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15.86	16	66	6.1	0.056	0.37	0.070	1.30
		50	230					6.0				
		50	240					5.8				
RXM60R5V1B	FHA60AVEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15.09	16	62	5.5	0.056	0.37	0.091	0.60
		50	230					5.3				
		50	240					5.1				
RXM60R5V1B	FFA60A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15.09	16	70	6.5	0.056	0.37	0.050	0.60
		50	230					6.3				
		50	240					6.2				
RXM60R5V1B	FDXM60F3V1B9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15.42	16	73	6.7	0.056	0.37	0.060	0.90
		50	230					6.5				
		50	240					6.4				
RXM60R5V1B	FNA60A2VEB9	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15.09	16	73	6.7	0.056	0.37	0.060	0.60
		50	230					6.5				
		50	240					6.4				
RXM71R5V1B	FTXM71R2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	19.78	20	54	9.4	0.128	0.38	0.052	0.60
		50	230					8.9				
		50	240					8.6				

NOTES:

1. The ·RLA· is based on the following conditions.  
Outdoor temperature ·35·° C DB  
Indoor temperature ·27·° C DB / ·19·° C WB
2. Select the wire size according to the MCA.
3. The maximum allowable voltage that is unbalanced between phases is ·2· %.
4. Use a circuit breaker instead of a fuse.

SYMBOLS

MCA: Minimum Circuit Ampere [A]  
MCA: Minimum Circuit Ampere [A]  
MFA: Maximum Fuse Ampere [A]  
RLA: Rated load amps [A]  
OFM: Outdoor fan motor  
IFM: Indoor fan motor  
FLA: Full Load Ampere [A]  
kW: Fan motor rated output [kW]  
RHz: Rated operating frequency [Hz]

3D133951



### 3 Electrical data

#### 3 - 1 Electrical Data

#### RXM50R

Unit combination restrictions		Power supply					COMP		OFM		IFM	
Indoor unit	Outdoor unit	Hz	Voltage	Voltage range	MCA	MFA	RHz	RLA	kW	FLA	kW	FLA
RXM42N2V1B9	FTXM42N2V1B	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	11.62	13	49	4.4	0.056	0.37	0.028	0.22
		50	230					4.2				
		50	240					3.9				
RXM50N2V1B9	FTXM50N2V1B	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	12.00	13	52	3.8	0.056	0.37	0.046	0.6
		50	230					3.5				
		50	240					3.2				
ARXM50N2V1B9	ATXM50N2V1B	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	12.00	13	52	3.8	0.056	0.37	0.046	0.6
		50	230					3.5				
		50	240					3.2				
RXM50N2V1B9	FCAG50AVEB	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	11.70	13	58	5.2	0.056	0.37	0.048	0.3
		50	230					5.0				
		50	240					4.8				
RXM50N2V1B9	FBA50AVEB	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	12.80	13	55	5.2	0.056	0.37	0.089	1.4
		50	230					5.0				
		50	240					4.8				
RXM50N2V1B9	FHA50AVEB	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	12.00	13	64	5.5	0.056	0.37	0.090	0.6
		50	230					5.3				
		50	240					5.2				
RXM50N2V1B9	FFA50A2VEB	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	11.80	13	62	5.6	0.056	0.37	0.050	0.4
		50	230					5.4				
		50	240					5.3				
RXM50N2V1B9	FDXM50F3V1B	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	12.30	13	55	4.9	0.056	0.37	0.060	0.9
		50	230					4.7				
		50	240					4.5				
RXM50N2V1B9	FNA50A2VEB	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	11.90	13	55	4.9	0.056	0.37	0.060	0.5
		50	230					4.7				
		50	240					4.5				
RXM50N2V1B9	FVXM50FV1B	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	11.50	13	60	5.4	0.056	0.37	0.048	0.1
		50	230					5.2				
		50	240					5.0				
RXM60N2V1B9	FTXM60N2V1B	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	15.13	16	66	5.9	0.056	0.37	0.046	0.6
		50	230					5.7				
		50	240					5.5				
RXM60N2V1B9	FCAG60AVEB	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	14.83	16	71	6.5	0.056	0.37	0.048	0.3
		50	230					6.3				
		50	240					6.2				
RXM60N2V1B9	FBA60AVEB	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	15.83	16	66	6.1	0.056	0.37	0.070	1.3
		50	230					6.0				
		50	240					5.8				
RXM60N2V1B9	FHA60AVEB	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	15.13	16	62	5.6	0.056	0.37	0.091	0.6
		50	230					5.3				
		50	240					5.1				
RXM60N2V1B9	FFA60A2VEB	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	15.13	16	70	6.5	0.056	0.37	0.050	0.6
		50	230					6.3				
		50	240					6.2				
RXM60N2V1B9	FDXM60F3V1B	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	15.43	16	73	6.7	0.056	0.37	0.060	0.9
		50	230					6.5				
		50	240					6.4				
RXM60N2V1B9	FNA60A2VEB	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	15.13	16	73	6.7	0.056	0.37	0.060	0.6
		50	230					6.5				
		50	240					6.4				
RXM50R2V1B	FVXM50A2V1B	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	14.04	16	58	5.3	0.056	0.37	0.037	0.14
		50	230					5.1				
		50	240					4.9				
RXM50N2V1B9	FTXM50R2V1B	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	10.69	13	54	4.7	0.056	0.37	0.046	0.6
		50	230					4.5				
		50	240					4.3				
ARXM50N2V1B9	ATXM50R2V1B	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	10.69	13	54	4.7	0.056	0.37	0.046	0.6
		50	230					4.5				
		50	240					4.3				
RXM60N2V1B9	FTXM60R2V1B	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	13.44	16	70	6.6	0.056	0.37	0.046	0.6
		50	230					6.3				
		50	240					6.0				
RXM71N2V1B	FTXM71R2V1B	50	220	Maximum :50-Hz :264-V Minimum :50-Hz :198-V	18.30	20	54	7.9	0.128	0.38	0.052	0.34
		50	230					7.2				
		50	240					6.9				

#### SYMBOLS

- MCA: Minimum Circuit Ampere [A]
- MFA: Maximum Fuse Ampere [A]
- RLA: Rated load amps [A]
- OFM: Outdoor fan motor
- IFM: Indoor fan motor
- RHz: Rated operating frequency [Hz]
- FLA: Full Load Ampere [A]
- kW : Fan motor rated output [kW]

#### Notes

- 1) The ·RLA· is based on the following conditions.  
Outdoor temperature ·35·° C DB  
Indoor temperature ·27·° C DB / ·1· ° C WB
- 2) Select the wire size according to the MCA.
- 3) The maximum allowable voltage that is unbalanced between phases is ·2· %.
- 4) Use a circuit breaker instead of a fuse.

3D120639C

# 3 Electrical data

## 3 - 1 Electrical Data

**3**
**RXM50R**

Unit combination restrictions		Power supply				COMP		OFM		IFM		
Outdoor unit	Indoor unit	Hz	Voltage	Voltage range	MCA	MFA	RHz	RLA	kW	FLA	kW	FLA
RXM50R5V1B	FVXM50A2V1B	50	220	Maximum ·50·Hz ·264·V	14.04	16	58	5.3	0.056	0.37	0.037	0.14
		50	230					5.1				
		50	240	Minimum ·50·Hz ·198·V				4.9				

**SYMBOLS**

MCA: Minimum Circuit Ampere [A]  
 MCA: Minimum Circuit Ampere [A]  
 MFA: Maximum Fuse Ampere [A]  
 RLA: Rated load amps [A]  
 OFM: Outdoor fan motor  
 IFM: Indoor fan motor  
 FLA: Full Load Ampere [A]  
 kW: Fan motor rated output [kW]  
 RHz: Rated operating frequency [Hz]

**NOTES:**

- The ·RLA· is based on the following conditions.  
 Outdoor temperature ·35·° C DB  
 Indoor temperature ·27·° C DB / ·19·° C WB
- Select the wire size according to the MCA.
- The maximum allowable voltage that is unbalanced between phases is ·2·%.
- Use a circuit breaker instead of a fuse.

**3D133949**

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

**FTXM20R / RXM20R**

**Cooling**

50Hz 220-240V

AFR	10,48
BF	0,08

INDOOR		Outdoor temperature [° C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	2,05	2,05	0,34	1,96	1,96	0,37	1,86	1,86	0,40	1,83	1,83	0,41	1,77	1,77	0,43	1,68	1,68	0,47
16	22	2,14	1,95	0,34	2,05	1,98	0,37	1,95	1,95	0,40	1,92	1,92	0,42	1,86	1,86	0,43	1,77	1,77	0,47
18	25	2,23	2,23	0,34	2,14	2,14	0,37	2,05	2,05	0,40	2,01	2,01	0,42	1,95	1,95	0,44	1,86	1,86	0,47
19	27	2,28	2,28	0,34	2,19	2,19	0,37	2,09	2,09	0,41	2,06	2,06	0,42	2,00	2,00	0,44	1,91	1,91	0,47
22	30	2,42	2,32	0,34	2,32	2,32	0,38	2,23	2,23	0,41	2,19	2,19	0,42	2,14	2,14	0,44	2,05	2,05	0,47
24	32	2,51	2,07	0,35	2,42	2,14	0,38	2,32	2,25	0,41	2,29	2,29	0,42	2,23	2,23	0,44	2,14	2,14	0,47

**Heating**

50Hz 220-240V

AFR	9,33
-----	------

INDOOR		Outdoor temperature [° C WB]											
EDB		-15		-10		-5		0		7		10	
°C		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15		1,19	0,32	1,43	0,34	1,67	0,36	1,94	0,46	2,59	0,49	2,81	0,51
20		1,12	0,33	1,36	0,35	1,60	0,37	1,86	0,47	2,50	0,50	2,73	0,52
22		1,09	0,34	1,33	0,36	1,57	0,37	1,83	0,48	2,47	0,50	2,69	0,52
24		1,06	0,34	1,30	0,36	1,54	0,38	1,80	0,48	2,43	0,51	2,66	0,53
25		1,04	0,34	1,28	0,36	1,52	0,38	1,78	0,49	2,41	0,51	2,64	0,53
27		1,01	0,35	1,25	0,37	1,49	0,38	1,76	0,49	2,38	0,52	2,61	0,54

**Symbols**

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature [° C WB]
- EDB: Entering dry-bulb temperature [° C DB]
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

**Notes**

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- Nominal capacity and nominal input
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0· m
- The air flow rate and bypass factor are mentioned in the table.

4D130634

**FTXM20N / RXM20R**

**Cooling ·220-240V 50Hz·**

AFR	11,1
BF	0,16

①	②	③																	
		20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	2,05	1,76	0,34	1,96	1,72	0,37	1,86	1,68	0,40	1,83	1,66	0,42	1,77	1,64	0,44	1,68	1,59	0,47
16	22	2,14	1,76	0,34	2,05	1,69	0,37	1,95	1,65	0,41	1,92	1,64	0,42	1,86	1,62	0,44	1,77	1,58	0,47
18	25	2,23	1,85	0,34	2,14	1,81	0,38	2,05	1,78	0,41	2,01	1,76	0,42	1,95	1,74	0,44	1,86	1,70	0,47
19	27	2,28	1,98	0,34	2,19	1,95	0,38	2,09	1,91	0,41	2,06	1,90	0,42	2,00	1,88	0,44	1,91	1,84	0,47
22	30	2,42	1,92	0,35	2,32	1,89	0,38	2,23	1,86	0,41	2,19	1,85	0,42	2,14	1,83	0,44	2,05	1,80	0,47
24	32	2,51	1,88	0,35	2,42	1,86	0,38	2,32	1,83	0,41	2,29	1,82	0,43	2,23	1,80	0,44	2,14	1,77	0,48

**Symbols**

- TC: Total capacity [kW]
- PI: Power input [kW]
- SHC: Sensible heat capacity [kW]
- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor

**Heating ·220-240V 50Hz·**

AFR	10,4
-----	------

②	④											
	-15		-10		-5		0		6		10	
	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	1,19	0,32	1,43	0,34	1,67	0,36	2,25	0,46	2,59	0,49	2,81	0,51
20	1,12	0,33	1,36	0,35	1,60	0,37	2,16	0,47	2,50	0,50	2,73	0,52
22	1,09	0,34	1,33	0,36	1,57	0,37	2,13	0,48	2,47	0,50	2,69	0,52
24	1,06	0,34	1,30	0,36	1,54	0,38	2,09	0,48	2,43	0,51	2,66	0,53
25	1,04	0,34	1,28	0,36	1,52	0,38	2,07	0,49	2,41	0,51	2,64	0,53
27	1,01	0,35	1,25	0,37	1,49	0,38	2,04	0,49	2,38	0,52	2,61	0,54

- ① Indoor air temperature [°C WB]
- ② Indoor air temperature [°C DB]
- ③ Outdoor air temperature [°C DB]
- ④ Outdoor air temperature [°C WB]

**Notes**

- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5,0· m  
Level difference: ·0· m
- The bold cells indicate the standard conditions.  
Rated operating frequency [Hz]

3D099850F

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

4

**FDXM25F9 / RXM25R**

**Cooling**    50Hz    220-240V

AFR	8,7
BF	0,17

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	2,46	1,94	0,49	2,35	1,88	0,54	2,24	1,83	0,59	2,19	1,81	0,61	2,12	1,78	0,63	2,01	1,73	0,68
16,0	22	2,57	1,91	0,50	2,46	1,86	0,54	2,35	1,81	0,59	2,30	1,79	0,61	2,23	1,76	0,64	2,12	1,71	0,68
18,0	25	2,68	2,01	0,50	2,57	1,97	0,55	2,46	1,92	0,59	2,41	1,90	0,61	2,34	1,87	0,64	2,23	1,83	0,69
19,0	27	2,74	2,14	0,50	2,62	2,09	0,55	2,51	2,05	0,59	2,47	2,03	0,61	2,40	2,00	0,64	2,29	1,96	0,69
22,0	30	2,90	2,07	0,50	2,79	2,03	0,55	2,68	1,99	0,60	2,63	1,97	0,62	2,57	1,95	0,65	2,45	1,91	0,69
24,0	32	3,01	2,02	0,51	2,90	1,98	0,55	2,79	1,95	0,60	2,74	1,93	0,62	2,68	1,91	0,65	2,56	1,88	0,70

**Heating**    50Hz    220-240V

AFR	8,7
-----	-----

Indoor temperature		Outdoor temperature [°C WB]											
°C	EDB	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	1,49	0,64	1,79	0,68	2,09	0,71	2,39	0,74	3,31	0,78	3,60	0,81	
20,0	1,40	0,66	1,70	0,69	2,00	0,73	2,30	0,76	3,20	0,80	3,49	0,83	
22,0	1,36	0,67	1,66	0,70	1,96	0,73	2,26	0,77	3,16	0,81	3,44	0,83	
24,0	1,32	0,68	1,62	0,71	1,92	0,74	2,22	0,77	3,11	0,81	3,40	0,84	
25,0	1,30	0,68	1,60	0,71	1,90	0,75	2,20	0,78	3,09	0,82	3,38	0,84	
27,0	1,27	0,69	1,57	0,72	1,87	0,75	2,17	0,79	3,05	0,83	3,33	0,85	

**Symbols**

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EVB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

**Notes**

1. The ratings shown are net capacities which include a deduction for indoor fan motor heat.
2. On the figure the □ · mark shows the rated capacity and rated coefficient of the power input.
3. The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
4. In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
5. The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5 m  
Level difference: ·0 m
6. The air flow rate and bypass factor are mentioned in the table.

**3D110078B**

**FFA25A9 / RXM25R**

**Cooling**    50Hz    220-240V

AFR	9,0
BF	0,24

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	2,56	1,95	0,42	2,44	1,89	0,46	2,33	1,84	0,50	2,28	1,81	0,52	2,21	1,78	0,54	2,10	1,72	0,58
16,0	22	2,68	1,92	0,42	2,56	1,86	0,46	2,44	1,81	0,50	2,40	1,79	0,52	2,33	1,76	0,54	2,21	1,71	0,58
18,0	25	2,79	2,01	0,42	2,68	1,96	0,46	2,56	1,92	0,51	2,51	1,90	0,52	2,44	1,87	0,55	2,33	1,82	0,59
19,0	27	2,85	2,13	0,43	2,73	2,08	0,47	2,62	2,04	0,51	2,57	2,02	0,52	2,50	1,99	0,55	2,38	1,94	0,59
22,0	30	3,02	2,06	0,43	2,91	2,02	0,47	2,79	1,97	0,51	2,74	1,96	0,53	2,67	1,93	0,55	2,56	1,89	0,59
24,0	32	3,14	2,01	0,43	3,02	1,97	0,47	2,90	1,93	0,51	2,86	1,91	0,53	2,79	1,89	0,55	2,67	1,85	0,59

**Heating**    50Hz    220-240V

AFR	9,0
-----	-----

Indoor temperature		Outdoor temperature [°C WB]											
°C	EDB	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	1,49	0,66	1,79	0,69	2,09	0,73	2,39	0,76	3,31	0,80	3,60	0,83	
20,0	1,40	0,68	1,70	0,71	2,00	0,75	2,30	0,78	3,20	0,82	3,49	0,85	
22,0	1,36	0,69	1,66	0,72	1,96	0,75	2,26	0,79	3,16	0,83	3,44	0,85	
24,0	1,32	0,69	1,62	0,73	1,92	0,76	2,22	0,79	3,11	0,84	3,40	0,86	
25,0	1,30	0,70	1,60	0,73	1,90	0,76	2,20	0,80	3,09	0,84	3,38	0,87	
27,0	1,27	0,70	1,57	0,74	1,87	0,77	2,17	0,81	3,05	0,85	3,33	0,87	

**Symbols**

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EVB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

**Notes**

1. The ratings shown are net capacities which include a deduction for indoor fan motor heat.
2. On the figure the □ · mark shows the rated capacity and rated coefficient of the power input.
3. The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
4. In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
5. The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5 m  
Level difference: ·0 m
6. The air flow rate and bypass factor are mentioned in the table.

**3D110082B**

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

**FNA25A9 / RXM25R**

**Cooling**

50Hz 220 - 240V

AFR	8,7
BF	0,17

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	2,66	2,04	0,52	2,54	1,98	0,58	2,42	1,92	0,63	2,37	1,90	0,65	2,30	1,86	0,68	2,18	1,81	0,73
16,0	22	2,78	2,00	0,53	2,66	1,95	0,58	2,54	1,89	0,63	2,49	1,87	0,65	2,42	1,84	0,68	2,30	1,78	0,73
18,0	25	2,90	2,11	0,53	2,78	2,06	0,58	2,66	2,00	0,63	2,61	1,98	0,65	2,54	1,95	0,68	2,42	1,90	0,73
19,0	27	2,96	2,23	0,53	2,84	2,18	0,58	2,72	2,13	0,63	2,67	2,11	0,65	2,60	2,08	0,68	2,48	2,04	0,73
22,0	30	3,14	2,16	0,54	3,02	2,11	0,59	2,90	2,07	0,64	2,85	2,05	0,66	2,78	2,02	0,69	2,66	1,98	0,74
24,0	32	3,26	2,10	0,54	3,14	2,06	0,59	3,02	2,02	0,64	2,97	2,01	0,66	2,90	1,98	0,69	2,78	1,94	0,74

**Heating**

50Hz 220 - 240V

AFR	8,7
-----	-----

Indoor temperature		Outdoor temperature [°C WB]											
EDB		-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0		1,49	0,64	1,79	0,68	2,09	0,71	2,39	0,74	3,31	0,78	3,60	0,81
20,0		1,40	0,66	1,70	0,69	2,00	0,73	2,30	0,76	3,20	0,80	3,49	0,83
22,0		1,36	0,67	1,66	0,70	1,96	0,73	2,26	0,77	3,16	0,81	3,44	0,83
24,0		1,32	0,68	1,62	0,71	1,92	0,74	2,22	0,77	3,11	0,81	3,40	0,84
25,0		1,30	0,68	1,60	0,71	1,90	0,75	2,20	0,78	3,09	0,82	3,38	0,84
27,0		1,27	0,69	1,57	0,72	1,87	0,75	2,17	0,79	3,05	0,83	3,33	0,85

**Symbols**

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

**Notes**

1. The ratings shown are net capacities which include a deduction for indoor fan motor heat.
2. On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
3. The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
4. In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
5. The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0·m
6. The air flow rate and bypass factor are mentioned in the table.

**3D110089B**

**FVXM25F / RXM25R**

**Cooling**

50Hz 220 - 240V

AFR	8,2
BF	0,1

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	2,56	2,00	0,46	2,44	1,95	0,50	2,33	1,89	0,55	2,28	1,87	0,56	2,21	1,84	0,59	2,10	1,78	0,64
16,0	22	2,68	1,97	0,46	2,56	1,92	0,51	2,44	1,87	0,55	2,40	1,84	0,57	2,33	1,81	0,59	2,21	1,76	0,64
18,0	25	2,79	2,08	0,46	2,68	2,03	0,51	2,56	1,98	0,55	2,51	1,96	0,57	2,44	1,93	0,60	2,33	1,89	0,64
19,0	27	2,85	2,21	0,47	2,73	2,16	0,51	2,62	2,11	0,55	2,57	2,09	0,57	2,50	2,07	0,60	2,38	2,02	0,64
22,0	30	3,02	2,13	0,47	2,91	2,09	0,51	2,79	2,05	0,56	2,74	2,03	0,58	2,67	2,01	0,60	2,56	1,97	0,65
24,0	32	3,14	2,08	0,47	3,02	2,04	0,52	2,90	2,01	0,56	2,86	1,99	0,58	2,79	1,97	0,60	2,67	1,93	0,65

**Heating**

50Hz 220 - 240V

AFR	8,8
-----	-----

Indoor temperature		Outdoor temperature [°C WB]											
EDB		-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0		1,58	0,62	1,90	0,65	2,22	0,68	2,54	0,71	3,52	0,75	3,82	0,78
20,0		1,48	0,64	1,80	0,67	2,12	0,70	2,44	0,73	3,40	0,77	3,71	0,79
22,0		1,44	0,64	1,76	0,67	2,08	0,71	2,40	0,74	3,35	0,78	3,66	0,80
24,0		1,41	0,65	1,72	0,68	2,04	0,71	2,36	0,75	3,31	0,78	3,61	0,81
25,0		1,39	0,65	1,70	0,69	2,02	0,72	2,34	0,75	3,28	0,79	3,59	0,81
27,0		1,35	0,66	1,67	0,69	1,98	0,72	2,30	0,76	3,24	0,79	3,54	0,82

**Symbols**

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

**Notes**

1. The ratings shown are net capacities which include a deduction for indoor fan motor heat.
2. On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
3. The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
4. In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
5. The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0·m
6. The air flow rate and bypass factor are mentioned in the table.

**3D110093B**

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

4

**FTXM25N / RXM25R**

**Cooling ·220-240V 50Hz·**

AFR	11,1
BF	0,21

①	②	③																	
		20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	2,56	1,95	0,40	2,44	1,90	0,45	2,32	1,85	0,51	2,28	1,83	0,53	2,21	1,79	0,55	2,09	1,74	0,60
16	22	2,68	1,92	0,43	2,56	1,87	0,47	2,44	1,82	0,51	2,40	1,80	0,53	2,33	1,76	0,56	2,21	1,71	0,60
18	25	2,79	2,02	0,43	2,68	1,97	0,47	2,56	1,92	0,52	2,51	1,90	0,53	2,44	1,88	0,56	2,33	1,83	0,60
19	27	2,85	2,14	0,43	2,73	2,09	0,48	2,62	2,05	0,52	2,57	2,03	0,53	2,50	2,00	0,56	2,38	1,95	0,60
22	30	3,02	2,07	0,44	2,91	2,03	0,48	2,79	1,98	0,52	2,74	1,97	0,54	2,67	1,94	0,56	2,56	1,90	0,61
24	32	3,14	2,02	0,44	3,02	1,98	0,48	2,90	1,94	0,52	2,86	1,92	0,54	2,79	1,90	0,57	2,67	1,87	0,61

**Symbols**

- TC: Total capacity [kW]
- PI: Power input [kW]
- SHC: Sensible heat capacity [kW]
- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor

**Heating ·220-240V 50Hz·**

AFR	10,8
-----	------

②	④											
	-15		-10		-5		0		6		10	
	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	1,33	0,36	1,60	0,38	1,87	0,40	2,52	0,52	2,90	0,55	3,15	0,57
20	1,25	0,37	1,52	0,39	1,79	0,41	2,42	0,53	2,80	0,56	3,05	0,58
22	1,22	0,37	1,49	0,40	1,76	0,42	2,38	0,53	2,76	0,57	3,01	0,59
24	1,19	0,38	1,45	0,40	1,72	0,42	2,34	0,54	2,72	0,57	2,98	0,59
25	1,17	0,38	1,44	0,40	1,71	0,42	2,32	0,54	2,70	0,57	2,96	0,59
27	1,14	0,39	1,41	0,41	1,67	0,42	2,29	0,55	2,66	0,58	2,92	0,60

- ① Indoor air temperature [°C WB]
- ② Indoor air temperature [°C DB]
- ③ Outdoor air temperature [°C DB]
- ④ Outdoor air temperature [°C WB]

**Notes**

- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5,0· m  
Level difference: ·0·m
- The bold cells indicate the standard conditions.  
Rated operating frequency [Hz]

3D120715A

**FVXM25A / RXM25R**

**Cooling ·220-240V 50Hz·**

AFR	8,7
BF	0,09

Indoor air temperature [°C WB]	Indoor air temperature [°C DB]	Outdoor air temperature [°C DB]																	
		20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	2,46	1,87	0,40	2,35	1,84	0,44	2,24	1,81	0,47	2,19	1,80	0,49	2,12	1,79	0,51	2,01	1,78	0,55
16	22	2,57	1,78	0,40	2,46	1,74	0,44	2,35	1,71	0,48	2,30	1,70	0,49	2,23	1,68	0,51	2,12	1,66	0,55
18	25	2,68	1,88	0,40	2,57	1,85	0,44	2,46	1,83	0,48	2,41	1,82	0,49	2,34	1,82	0,52	2,23	1,82	0,56
19	27	2,74	2,04	0,40	2,62	2,03	0,44	2,51	2,03	0,48	2,47	2,04	0,50	2,40	2,05	0,52	2,29	2,08	0,56
22	30	2,90	1,84	0,41	2,79	1,82	0,44	2,68	1,81	0,48	2,63	1,80	0,50	2,57	1,80	0,52	2,45	1,81	0,56
24	32	3,01	1,72	0,41	2,90	1,70	0,45	2,79	1,68	0,49	2,74	1,67	0,50	2,68	1,67	0,52	2,56	1,66	0,56

**Heating ·220-240V 50Hz·**

AFR	9,2
-----	-----

Indoor air temperature [°C DB]	Outdoor air temperature [°C DB]													
	-20		-15		-10		-5		0		7		10	
	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	1,61	0,54	1,98	0,57	2,35	0,60	2,26	0,63	2,56	0,66	3,61	0,69	3,83	0,71
20	1,40	0,59	1,77	0,62	2,14	0,65	2,51	0,68	2,39	0,71	3,40	0,75	3,62	0,76
22	1,31	0,61	1,68	0,64	2,05	0,67	2,43	0,70	1,81	0,73	3,32	0,76	3,54	0,78
24	1,23	0,63	1,60	0,66	1,97	0,69	2,34	0,72	1,73	0,75	3,23	0,77	3,45	0,81
25	1,19	0,65	1,56	0,67	1,93	0,70	2,30	0,73	1,70	0,76	3,19	0,77	3,41	0,82
27	1,08	0,66	1,47	0,69	1,84	0,72	2,22	0,75	1,62	0,78	3,11	0,78	3,33	0,84

Heating capacity at nominal operating frequency, measured according to ·EN 14511·.

**Notes**

- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5,0· m  
Level difference: ·0·m
- The bold cells indicate the standard conditions.

**Symbols**

- TC: Total capacity [kW]
- PI: Power input [kW]
- SHC: Sensible heat capacity [kW]
- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor

3D130939

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

**FTXM25R / RXM25R**

**Cooling**

50Hz 220-240V

AFR	10,49
BF	0,25

INDOOR		Outdoor temperature [° C DB]																	
°C	°C	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	2,56	1,90	0,43	2,44	1,86	0,47	2,33	1,82	0,51	2,28	1,81	0,52	2,21	1,79	0,55	2,10	1,77	0,59
16	22	2,68	1,81	0,43	2,56	1,77	0,47	2,44	1,73	0,51	2,40	1,72	0,53	2,33	1,70	0,55	2,21	1,67	0,59
18	25	2,79	1,90	0,43	2,68	1,87	0,47	2,56	1,84	0,51	2,51	1,83	0,53	2,44	1,82	0,55	2,33	1,81	0,60
19	27	2,85	2,05	0,43	2,73	2,03	0,47	2,62	2,02	0,51	2,57	2,02	0,53	2,50	2,02	0,56	2,38	2,03	0,60
22	30	3,02	1,86	0,44	2,91	1,83	0,48	2,79	1,81	0,52	2,74	1,80	0,53	2,67	1,80	0,56	2,56	1,79	0,60
24	32	3,14	1,74	0,44	3,02	1,71	0,48	2,90	1,69	0,52	2,86	1,68	0,54	2,79	1,67	0,56	2,67	1,66	0,60

**Heating**

50Hz 220-240V

AFR	9,78
-----	------

INDOOR		Outdoor temperature [° C WB]											
°C	EDB	-15		-10		-5		0		7		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15		1,33	0,36	1,60	0,38	1,87	0,40	2,09	0,52	2,90	0,55	3,15	0,57
20		1,25	0,37	1,52	0,39	1,79	0,41	1,98	0,53	2,80	0,56	3,05	0,58
22		1,22	0,37	1,49	0,40	1,76	0,42	1,95	0,53	2,76	0,57	3,01	0,59
24		1,19	0,38	1,45	0,40	1,72	0,42	1,92	0,54	2,72	0,57	2,98	0,59
25		1,17	0,38	1,44	0,40	1,71	0,42	1,90	0,54	2,70	0,57	2,96	0,59
27		1,14	0,39	1,41	0,41	1,67	0,42	1,88	0,55	2,66	0,58	2,92	0,60

**Symbols**

AFR: Air flow rate [m³/min]

BF: Bypass factor

EWB: Entering wet-bulb temperature [° C WB]

EDB: Entering dry-bulb temperature [° C DB]

TC: Total capacity [kW]

SHC: Sensible heat capacity [kW]

PI: Power input [kW]

**Notes**

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- Nominal capacity and nominal input
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0·m
- The air flow rate and bypass factor are mentioned in the table.

4D130635

**FBA35A9 / RXM35R**

**Cooling ·220-240V 50Hz·**

AFR	15,0
BF	0,08

Indoor		Outdoor temperature [°C DB]																	
°C	EWB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	3,59	3,18	0,67	3,42	3,11	0,73	3,26	3,03	0,80	3,19	3,00	0,82	3,10	2,96	0,86	2,93	2,89	0,93
16	22	3,75	3,13	0,67	3,58	3,06	0,74	3,42	2,99	0,80	3,36	2,97	0,83	3,26	2,92	0,86	3,10	2,86	0,93
18	25	3,91	3,35	0,68	3,75	3,29	0,74	3,58	3,22	0,80	3,52	3,20	0,83	3,42	3,16	0,87	3,26	3,10	0,93
19	27	3,99	3,60	0,68	3,83	3,54	0,74	3,66	3,48	0,81	3,60	3,45	0,83	3,50	3,42	0,87	3,34	3,36	0,93
22	30	4,23	3,50	0,68	4,07	3,44	0,75	3,90	3,39	0,81	3,84	3,37	0,84	3,74	3,34	0,88	3,58	3,28	0,94
24	32	4,39	3,43	0,69	4,23	3,38	0,75	4,07	3,33	0,82	4,00	3,31	0,84	3,90	3,28	0,88	3,74	3,23	0,94

**Heating ·220-240V 50Hz·**

AFR	15,0
-----	------

Indoor		Outdoor temperature [°C WB]											
°C	EDB	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15		1,86	0,80	2,23	0,84	2,61	0,88	2,98	0,92	4,14	0,97	4,50	1,01
20		1,75	0,82	2,12	0,86	2,50	0,90	2,87	0,95	4,00	1,00	4,36	1,03
22		1,70	0,83	2,07	0,87	2,45	0,91	2,82	0,95	3,94	1,00	4,31	1,04
24		1,65	0,84	2,03	0,88	2,40	0,92	2,78	0,96	3,89	1,01	4,25	1,05
25		1,63	0,85	2,01	0,89	2,38	0,93	2,76	0,97	3,86	1,02	4,22	1,05
27		1,59	0,85	1,96	0,90	2,33	0,94	2,71	0,98	3,81	1,03	4,17	1,06

**Symbols**

TC: Total capacity [kW]

PI: Power input [kW]

SHC: Sensible heat capacity [kW]

AFR: Air flow rate [m³/min]

BF: Bypass factor

EWB: Entering wet-bulb temperature (°C WB)

EDB: Entering dry-bulb temperature (°C DB)

**Notes**

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- The bold cells indicate the standard conditions.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0·m
- The air flow rate and bypass factor are mentioned in the table.

3D110072B

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

4

**FCAG35B / RXM35R**

Cooling ·220-240V 50Hz·

AFR	12,5
BF	0,4

Indoor		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	3,08	2,27	0,63	3,08	2,27	0,72	3,08	2,27	0,81	3,08	2,27	0,85	3,01	2,24	0,89	2,85	2,16	0,96
16	22	3,64	2,44	0,70	3,48	2,36	0,76	3,32	2,28	0,83	3,26	2,25	0,86	3,17	2,21	0,90	3,01	2,13	0,96
18	25	3,80	2,54	0,70	3,64	2,46	0,77	3,48	2,39	0,83	3,42	2,36	0,86	3,32	2,32	0,90	3,16	2,25	0,97
19	27	3,87	2,66	0,70	3,72	2,59	0,77	3,56	2,52	0,84	3,49	2,49	0,86	3,40	2,45	0,90	3,24	2,39	0,97
22	30	4,11	2,56	0,71	3,95	2,50	0,77	3,79	2,44	0,84	3,73	2,41	0,87	3,63	2,38	0,91	3,48	2,32	0,97
24	32	4,27	2,49	0,71	4,11	2,43	0,78	3,95	2,37	0,85	3,89	2,35	0,87	3,79	2,32	0,91	3,63	2,26	0,98

Heating ·220-240V 50Hz·

AFR	12,5
-----	------

Indoor		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	1,95	0,97	2,35	1,01	2,74	1,06	3,13	1,11	4,34	1,17	4,72	1,21	
20	1,83	0,99	2,23	1,04	2,62	1,09	3,01	1,14	4,20	1,20	4,58	1,24	
22	1,78	1,00	2,18	1,05	2,57	1,10	2,97	1,15	4,14	1,21	4,52	1,25	
24	1,74	1,01	2,13	1,06	2,52	1,11	2,92	1,16	4,08	1,22	4,46	1,26	
25	1,71	1,02	2,11	1,07	2,50	1,12	2,89	1,17	4,06	1,23	4,43	1,27	
27	1,66	1,03	2,06	1,08	2,45	1,13	2,85	1,18	4,00	1,24	4,38	1,28	

Symbols

- TC: Total capacity [kW]
- PI: Power input [kW]
- SHC: Sensible heat capacity [kW]
- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)

Notes

1. The ratings shown are net capacities which include a deduction for indoor fan motor heat.
2. The bold cells indicate the standard conditions.
3. The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
4. In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
5. The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0·m
6. The air flow rate and bypass factor are mentioned in the table.

3D110075C

**FDXM35F9 / RXM35R**

Cooling ·220-240V 50Hz·

AFR	8,7
BF	0,17

Indoor		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	2,96	2,19	0,78	2,96	2,19	0,89	2,96	2,19	1,01	2,96	2,19	1,05	2,96	2,19	1,13	2,85	2,13	1,22
16	22	3,64	2,42	0,89	3,48	2,34	0,97	3,32	2,26	1,06	3,26	2,23	1,09	3,17	2,18	1,14	3,01	2,11	1,23
18	25	3,80	2,51	0,89	3,64	2,43	0,98	3,48	2,36	1,06	3,42	2,33	1,10	3,32	2,29	1,15	3,16	2,22	1,23
19	27	3,87	2,63	0,89	3,72	2,55	0,98	3,56	2,48	1,06	3,49	2,46	1,10	3,40	2,42	1,15	3,24	2,35	1,23
22	30	4,11	2,52	0,90	3,95	2,46	0,99	3,79	2,40	1,07	3,73	2,38	1,11	3,63	2,34	1,16	3,48	2,28	1,24
24	32	4,27	2,45	0,91	4,11	2,39	0,99	3,95	2,34	1,08	3,89	2,32	1,11	3,79	2,28	1,16	3,63	2,23	1,25

Heating ·220-240V 50Hz·

AFR	8,7
-----	-----

Indoor		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	1,86	0,92	2,23	0,97	2,61	1,02	2,98	1,07	4,14	1,12	4,50	1,16	
20	1,75	0,95	2,12	1,00	2,50	1,05	2,87	1,09	4,00	1,15	4,36	1,19	
22	1,70	0,96	2,07	1,01	2,45	1,06	2,82	1,10	3,94	1,16	4,31	1,20	
24	1,65	0,97	2,03	1,02	2,40	1,07	2,78	1,11	3,89	1,17	4,25	1,21	
25	1,63	0,98	2,01	1,02	2,38	1,07	2,76	1,12	3,86	1,18	4,22	1,21	
27	1,59	0,99	1,96	1,03	2,33	1,08	2,71	1,13	3,81	1,19	4,02	1,21	

Symbols

- TC: Total capacity [kW]
- PI: Power input [kW]
- SHC: Sensible heat capacity [kW]
- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)

Notes

1. The ratings shown are net capacities which include a deduction for indoor fan motor heat.
2. The bold cells indicate the standard conditions.
3. The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
4. In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
5. The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0·m
6. The air flow rate and bypass factor are mentioned in the table.

3D110079B



# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

**FFA35A9 / RXM35R**

Cooling ·220-240V 50Hz·

AFR	10,0
BF	0,25

Indoor		Outdoor temperature [°C DB]																	
EWB °C	EDB °C	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	3,08	2,27	0,62	3,08	2,27	0,71	3,08	2,27	0,80	3,08	2,27	0,84	3,01	2,24	0,88	2,85	2,16	0,95
16	22	3,64	2,44	0,69	3,48	2,36	0,75	3,32	2,28	0,82	3,26	2,25	0,85	3,17	2,21	0,89	3,01	2,13	0,95
18	25	3,80	2,54	0,69	3,64	2,46	0,76	3,48	2,39	0,82	3,42	2,36	0,85	3,32	2,32	0,89	3,16	2,25	0,96
19	27	3,87	2,66	0,69	3,72	2,59	0,76	3,56	2,52	0,83	3,49	2,49	0,85	3,40	2,45	0,89	3,24	2,39	0,96
22	30	4,11	2,56	0,70	3,95	2,50	0,77	3,79	2,44	0,83	3,73	2,41	0,86	3,63	2,38	0,90	3,48	2,32	0,96
24	32	4,27	2,49	0,70	4,11	2,43	0,77	3,95	2,37	0,84	3,89	2,35	0,86	3,79	2,32	0,90	3,63	2,26	0,97

Heating ·220-240V 50Hz·

AFR	10,0
-----	------

Indoor		Outdoor temperature [°C WB]											
EDB °C	TC	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	1,95	0,97	2,35	1,01	2,74	1,06	3,13	1,11	4,34	1,17	4,72	1,21	
20	1,83	0,99	2,23	1,04	2,62	1,09	3,01	1,14	4,20	1,20	4,58	1,24	
22	1,78	1,00	2,18	1,05	2,57	1,10	2,97	1,15	4,14	1,21	4,52	1,25	
24	1,74	1,01	2,13	1,06	2,52	1,11	2,92	1,16	4,08	1,22	4,46	1,26	
25	1,71	1,02	2,11	1,07	2,50	1,12	2,89	1,17	4,06	1,23	4,43	1,27	
27	1,66	1,03	2,06	1,08	2,45	1,13	2,85	1,18	4,00	1,24	4,38	1,28	

Symbols

- TC: Total capacity [kW]
- PI: Power input [kW]
- SHC: Sensible heat capacity [kW]
- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)

Notes

1. The ratings shown are net capacities which include a deduction for indoor fan motor heat.
2. The bold cells indicate the standard conditions.
3. The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
4. In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
5. The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0·m
6. The air flow rate and bypass factor are mentioned in the table.

3D110083B

**FHA35A9 / RXM35R**

Cooling ·220-240V 50Hz·

AFR	14,0
BF	0,17

Indoor		Outdoor temperature [°C DB]																	
EWB °C	EDB °C	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	3,48	2,89	0,70	3,33	2,82	0,77	3,17	2,75	0,83	3,10	2,72	0,86	3,01	2,67	0,90	2,85	2,60	0,97
16	22	3,64	2,85	0,70	3,48	2,78	0,77	3,32	2,71	0,84	3,26	2,68	0,87	3,17	2,64	0,91	3,01	2,57	0,97
18	25	3,80	3,03	0,71	3,64	2,96	0,77	3,48	2,90	0,84	3,42	2,87	0,87	3,32	2,83	0,91	3,16	2,77	0,98
19	27	3,87	3,23	0,71	3,72	3,17	0,78	3,56	3,11	0,84	3,49	3,08	0,87	3,40	3,05	0,91	3,24	2,99	0,98
22	30	4,11	3,13	0,72	3,95	3,08	0,78	3,79	3,02	0,85	3,73	3,00	0,88	3,63	2,97	0,92	3,48	2,92	0,98
24	32	4,27	3,06	0,72	4,11	3,01	0,79	3,95	2,96	0,85	3,89	2,95	0,88	3,79	2,92	0,92	3,63	2,87	0,99

Heating ·220-240V 50Hz·

AFR	14,0
-----	------

Indoor		Outdoor temperature [°C WB]											
EDB °C	TC	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	1,86	0,79	2,23	0,83	2,61	0,87	2,98	0,91	4,14	0,96	4,50	0,99	
20	1,75	0,81	2,12	0,85	2,50	0,89	2,87	0,93	4,00	0,98	4,36	1,01	
22	1,70	0,82	2,07	0,86	2,45	0,90	2,82	0,94	3,94	0,99	4,31	1,02	
24	1,65	0,83	2,03	0,87	2,40	0,91	2,78	0,95	3,89	1,00	4,25	1,03	
25	1,63	0,83	2,01	0,87	2,38	0,91	2,76	0,95	3,86	1,00	4,22	1,03	
27	1,59	0,84	1,96	0,88	2,33	0,92	2,71	0,96	3,81	1,01	4,17	1,04	

Symbols

- TC: Total capacity [kW]
- PI: Power input [kW]
- SHC: Sensible heat capacity [kW]
- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)

Notes

1. The ratings shown are net capacities which include a deduction for indoor fan motor heat.
2. The bold cells indicate the standard conditions.
3. The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
4. In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
5. The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0·m
6. The air flow rate and bypass factor are mentioned in the table.

3D110086B

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

### FNA35A9 / RXM35R

Cooling · 220-240V 50Hz ·

AFR	8,7
BF	0,17

Indoor		Outdoor temperature [°C DB]																	
°C	°C	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	2,96	2,19	0,75	2,96	2,19	0,85	2,96	2,19	0,96	2,96	2,19	1,01	2,96	2,19	1,08	2,85	2,13	1,17
16	22	3,64	2,42	0,85	3,48	2,34	0,93	3,32	2,26	1,01	3,26	2,23	1,04	3,17	2,18	1,09	3,01	2,11	1,17
18	25	3,80	2,51	0,85	3,64	2,43	0,93	3,48	2,36	1,02	3,42	2,33	1,05	3,32	2,29	1,10	3,16	2,22	1,18
19	27	3,87	2,63	0,86	3,72	2,55	0,94	3,56	2,48	1,02	3,49	2,46	1,05	3,40	2,42	1,10	3,24	2,35	1,18
22	30	4,11	2,52	0,86	3,95	2,46	0,94	3,79	2,40	1,03	3,73	2,38	1,06	3,63	2,34	1,11	3,48	2,28	1,19
24	32	4,27	2,45	0,87	4,11	2,39	0,95	3,95	2,34	1,03	3,89	2,32	1,06	3,79	2,28	1,11	3,63	2,23	1,19

Heating · 220-240V 50Hz ·

AFR	8,7
-----	-----

Indoor		Outdoor temperature [°C WB]											
°C	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	1,86	0,92	2,23	0,97	2,61	1,02	2,98	1,07	4,14	1,12	4,50	1,16	
20	1,75	0,95	2,12	1,00	2,50	1,05	2,87	1,09	4,00	1,15	4,36	1,19	
22	1,70	0,96	2,07	1,01	2,45	1,06	2,82	1,10	3,94	1,16	4,31	1,20	
24	1,65	0,97	2,03	1,02	2,40	1,07	2,78	1,11	3,89	1,17	4,25	1,21	
25	1,63	0,98	2,01	1,02	2,38	1,07	2,76	1,12	3,86	1,18	4,22	1,21	
27	1,59	0,99	1,96	1,03	2,33	1,08	2,71	1,13	3,81	1,19	4,02	1,21	

Symbols

- TC: Total capacity [kW]
- PI: Power input [kW]
- SHC: Sensible heat capacity [kW]
- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)

#### Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- The bold cells indicate the standard conditions.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0· m
- The air flow rate and bypass factor are mentioned in the table.

3D110090B

### FVXM35F / RXM35R

Cooling · 220-240V 50Hz ·

AFR	8,5
BF	0,11

Indoor		Outdoor temperature [°C DB]																	
°C	°C	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	3,11	2,29	0,75	3,11	2,29	0,86	3,11	2,29	0,96	3,11	2,29	1,01	3,10	2,29	1,08	2,93	2,21	1,16
16	22	3,75	2,50	0,84	3,58	2,42	0,92	3,42	2,34	1,00	3,36	2,31	1,03	3,26	2,26	1,08	3,10	2,18	1,16
18	25	3,91	2,60	0,85	3,75	2,52	0,93	3,58	2,45	1,01	3,52	2,42	1,04	3,42	2,37	1,09	3,26	2,30	1,17
19	27	3,99	2,72	0,85	3,83	2,65	0,93	3,66	2,57	1,01	3,60	2,55	1,04	3,50	2,50	1,09	3,34	2,43	1,17
22	30	4,23	2,61	0,86	4,07	2,55	0,94	3,90	2,49	1,02	3,84	2,46	1,05	3,74	2,43	1,10	3,58	2,36	1,18
24	32	4,39	2,54	0,86	4,23	2,48	0,94	4,07	2,42	1,02	4,00	2,40	1,05	3,90	2,37	1,10	3,74	2,31	1,18

Heating · 220-240V 50Hz ·

AFR	9,4
-----	-----

Indoor		Outdoor temperature [°C WB]											
°C	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	2,09	0,96	2,51	1,01	2,94	1,06	3,36	1,10	4,66	1,16	5,06	1,20	
20	1,96	0,98	2,39	1,03	2,81	1,08	3,23	1,13	4,50	1,19	4,91	1,23	
22	1,91	1,00	2,33	1,04	2,76	1,09	3,18	1,14	4,44	1,20	4,84	1,24	
24	1,86	1,01	2,28	1,06	2,70	1,10	3,13	1,15	4,38	1,21	4,78	1,25	
25	1,83	1,01	2,26	1,06	2,68	1,11	3,10	1,16	4,34	1,22	4,75	1,26	
27	1,78	1,02	2,20	1,07	2,63	1,12	3,05	1,17	4,28	1,23	4,49	1,26	

Symbols

- TC: Total capacity [kW]
- PI: Power input [kW]
- SHC: Sensible heat capacity [kW]
- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)

#### Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- The bold cells indicate the standard conditions.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0· m
- The air flow rate and bypass factor are mentioned in the table.

3D110094B

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

4

**FTXM35N / RXM35R**

Cooling · 220-240V 50Hz·

AFR	12,3
BF	0,21

Indoor		Outdoor temperature [°C DB]																	
°C	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	3,48	2,66	0,59	3,32	2,60	0,67	3,16	2,52	0,73	3,11	2,49	0,75	3,01	2,45	0,79	2,85	2,38	0,85
16	22	3,64	2,63	0,62	3,48	2,57	0,68	3,32	2,49	0,73	3,27	2,46	0,76	3,17	2,42	0,79	3,01	2,35	0,86
18	25	3,80	2,77	0,62	3,64	2,70	0,68	3,48	2,64	0,74	3,42	2,61	0,76	3,32	2,58	0,80	3,17	2,51	0,86
19	27	3,88	2,93	0,62	3,72	2,88	0,69	3,56	2,81	0,74	3,50	2,78	0,76	3,40	2,74	0,80	3,25	2,68	0,86
22	30	4,11	2,84	0,63	3,96	2,78	0,69	3,79	2,72	0,74	3,73	2,70	0,77	3,63	2,67	0,81	3,48	2,61	0,87
24	32	4,27	2,77	0,63	4,11	2,71	0,70	3,96	2,66	0,75	3,89	2,64	0,77	3,79	2,61	0,81	3,63	2,57	0,87

Heating · 220-240V 50Hz·

AFR	10,8
-----	------

Indoor		Outdoor temperature [°C WB]											
°C	EDB	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	1,90	0,64	2,29	0,67	2,67	0,71	3,60	0,92	4,14	0,97	4,50	1,00	
20	1,79	0,66	2,17	0,68	2,56	0,72	3,46	0,94	4,00	0,99	4,36	1,03	
22	1,74	0,66	2,12	0,70	2,51	0,73	3,40	0,96	3,94	1,00	4,31	1,04	
24	1,69	0,67	2,08	0,71	2,46	0,73	3,35	0,96	3,89	1,01	4,25	1,04	
25	1,67	0,67	2,05	0,71	2,44	0,74	3,32	0,97	3,86	1,01	4,22	1,05	
27	1,62	0,68	2,01	0,71	2,39	0,74	3,26	0,97	3,81	1,03	4,17	1,05	

Symbols

TC: Total capacity [kW]

PI: Power input [kW]

SHC: Sensible heat capacity [kW]

AFR: Air flow rate [m³/min]

BF: Bypass factor

EWB: Entering wet-bulb temperature (°C WB)

EDB: Entering dry-bulb temperature (°C DB)

Notes

- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0·m
- The bold cells indicate the standard conditions.  
Rated operating frequency [Hz]

3D120716A

**FVXM35A / RXM35R**

Cooling · 220-240V 50Hz·

AFR	9,2
BF	0,11

Indoor air temperature [°C WB]	Indoor air temperature [°C DB]	Outdoor air temperature [°C DB]																	
		20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	3,35	2,39	0,63	3,33	2,38	0,70	3,17	2,32	0,76	3,10	2,29	0,79	3,01	2,26	0,82	2,85	2,20	0,89
16	22	3,64	2,36	0,64	3,48	2,29	0,70	3,32	2,22	0,77	3,26	2,20	0,79	3,17	2,16	0,83	3,01	2,10	0,89
18	25	3,80	2,44	0,65	3,64	2,38	0,71	3,48	2,32	0,77	3,42	2,30	0,79	3,32	2,27	0,83	3,16	2,23	0,89
19	27	3,87	2,58	0,65	3,72	2,53	0,71	3,56	2,49	0,77	3,49	2,47	0,80	3,40	2,45	0,83	3,24	2,43	0,89
22	30	4,11	2,38	0,65	3,95	2,32	0,72	3,79	2,27	0,78	3,73	2,26	0,80	3,63	2,23	0,84	3,48	2,19	0,90
24	32	4,27	2,25	0,66	4,11	2,20	0,72	3,95	2,15	0,78	3,89	2,13	0,81	3,79	2,10	0,84	3,63	2,06	0,90

Heating · 220-240V 50Hz·

AFR	9,8
-----	-----

Indoor air temperature [°C DB]	Outdoor air temperature [°C DB]													
	-20		-15		-10		-5		0		7		10	
	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	2,71	0,97	3,08	1,00	3,45	1,03	3,17	1,06	3,47	1,09	4,71	1,13	4,93	1,15
20	2,14	1,02	2,87	1,05	3,24	1,08	3,00	1,11	3,30	1,14	4,50	1,18	4,72	1,20
22	1,78	1,05	2,78	1,08	3,15	1,10	2,93	1,13	1,81	1,16	4,42	1,20	4,64	1,22
24	1,42	1,07	2,70	1,10	3,07	1,12	3,44	1,15	1,73	1,18	4,33	1,21	4,55	1,24
25	1,24	1,08	2,66	1,11	3,03	1,14	3,40	1,16	1,70	1,19	4,29	1,22	4,51	1,25
27	0,89	1,10	2,49	1,13	2,94	1,16	3,32	1,18	1,62	1,21	4,21	1,23	4,43	1,27

Heating capacity at nominal operating frequency, measured according to ·EN 14511·.

Notes

- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5,0· m  
Level difference: ·0·m
- The bold cells indicate the standard conditions.

Symbols

TC: Total capacity [kW]

PI: Power input [kW]

SHC: Sensible heat capacity [kW]

AFR: Air flow rate [m³/min]

BF: Bypass factor

3D130940

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

4

**FTXM35R / RXM35R**

**Cooling** 50Hz 220-240V

AFR	11,33
BF	0,20

INDOOR		Outdoor temperature [° C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	3,48	2,54	0,62	3,33	2,48	0,68	3,17	2,42	0,74	3,10	2,40	0,76	3,01	2,38	0,79	2,85	2,34	0,85
16	22	3,64	2,43	0,62	3,48	2,37	0,68	3,32	2,31	0,74	3,26	2,29	0,76	3,17	2,26	0,80	3,01	2,21	0,86
18	25	3,80	2,54	0,62	3,64	2,48	0,68	3,48	2,44	0,74	3,42	2,42	0,77	3,32	2,40	0,80	3,16	2,38	0,86
19	27	3,87	2,71	0,63	3,72	2,68	0,68	3,56	2,65	0,74	3,49	2,65	0,77	3,40	2,64	0,80	3,24	2,65	0,86
22	30	4,11	2,48	0,63	3,95	2,43	0,69	3,79	2,40	0,75	3,73	2,39	0,77	3,63	2,37	0,81	3,48	2,35	0,87
24	32	4,27	2,33	0,63	4,11	2,28	0,69	3,95	2,24	0,75	3,89	2,23	0,78	3,79	2,21	0,81	3,63	2,19	0,87

**Heating** 50Hz 220-240V

AFR	9,78
-----	------

INDOOR		Outdoor temperature [° C WB]											
EDB	°C	-15		-10		-5		0		7		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	2,31	0,75	2,74	0,79	3,13	0,84	3,35	0,88	4,21	0,94	4,47	0,96	
20	2,10	0,80	2,53	0,85	2,96	0,89	3,16	0,93	4,00	0,99	4,26	1,02	
22	2,02	0,82	2,45	0,87	2,88	0,91	3,08	0,95	3,92	1,01	4,18	1,04	
24	1,93	0,84	2,36	0,89	2,80	0,93	3,01	0,97	3,83	1,02	4,09	1,06	
25	1,89	0,86	2,32	0,90	2,75	0,94	2,97	0,98	3,79	1,02	4,05	1,07	
27	1,81	0,88	2,24	0,92	2,67	0,96	2,90	1,00	3,71	1,03	3,97	1,09	

**Symbols**

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature [° C WB]
- EDB: Entering dry-bulb temperature [° C DB]
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

**Notes**

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- Nominal capacity and nominal input
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0·m
- The air flow rate and bypass factor are mentioned in the table.

4D130636

**FTXM42R / RXM42R**

**Cooling** 50Hz 220-240V

AFR	11,93
BF	0,21

INDOOR		Outdoor temperature [° C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	3,86	2,83	0,71	3,86	2,83	0,79	3,86	2,83	0,88	3,83	2,82	0,92	3,72	2,77	0,96	3,52	2,71	1,03
16	22	4,50	2,91	0,75	4,30	2,82	0,82	4,11	2,74	0,89	4,03	2,70	0,92	3,91	2,66	0,96	3,71	2,58	1,04
18	25	4,69	3,01	0,75	4,49	2,93	0,82	4,30	2,86	0,90	4,22	2,83	0,92	4,10	2,79	0,97	3,91	2,73	1,04
19	27	4,79	3,17	0,75	4,59	3,11	0,83	4,40	3,05	0,90	4,32	3,03	0,93	4,20	3,00	0,97	4,00	2,97	1,04
22	30	5,08	2,93	0,76	4,88	2,86	0,83	4,69	2,80	0,90	4,61	2,77	0,93	4,49	2,74	0,98	4,29	2,69	1,05
24	32	5,27	2,77	0,77	5,07	2,70	0,84	4,88	2,64	0,91	4,80	2,61	0,94	4,68	2,58	0,98	4,49	2,53	1,05

**Heating** 50Hz 220-240V

AFR	12,42
-----	-------

INDOOR		Outdoor temperature [° C WB]											
EDB	°C	-15		-10		-5		0		7		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	2,66	0,79	3,33	0,89	4,00	1,00	3,87	1,11	5,61	1,26	6,01	1,32	
20	2,45	0,84	3,12	0,95	3,79	1,05	3,70	1,16	5,40	1,31	5,80	1,38	
22	2,36	0,86	3,03	0,97	3,70	1,07	3,63	1,18	5,32	1,33	5,72	1,40	
24	2,28	0,88	2,95	0,99	3,62	1,09	3,56	1,20	5,23	1,35	5,63	1,42	
25	2,24	0,89	2,91	1,00	3,58	1,10	3,52	1,21	5,19	1,35	5,59	1,43	
27	2,15	0,91	2,82	1,02	3,49	1,13	3,45	1,23	5,11	1,36	5,51	1,45	

**Symbols**

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature [° C WB]
- EDB: Entering dry-bulb temperature [° C DB]
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

**Notes**

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- Nominal capacity and nominal input
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0·m
- The air flow rate and bypass factor are mentioned in the table.

4D130637

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

**FTXM50R / RXM50R**

Cooling

·50· Hz ·220-240· V

AFR	15,45
BF	0,21

Indoor		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC
14	20	5,12	3,89	1,04	4,89	3,82	1,14	4,66	3,76	1,24	4,56	3,74	1,28	4,42	3,71	1,34	4,19	3,69	1,44
16	22	5,35	3,70	1,05	5,12	3,62	1,15	4,89	3,55	1,25	4,79	3,53	1,29	4,65	3,50	1,35	4,42	3,45	1,45
18	25	5,58	3,90	1,05	5,35	3,84	1,15	5,12	3,80	1,26	5,02	3,79	1,30	4,88	3,78	1,36	4,65	3,77	1,46
19	27	5,70	4,24	1,06	5,47	4,21	1,16	5,23	4,22	1,26	5,14	4,22	1,30	5,00	4,25	1,36	4,77	4,31	1,46
22	30	6,04	3,82	1,07	5,81	3,78	1,17	5,58	3,75	1,27	5,49	3,75	1,31	5,35	3,74	1,37	5,11	3,76	1,47
24	32	6,27	3,57	1,07	6,04	3,53	1,17	5,81	3,49	1,27	5,72	3,48	1,31	5,58	3,46	1,37	5,34	3,45	1,47

Heating

·50· Hz ·220-240· V

AFR	15,33
-----	-------

Indoor		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		7		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	2,76	0,93	3,32	0,98	3,88	1,03	4,03	1,35	6,00	1,42	6,52	1,47	
20	2,59	0,96	3,15	1,01	3,71	1,05	3,88	1,38	5,80	1,45	6,32	1,50	
22	2,52	0,97	3,08	1,02	3,64	1,07	3,81	1,39	5,72	1,46	6,24	1,51	
24	2,46	0,98	3,01	1,03	3,57	1,08	3,75	1,40	5,64	1,48	6,16	1,52	
25	2,42	0,99	2,98	1,03	3,54	1,08	3,68	1,41	5,60	1,48	6,12	1,53	
27	2,35	1,00	2,91	1,04	3,47	1,09	3,62	1,42	5,52	1,50	6,04	1,54	

Symbols

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- 1) The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- 2) On the figure the  mark shows the rated capacity and rated coefficient of the power input.
- 3) The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- 4) In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- 5) The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0· m
- 6) The air flow rate and bypass factor are mentioned in the table.

3D131701

**FVXM50A / RXM50R**

Cooling ·50Hz 220-240V·

AFR	11,6
BF	0,11

Indoor		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC
14	20	4,34	3,70	0,95	4,28	3,70	1,07	4,18	3,69	1,18	4,11	3,69	1,23	4,06	3,69	1,29	4,01	3,69	1,39
16	22	5,15	3,63	1,01	5,02	3,59	1,11	4,86	3,55	1,21	4,79	3,53	1,25	4,65	3,50	1,30	4,42	3,45	1,40
18	25	5,48	3,87	1,02	5,32	3,84	1,12	5,12	3,80	1,21	5,02	3,79	1,25	4,88	3,78	1,31	4,65	3,77	1,41
19	27	5,67	4,23	1,02	5,47	4,21	1,12	5,23	4,22	1,22	5,14	4,22	1,25	5,00	4,25	1,31	4,77	4,31	1,41
22	30	6,04	3,82	1,03	5,81	3,78	1,13	5,58	3,75	1,22	5,49	3,75	1,26	5,35	3,74	1,32	5,11	3,76	1,42
24	32	6,27	3,57	1,04	6,04	3,53	1,13	5,81	3,49	1,23	5,72	3,48	1,27	5,58	3,46	1,33	5,34	3,45	1,42

Heating ·50Hz 220-240V·

AFR	12,8
-----	------

Indoor		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		7		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	2,44	0,95	3,26	1,07	4,07	1,19	4,05	1,31	6,02	1,47	6,51	1,54	
20	2,22	1,01	3,04	1,12	3,85	1,24	3,86	1,36	5,80	1,52	6,29	1,59	
22	2,13	1,03	2,95	1,14	3,76	1,26	3,79	1,38	5,71	1,55	6,20	1,61	
24	2,05	1,05	2,86	1,16	3,67	1,28	3,72	1,40	5,62	1,56	6,11	1,63	
25	2,00	1,06	2,82	1,17	3,63	1,29	3,68	1,41	5,58	1,57	6,07	1,64	
27	1,91	1,08	2,73	1,20	3,54	1,31	3,61	1,43	5,49	1,58	5,98	1,67	

Notes

- 1) The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- 2) The bold cells indicate the standard conditions.
- 3) The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- 4) In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- 5) The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0· m
- 6) The air flow rate and bypass factor are mentioned in the table.

Symbols

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

4D134323

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

4

**FBA50A9 / RXM50R**

**Cooling**

·50· Hz ·220 - 240· V

AFR	15,0
BF	0,13

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,12	3,84	1,08	4,89	3,72	1,18	4,66	3,61	1,29	4,56	3,56	1,33	4,42	3,49	1,39	4,19	3,38	1,50
16,0	22	5,35	3,77	1,09	5,12	3,66	1,19	4,89	3,55	1,29	4,79	3,51	1,34	4,65	3,45	1,40	4,42	3,34	1,50
18,0	25	5,58	3,95	1,09	5,35	3,85	1,20	5,12	3,75	1,30	5,02	3,71	1,34	4,88	3,66	1,40	4,65	3,56	1,51
19,0	27	5,70	4,18	1,10	5,47	4,08	1,20	5,23	3,98	1,30	5,14	3,94	1,35	5,00	3,89	1,41	4,77	3,79	1,51
22,0	30	6,04	4,03	1,11	5,81	3,94	1,21	5,58	3,86	1,31	5,49	3,82	1,35	5,35	3,77	1,42	5,11	3,69	1,52
24,0	32	6,27	3,92	1,11	6,04	3,85	1,22	5,81	3,77	1,32	5,72	3,74	1,36	5,58	3,69	1,42	5,34	3,62	1,53

**Heating**

·50· Hz ·220 - 240· V

AFR	15,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	2,56	1,16	3,07	1,21	3,59	1,27	4,10	1,33	5,69	1,40	6,19	1,45	
20,0	2,40	1,19	2,92	1,25	3,43	1,31	3,95	1,37	5,50	1,44	6,00	1,48	
22,0	2,34	1,20	2,85	1,26	3,37	1,32	3,88	1,38	5,42	1,45	5,92	1,50	
24,0	2,27	1,21	2,79	1,27	3,30	1,33	3,82	1,39	5,35	1,46	5,84	1,51	
25,0	2,24	1,22	2,76	1,28	3,27	1,34	3,79	1,40	5,31	1,47	5,81	1,52	
27,0	2,18	1,23	2,69	1,29	3,21	1,35	3,73	1,41	5,23	1,48	5,73	1,53	

Symbols

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0· m
- The air flow rate and bypass factor are mentioned in the table.

3D110073C

**FCAG50B / RXM50R**

**Cooling**

·50· Hz ·220 - 240· V

AFR	12,6
BF	0,22

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	4,03	2,98	0,91	4,03	2,98	1,04	4,03	2,98	1,17	4,03	2,98	1,23	4,03	2,98	1,31	4,03	2,98	1,46
16,0	22	5,13	3,37	1,05	5,12	3,37	1,18	4,89	3,25	1,28	4,79	3,21	1,33	4,65	3,14	1,39	4,42	3,03	1,49
18,0	25	5,58	3,61	1,08	5,35	3,50	1,19	5,12	3,39	1,29	5,02	3,35	1,33	4,88	3,28	1,39	4,65	3,18	1,50
19,0	27	5,70	3,77	1,09	5,47	3,66	1,19	5,23	3,55	1,29	5,14	3,51	1,34	5,00	3,45	1,40	4,77	3,35	1,50
22,0	30	6,04	3,62	1,10	5,81	3,52	1,20	5,58	3,43	1,30	5,49	3,39	1,34	5,35	3,34	1,41	5,11	3,25	1,51
24,0	32	6,27	3,51	1,10	6,04	3,42	1,21	5,81	3,34	1,31	5,72	3,30	1,35	5,58	3,25	1,41	5,34	3,17	1,52

**Heating**

·50· Hz ·220 - 240· V

AFR	12,6
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	2,79	1,30	3,35	1,37	3,91	1,44	4,48	1,50	6,21	1,59	6,75	1,64	
20,0	2,62	1,34	3,18	1,41	3,74	1,47	4,31	1,54	6,00	1,62	6,54	1,68	
22,0	2,55	1,36	3,11	1,42	3,67	1,49	4,24	1,56	5,92	1,64	6,31	1,69	
24,0	2,48	1,37	3,04	1,44	3,61	1,50	4,17	1,57	5,83	1,65	6,16	1,70	
25,0	2,45	1,38	3,01	1,44	3,57	1,51	4,13	1,58	5,63	1,66	6,03	1,71	
27,0	2,38	1,39	2,94	1,46	3,50	1,53	4,06	1,59	5,48	1,67	5,88	1,73	

Symbols

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0· m
- The air flow rate and bypass factor are mentioned in the table.

3D110076D

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

**FDXM50F9 / RXM50R**

Cooling 50· Hz 220· 240· V

AFR	15,8
BF	0,11

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	4,38	3,24	1,15	4,38	3,24	1,30	4,38	3,24	1,46	4,38	3,24	1,53	4,38	3,24	1,61	4,17	3,13	1,75
16,0	22	5,35	3,56	1,27	5,12	3,44	1,40	4,89	3,33	1,52	4,79	3,28	1,57	4,65	3,22	1,62	4,37	3,08	1,75
18,0	25	5,58	3,70	1,28	5,35	3,59	1,40	5,12	3,48	1,52	5,02	3,44	1,57	4,88	3,38	1,63	4,58	3,24	1,75
19,0	27	5,70	3,87	1,28	5,47	3,76	1,41	5,23	3,66	1,53	5,14	3,62	1,58	5,00	3,56	1,63	4,68	3,42	1,75
22,0	30	6,04	3,72	1,30	5,81	3,63	1,42	5,58	3,54	1,54	5,49	3,50	1,59	5,35	3,45	1,65	4,97	3,31	1,75
24,0	32	6,27	3,61	1,30	6,04	3,53	1,42	5,81	3,45	1,55	5,72	3,41	1,60	5,58	3,36	1,66	5,17	3,22	1,75

Heating 50· Hz 220· 240· V

AFR	15,8
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	2,70	1,51	3,24	1,58	3,78	1,66	4,33	1,74	6,00	1,83	6,52	1,89	
20,0	2,53	1,55	3,07	1,62	3,62	1,70	4,16	1,78	5,80	1,87	6,32	1,93	
22,0	2,46	1,56	3,01	1,64	3,55	1,72	4,10	1,80	5,72	1,89	6,24	1,95	
24,0	2,40	1,58	2,94	1,66	3,49	1,74	4,03	1,81	5,64	1,90	5,96	1,97	
25,0	2,36	1,59	2,91	1,67	3,45	1,74	4,00	1,82	5,60	1,91	5,73	1,97	
27,0	2,30	1,61	2,84	1,68	3,39	1,76	3,93	1,84	5,27	1,93	5,27	1,99	

Symbols

- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □· mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: 5· m  
Level difference: 0·m
- The air flow rate and bypass factor are mentioned in the table.

3D110080C

**FFA60A9 / RXM60R**

Cooling 50· Hz 220· 240· V

AFR	14,5
BF	0,11

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,30	3,91	1,36	5,30	3,91	1,53	5,30	3,91	1,71	5,20	3,86	1,77	5,04	3,78	1,85	4,78	3,65	1,99
16,0	22	6,10	4,12	1,44	5,84	3,99	1,58	5,57	3,86	1,72	5,47	3,81	1,77	5,31	3,73	1,86	5,04	3,61	1,99
18,0	25	6,36	4,29	1,45	6,10	4,17	1,59	5,83	4,05	1,73	5,73	4,00	1,78	5,57	3,93	1,86	5,30	3,82	2,00
19,0	27	6,50	4,50	1,45	6,23	4,38	1,59	5,97	4,27	1,73	5,86	4,22	1,79	5,70	4,16	1,87	5,43	4,05	2,01
22,0	30	6,89	4,33	1,47	6,62	4,23	1,61	6,36	4,13	1,74	6,25	4,09	1,80	6,09	4,03	1,88	5,78	3,91	2,01
24,0	32	7,15	4,21	1,48	6,89	4,12	1,61	6,62	4,02	1,75	6,52	3,99	1,81	6,36	3,93	1,89	6,01	3,82	2,01

Heating 50· Hz 220· 240· V

AFR	14,5
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	3,39	1,65	4,08	1,74	4,76	1,82	5,44	1,91	7,24	2,01	7,87	2,07	
20,0	3,18	1,70	3,87	1,78	4,55	1,87	5,23	1,95	7,00	2,05	7,63	2,12	
22,0	3,10	1,72	3,78	1,80	4,47	1,89	5,15	1,97	6,90	2,07	7,54	2,14	
24,0	3,02	1,73	3,70	1,82	4,38	1,90	5,07	1,99	6,81	2,09	7,44	2,16	
25,0	2,97	1,74	3,66	1,83	4,34	1,91	5,03	2,00	6,76	2,10	7,39	2,17	
27,0	2,89	1,76	3,57	1,85	4,26	1,93	4,94	2,02	6,66	2,12	7,29	2,19	

Symbols

- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □· mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: 5· m  
Level difference: 0·m
- The air flow rate and bypass factor are mentioned in the table.

3D110084C

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

4

**FFA50A9 / RXM50R**

**Cooling** 50-Hz 220-240-V

AFR	12,7
BF	0,16

Indoor temperature		Outdoor temperature [°C DB]																			
EWB	EDB	20			25			30			32			35			40				
		°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	
14,0	20	4,14	3,06	1,03	4,14	3,06	1,17	4,14	3,06	1,32	4,14	3,06	1,38	4,14	3,06	1,47	4,14	3,06	1,63		
16,0	22	5,26	3,46	1,18	5,12	3,39	1,30	4,89	3,27	1,42	4,79	3,23	1,46	4,65	3,16	1,53	4,42	3,05	1,65		
18,0	25	5,58	3,64	1,20	5,35	3,53	1,31	5,12	3,42	1,43	5,02	3,37	1,47	4,88	3,31	1,54	4,65	3,21	1,65		
19,0	27	5,70	3,80	1,20	5,47	3,69	1,31	5,23	3,59	1,43	5,14	3,54	1,47	5,00	3,48	1,54	4,77	3,38	1,66		
22,0	30	6,04	3,65	1,21	5,81	3,55	1,33	5,58	3,46	1,44	5,49	3,42	1,48	5,35	3,37	1,55	5,11	3,28	1,67		
24,0	32	6,27	3,54	1,22	6,04	3,45	1,33	5,81	3,37	1,45	5,72	3,34	1,49	5,58	3,29	1,56	5,34	3,20	1,67		

**Heating** 50-Hz 220-240-V

AFR	12,7
-----	------

Indoor temperature		Outdoor temperature [°C WB]												
EDB	°C	-15		-10		-5		0		6		10		
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	
15,0	2,70	1,34	3,24	1,41	3,78	1,47	4,33	1,54	6,00	1,62	6,52	1,68		
20,0	2,53	1,37	3,07	1,44	3,62	1,51	4,16	1,58	5,80	1,66	6,32	1,72		
22,0	2,46	1,39	3,01	1,46	3,55	1,53	4,10	1,59	5,72	1,68	6,21	1,73		
24,0	2,40	1,40	2,94	1,47	3,49	1,54	4,03	1,61	5,64	1,69	5,77	1,75		
25,0	2,36	1,41	2,91	1,48	3,45	1,55	4,00	1,62	5,55	1,70	5,55	1,75		
27,0	2,30	1,43	2,84	1,50	3,39	1,56	3,93	1,63	5,10	1,71	5,10	1,77		

Symbols

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: 5 m  
Level difference: 0 m
- The air flow rate and bypass factor are mentioned in the table.

3D110085C

**FTXM50N / RXM50R**

**Cooling** 50-Hz 220-240-V

AFR	16,1
BF	0,13

Indoor temperature		Outdoor temperature [°C DB]																			
EWB	EDB	20			25			30			32			35			40				
		°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	
14,0	20	4,11	3,04	1,07	3,88	2,93	1,14	3,65	2,83	1,21	3,55	2,78	1,28	3,41	2,72	1,34	3,18	2,62	1,44		
16,0	22	5,26	3,46	1,08	5,03	3,35	1,15	4,80	3,25	1,22	4,70	3,20	1,29	4,56	3,14	1,35	4,33	3,04	1,44		
18,0	25	5,58	3,66	1,08	5,35	3,55	1,15	5,12	3,45	1,22	5,02	3,40	1,29	4,88	3,34	1,36	4,65	3,24	1,45		
19,0	27	5,70	3,83	1,09	5,47	3,72	1,16	5,23	3,62	1,23	5,14	3,58	1,30	5,00	3,52	1,36	4,77	3,42	1,45		
22,0	30	6,04	3,68	1,09	5,81	3,59	1,16	5,58	3,50	1,23	5,49	3,46	1,30	5,35	3,40	1,37	5,11	3,32	1,46		
24,0	32	6,27	3,57	1,09	6,04	3,49	1,16	5,81	3,40	1,23	5,72	3,37	1,30	5,58	3,32	1,38	5,34	3,24	1,47		

**Heating** 50-Hz 220-240-V

AFR	17,1
-----	------

Indoor temperature		Outdoor temperature [°C WB]												
EDB	°C	-15		-10		-5		0		6		10		
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	
15,0	2,76	0,93	3,32	0,98	3,88	1,03	4,43	1,35	6,00	1,42	6,52	1,47		
20,0	2,59	0,96	3,15	1,01	3,71	1,05	4,26	1,38	5,80	1,45	6,32	1,50		
22,0	2,52	0,97	3,08	1,02	3,64	1,07	4,19	1,39	5,72	1,46	6,24	1,51		
24,0	2,46	0,98	3,01	1,03	3,57	1,08	4,12	1,40	5,64	1,48	6,16	1,52		
25,0	2,42	0,99	2,98	1,03	3,54	1,08	4,09	1,41	5,60	1,48	6,12	1,53		
27,0	2,35	1,00	2,91	1,04	3,47	1,09	4,02	1,42	5,52	1,50	6,04	1,54		

Symbols

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: 5 m  
Level difference: 0 m
- The air flow rate and bypass factor are mentioned in the table.

3D120632A



# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

**FHA50A9 / RXM50R**

Cooling -50·Hz -220-240·V

AFR	15,0
BF	0,18

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC
14,0	20	5,05	3,73	1,18	4,89	3,65	1,31	4,66	3,53	1,43	4,56	3,49	1,47	4,42	3,42	1,54	4,19	3,30	1,66
16,0	22	5,35	3,70	1,20	5,12	3,59	1,32	4,89	3,48	1,43	4,79	3,44	1,48	4,65	3,37	1,55	4,42	3,27	1,66
18,0	25	5,58	3,87	1,21	5,35	3,77	1,32	5,12	3,66	1,44	5,02	3,62	1,49	4,88	3,56	1,55	4,65	3,47	1,67
19,0	27	5,70	4,08	1,21	5,47	3,98	1,33	5,23	3,88	1,44	5,14	3,84	1,49	5,00	3,78	1,56	4,77	3,69	1,67
22,0	30	6,04	3,93	1,22	5,81	3,84	1,34	5,58	3,75	1,45	5,49	3,72	1,50	5,35	3,67	1,57	5,11	3,58	1,68
24,0	32	6,27	3,82	1,23	6,04	3,74	1,34	5,81	3,66	1,46	5,72	3,63	1,51	5,58	3,59	1,58	5,34	3,51	1,69

Heating -50·Hz -220-240·V

AFR	15,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	2,79	1,44	3,35	1,51	3,91	1,59	4,48	1,66	6,21	1,75	6,75	1,81	
20,0	2,62	1,48	3,18	1,56	3,74	1,63	4,31	1,70	6,00	1,79	6,54	1,85	
22,0	2,55	1,50	3,11	1,57	3,67	1,64	4,24	1,72	5,92	1,81	6,46	1,87	
24,0	2,48	1,51	3,04	1,59	3,61	1,66	4,17	1,73	5,83	1,82	6,38	1,88	
25,0	2,45	1,52	3,01	1,60	3,57	1,67	4,13	1,74	5,79	1,83	6,33	1,89	
27,0	2,38	1,54	2,94	1,61	3,50	1,69	4,06	1,76	5,71	1,85	6,25	1,91	

Symbols

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5·m  
Level difference: ·0·m
- The air flow rate and bypass factor are mentioned in the table.

3D110087C

**FNA50A9 / RXM50R**

Cooling -50·Hz -220-240·V

AFR	16,0
BF	0,12

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC
14,0	20	5,12	3,94	1,13	4,89	3,83	1,24	4,66	3,71	1,35	4,56	3,67	1,40	4,42	3,60	1,46	4,19	3,49	1,57
16,0	22	5,35	3,87	1,14	5,12	3,77	1,25	4,89	3,66	1,36	4,79	3,62	1,40	4,65	3,56	1,47	4,42	3,45	1,58
18,0	25	5,58	4,08	1,15	5,35	3,98	1,26	5,12	3,88	1,37	5,02	3,84	1,41	4,88	3,78	1,48	4,65	3,69	1,59
19,0	27	5,70	4,32	1,15	5,47	4,22	1,26	5,23	4,13	1,37	5,14	4,09	1,41	5,00	4,04	1,48	4,77	3,94	1,59
22,0	30	6,04	4,17	1,16	5,81	4,09	1,27	5,58	4,00	1,38	5,49	3,97	1,42	5,35	3,92	1,49	5,11	3,84	1,60
24,0	32	6,27	4,07	1,17	6,04	3,99	1,28	5,81	3,92	1,39	5,72	3,89	1,43	5,58	3,84	1,50	5,34	3,77	1,60

Heating -50·Hz -220-240·V

AFR	16,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	2,70	1,40	3,24	1,47	3,78	1,54	4,33	1,61	6,00	1,70	6,52	1,75	
20,0	2,53	1,44	3,07	1,51	3,62	1,58	4,16	1,65	5,80	1,74	6,32	1,79	
22,0	2,46	1,45	3,01	1,52	3,55	1,59	4,10	1,67	5,72	1,75	6,24	1,81	
24,0	2,40	1,47	2,94	1,54	3,49	1,61	4,03	1,68	5,64	1,77	6,16	1,83	
25,0	2,36	1,48	2,91	1,55	3,45	1,62	4,00	1,69	5,60	1,78	6,12	1,83	
27,0	2,30	1,49	2,84	1,56	3,39	1,63	3,93	1,71	5,52	1,79	6,04	1,85	

Symbols

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5·m  
Level difference: ·0·m
- The air flow rate and bypass factor are mentioned in the table.

3D110091C

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

4

**FVXM50F / RXM50R**

Cooling -50· Hz -220 -240· V

AFR	10,1
BF	0,13

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	3,82	2,82	0,98	3,82	2,82	1,12	3,82	2,82	1,27	3,82	2,82	1,33	3,82	2,82	1,42	3,82	2,82	1,57
16,0	22	4,86	3,20	1,12	4,86	3,20	1,27	4,86	3,20	1,42	4,79	3,16	1,47	4,65	3,09	1,54	4,42	2,98	1,65
18,0	25	5,58	3,56	1,20	5,35	3,45	1,32	5,12	3,34	1,43	5,02	3,29	1,48	4,88	3,23	1,54	4,65	3,12	1,66
19,0	27	5,70	3,71	1,20	5,47	3,60	1,32	5,23	3,49	1,43	5,14	3,45	1,48	5,00	3,39	1,55	4,77	3,28	1,66
22,0	30	6,04	3,56	1,21	5,81	3,46	1,33	5,58	3,37	1,44	5,49	3,33	1,49	5,35	3,27	1,56	5,11	3,18	1,67
24,0	32	6,27	3,45	1,22	6,04	3,36	1,34	5,81	3,27	1,45	5,72	3,24	1,50	5,58	3,19	1,57	5,34	3,10	1,68

Heating -50· Hz -220 -240· V

AFR	11,8
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	2,70	1,29	3,24	1,35	3,78	1,42	4,33	1,48	6,00	1,56	6,52	1,61	
20,0	2,53	1,32	3,07	1,39	3,62	1,45	4,16	1,52	5,80	1,60	6,32	1,65	
22,0	2,46	1,34	3,01	1,40	3,55	1,47	4,10	1,53	5,72	1,61	6,24	1,66	
24,0	2,40	1,35	2,94	1,42	3,49	1,48	4,03	1,55	5,64	1,63	6,16	1,68	
25,0	2,36	1,36	2,91	1,42	3,45	1,49	4,00	1,55	5,57	1,63	6,09	1,69	
27,0	2,30	1,37	2,84	1,44	3,39	1,50	3,93	1,57	5,13	1,65	5,13	1,70	

Symbols

- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: 5· m  
Level difference: 0· m
- The air flow rate and bypass factor are mentioned in the table.

3D110095C

**FHA60A9 / RXM60R**

Cooling -50· Hz -220 -240· V

AFR	19,5
BF	0,2

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,84	4,45	1,33	5,57	4,32	1,46	5,31	4,19	1,59	5,20	4,13	1,64	5,04	4,06	1,71	4,78	3,93	1,84
16,0	22	6,10	4,37	1,34	5,84	4,25	1,47	5,57	4,13	1,59	5,47	4,08	1,64	5,31	4,01	1,72	5,04	3,89	1,85
18,0	25	6,36	4,59	1,34	6,10	4,48	1,47	5,83	4,37	1,60	5,73	4,32	1,65	5,57	4,26	1,73	5,30	4,15	1,86
19,0	27	6,50	4,86	1,35	6,23	4,75	1,48	5,97	4,64	1,60	5,86	4,60	1,66	5,70	4,54	1,73	5,43	4,43	1,86
22,0	30	6,89	4,69	1,36	6,62	4,60	1,49	6,36	4,50	1,62	6,25	4,46	1,67	6,09	4,41	1,74	5,83	4,31	1,87
24,0	32	7,15	4,57	1,37	6,89	4,49	1,50	6,62	4,40	1,62	6,52	4,36	1,68	6,36	4,31	1,75	6,09	4,23	1,88

Heating -50· Hz -220 -240· V

AFR	19,5
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	3,49	1,74	4,19	1,83	4,90	1,92	5,60	2,01	7,45	2,12	8,10	2,19	
20,0	3,27	1,79	3,98	1,88	4,68	1,97	5,38	2,06	7,20	2,17	7,85	2,24	
22,0	3,19	1,81	3,89	1,90	4,59	1,99	5,30	2,08	7,10	2,19	7,75	2,26	
24,0	3,10	1,83	3,81	1,92	4,51	2,01	5,21	2,10	7,00	2,21	7,65	2,28	
25,0	3,06	1,84	3,76	1,93	4,47	2,02	5,17	2,11	6,95	2,22	7,60	2,29	
27,0	2,97	1,86	3,68	1,95	4,38	2,04	5,08	2,13	6,85	2,24	7,50	2,31	

Symbols

- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: 5· m  
Level difference: 0· m
- The air flow rate and bypass factor are mentioned in the table.

3D110088C

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

**FTXM60N / RXM60R**  
**FTXM60R / RXM60R**

Cooling 50·Hz 220-240·V

AFR	17,1
BF	0,17

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,10	3,76	0,19	4,82	3,63	0,31	4,55	3,51	0,80	4,38	3,45	1,66	4,26	3,38	1,75	4,09	3,26	1,88
16,0	22	6,31	4,18	0,20	6,04	4,05	0,33	5,76	3,93	0,81	5,64	3,87	1,67	5,47	3,80	1,76	5,30	3,68	1,88
18,0	25	6,70	4,39	0,20	6,42	4,26	0,34	6,14	4,14	0,82	6,02	4,08	1,67	5,86	4,00	1,77	5,58	3,88	1,89
19,0	27	6,84	4,59	0,22	6,56	4,46	0,34	6,28	4,34	0,82	6,17	4,29	1,69	6,00	4,22	1,77	5,72	4,10	1,89
22,0	30	7,25	4,41	0,22	6,97	4,30	0,34	6,70	4,20	0,83	6,59	4,15	1,70	6,42	4,08	1,78	6,13	3,98	1,90
24,0	32	7,52	4,28	0,22	7,25	4,18	0,34	6,97	4,08	0,83	6,86	4,04	1,70	6,70	3,98	1,79	6,41	3,88	1,92

Heating 50·Hz 220-240·V

AFR	17,7
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	3,33	1,24	4,01	1,31	4,68	1,38	6,29	1,81	7,24	1,90	7,87	1,97	
20,0	3,13	1,29	3,80	1,35	4,48	1,41	6,05	1,85	7,00	1,94	7,63	2,01	
22,0	3,04	1,30	3,72	1,37	4,39	1,43	5,95	1,86	6,90	1,95	7,53	2,02	
24,0	2,97	1,31	3,63	1,38	4,31	1,45	5,85	1,87	6,81	1,98	7,43	2,03	
25,0	2,92	1,33	3,60	1,38	4,27	1,45	5,80	1,89	6,76	1,98	7,39	2,05	
27,0	2,84	1,34	3,51	1,39	4,19	1,46	5,71	1,90	6,66	2,01	7,29	2,06	

Symbols

- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: 5·m  
Level difference: 0·m
- The air flow rate and bypass factor are mentioned in the table.

3D117546B

**FTXM60R / RXM60R**

Cooling 50·Hz 220-240·V

AFR	16,22
BF	0,21

Indoor		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	6,15	4,26	1,36	5,87	4,12	1,49	5,59	3,99	1,62	5,48	3,94	1,67	5,31	3,87	1,75	5,03	3,76	1,88
16	22	6,42	4,11	1,37	6,14	3,97	1,50	5,86	3,84	1,63	5,75	3,79	1,68	5,59	3,72	1,76	5,31	3,60	1,89
18	25	6,70	4,23	1,37	6,42	4,10	1,50	6,14	3,99	1,64	6,03	3,95	1,69	5,86	3,89	1,77	5,58	3,79	1,90
19	27	6,84	4,43	1,38	6,56	4,33	1,51	6,28	4,23	1,64	6,17	4,20	1,69	6,00	4,15	1,77	5,72	4,08	1,90
22	30	7,25	4,11	1,39	6,97	4,00	1,52	6,69	3,90	1,65	6,58	3,87	1,70	6,41	3,81	1,78	6,14	3,73	1,91
24	32	7,53	3,91	1,40	7,25	3,80	1,53	6,97	3,70	1,66	6,86	3,66	1,71	6,69	3,60	1,79	6,41	3,52	1,92

Heating 50·Hz 220-240·V

AFR	15,88
-----	-------

Indoor		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		7		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	3,33	1,24	4,01	1,31	4,68	1,38	5,04	1,81	7,24	1,90	7,87	1,97	
20	3,13	1,29	3,80	1,35	4,48	1,41	4,87	1,85	7,00	1,94	7,63	2,01	
22	3,04	1,30	3,72	1,37	4,39	1,43	4,80	1,86	6,90	1,95	7,53	2,02	
24	2,97	1,31	3,63	1,38	4,31	1,45	4,73	1,87	6,81	1,98	7,43	2,03	
25	2,92	1,33	3,60	1,38	4,27	1,45	4,69	1,89	6,76	1,98	7,39	2,05	
27	2,84	1,34	3,51	1,39	4,19	1,46	4,62	1,90	6,66	2,01	7,29	2,06	

Symbols

- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: 5·m  
Level difference: 0·m
- The air flow rate and bypass factor are mentioned in the table.

3D131702

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

4

**FNA60A9 / RXM60R**

Cooling ·50· Hz ·220 - 240· V

AFR	16,0
BF	0,12

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,78	4,27	1,66	5,78	4,27	1,86	5,59	4,17	2,03	5,48	4,11	2,10	5,31	4,03	2,20	3,82	3,32	2,01
16,0	22	6,42	4,38	1,71	6,14	4,24	1,88	5,86	4,11	2,04	5,75	4,06	2,11	5,59	3,98	2,21	4,02	3,28	2,01
18,0	25	6,70	4,57	1,72	6,42	4,44	1,89	6,14	4,32	2,05	6,03	4,27	2,12	5,86	4,20	2,22	4,22	3,51	2,01
19,0	27	6,84	4,80	1,73	6,56	4,68	1,89	6,28	4,56	2,06	6,17	4,51	2,12	6,00	4,44	2,22	4,32	3,77	2,01
22,0	30	7,25	4,62	1,74	6,97	4,52	1,91	6,69	4,41	2,07	6,58	4,37	2,14	6,41	4,31	2,24	4,62	3,67	2,01
24,0	32	7,53	4,50	1,75	7,25	4,40	1,92	6,97	4,30	2,08	6,86	4,26	2,15	6,69	4,21	2,25	4,82	3,60	2,01

Heating ·50· Hz ·220 - 240· V

AFR	16,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	3,39	1,81	4,08	1,90	4,76	2,00	5,44	2,09	7,24	2,20	7,87	2,27	
20,0	3,18	1,86	3,87	1,95	4,55	2,05	5,23	2,14	7,00	2,25	7,63	2,32	
22,0	3,10	1,88	3,78	1,97	4,47	2,07	5,15	2,16	6,90	2,27	7,54	2,35	
24,0	3,02	1,90	3,70	1,99	4,38	2,09	5,07	2,18	6,81	2,29	7,44	2,37	
25,0	2,97	1,91	3,66	2,00	4,34	2,10	5,03	2,19	6,76	2,30	7,39	2,38	
27,0	2,89	1,93	3,57	2,03	4,26	2,12	4,94	2,21	6,66	2,32	7,29	2,40	

Symbols

- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0· m
- The air flow rate and bypass factor are mentioned in the table.

3D110092C

**FBA60A9 / RXM60R**

Cooling ·50· Hz ·220 - 240· V

AFR	18,0
BF	0,15

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,84	4,42	1,26	5,77	4,28	1,38	5,31	4,16	1,50	5,20	4,10	1,55	5,04	4,03	1,62	4,78	3,90	1,74
16,0	22	6,10	4,34	1,26	5,84	4,22	1,38	5,57	4,09	1,51	5,47	4,05	1,55	5,31	3,97	1,63	5,04	3,86	1,75
18,0	25	6,36	4,56	1,27	6,10	4,44	1,39	5,83	4,33	1,51	5,73	4,29	1,56	5,57	4,22	1,63	5,30	4,11	1,76
19,0	27	6,50	4,82	1,27	6,23	4,71	1,40	5,97	4,60	1,52	5,86	4,56	1,57	5,70	4,49	1,64	5,43	4,39	1,76
22,0	30	6,89	4,65	1,29	6,62	4,55	1,41	6,36	4,46	1,53	6,25	4,42	1,58	6,09	4,36	1,65	5,83	4,27	1,77
24,0	32	7,15	4,53	1,29	6,89	4,44	1,41	6,62	4,36	1,54	6,52	4,32	1,58	6,36	4,27	1,66	6,09	4,18	1,78

Heating ·50· Hz ·220 - 240· V

AFR	18,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	3,39	1,52	4,08	1,60	4,76	1,67	5,44	1,75	7,24	1,84	7,87	1,91	
20,0	3,18	1,56	3,87	1,64	4,55	1,72	5,23	1,79	7,00	1,89	7,63	1,95	
22,0	3,10	1,58	3,78	1,66	4,47	1,73	5,15	1,81	6,90	1,90	7,54	1,97	
24,0	3,02	1,59	3,70	1,67	4,38	1,75	5,07	1,83	6,81	1,92	7,44	1,98	
25,0	2,97	1,60	3,66	1,68	4,34	1,76	5,03	1,84	6,76	1,93	7,39	1,99	
27,0	2,89	1,62	3,57	1,70	4,26	1,78	4,94	1,85	6,66	1,95	7,29	2,01	

Symbols

- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: ·5· m  
Level difference: ·0· m
- The air flow rate and bypass factor are mentioned in the table.

3D110074C

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

**FDXM60F9 / RXM60R**

Cooling 50-Hz 220-240-V

AFR	16,0
BF	0,12

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,78	4,27	1,53	5,78	4,27	1,72	5,59	4,17	1,89	5,48	4,11	1,95	5,31	4,03	2,03	4,37	3,58	2,01
16,0	22	6,42	4,38	1,59	6,14	4,24	1,74	5,86	4,11	1,90	5,75	4,06	1,96	5,59	3,98	2,04	4,59	3,53	2,01
18,0	25	6,70	4,57	1,60	6,42	4,44	1,75	6,14	4,32	1,91	6,03	4,27	1,97	5,86	4,20	2,05	4,81	3,75	2,01
19,0	27	6,84	4,80	1,60	6,56	4,68	1,76	6,28	4,56	1,91	6,17	4,51	1,97	6,00	4,44	2,05	4,92	4,00	2,01
22,0	30	7,25	4,62	1,62	6,97	4,52	1,77	6,69	4,41	1,92	6,58	4,37	1,98	6,41	4,31	2,07	5,24	3,89	2,01
24,0	32	7,53	4,50	1,63	7,25	4,40	1,78	6,97	4,30	1,93	6,86	4,26	1,99	6,69	4,21	2,07	5,46	3,80	2,01

Heating 50-Hz 220-240-V

AFR	16,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]																							
EDB	°C	-15			-10			-5			0			6			10								
		TC	PI	SHC	TC	PI	SHC	TC	PI	SHC	TC	PI	SHC	TC	PI	SHC	TC	PI							
15,0	3,39	1,75	4,08	1,84	4,76	1,93	5,44	2,02	7,24	2,13	7,87	2,20	20,0	3,18	1,80	3,87	1,89	4,55	1,98	5,23	2,07	7,00	2,18	7,63	2,25
22,0	3,10	1,82	3,78	1,91	4,47	2,00	5,15	2,09	6,90	2,20	7,54	2,27	24,0	3,02	1,84	3,70	1,93	4,38	2,02	5,07	2,11	6,81	2,22	7,44	2,29
25,0	2,97	1,85	3,66	1,94	4,34	2,03	5,03	2,12	6,76	2,23	7,39	2,30	27,0	2,89	1,87	3,57	1,96	4,26	2,05	4,94	2,14	6,66	2,25	7,29	2,32

Symbols

- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: 5·m  
Level difference: 0·m
- The air flow rate and bypass factor are mentioned in the table.

3D110081C

**FCAG60B / RXM60R**

Cooling 50-Hz 220-240-V

AFR	13,6
BF	0,2

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	4,47	3,30	1,12	4,47	3,30	1,28	4,47	3,30	1,44	4,47	3,30	1,51	4,47	3,30	1,61	4,47	3,30	1,78
16,0	22	5,68	3,73	1,27	5,68	3,73	1,43	5,57	3,68	1,58	5,47	3,63	1,63	5,31	3,55	1,71	5,04	3,42	1,84
18,0	25	6,36	4,09	1,34	6,10	3,96	1,16	5,83	3,83	1,59	5,73	3,78	1,64	5,57	3,71	1,72	5,30	3,59	1,85
19,0	27	6,50	4,26	1,34	6,23	4,14	1,47	5,97	4,01	1,59	5,86	3,97	1,65	5,70	3,89	1,72	5,43	3,78	1,85
22,0	30	6,89	4,09	1,35	6,62	3,98	1,48	6,36	3,87	1,61	6,25	3,83	1,66	6,09	3,76	1,73	5,83	3,66	1,86
24,0	32	7,15	3,96	1,36	6,89	3,86	1,49	6,62	3,76	1,61	6,52	3,73	1,66	6,36	3,67	1,74	6,09	3,57	1,87

Heating 50-Hz 220-240-V

AFR	13,6
-----	------

Indoor temperature		Outdoor temperature [°C WB]																							
EDB	°C	-15			-10			-5			0			6			10								
		TC	PI	SHC	TC	PI	SHC	TC	PI	SHC	TC	PI	SHC	TC	PI	SHC	TC	PI							
15,0	3,39	1,67	4,08	1,75	4,76	1,84	5,44	1,92	7,24	2,02	7,87	2,09	20,0	3,18	1,71	3,87	1,80	4,55	1,88	5,23	1,97	7,00	2,07	7,63	2,14
22,0	3,10	1,73	3,78	1,82	4,47	1,90	5,15	1,99	6,90	2,09	7,54	2,16	24,0	3,02	1,75	3,70	1,84	4,38	1,92	5,07	2,01	6,81	2,11	7,38	2,18
25,0	2,97	1,76	3,66	1,84	4,34	1,93	5,03	2,02	6,76	2,12	7,13	2,19	27,0	2,89	1,78	3,57	1,86	4,26	1,95	4,94	2,03	6,64	2,14	7,29	2,20

Symbols

- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:  
Corresponding refrigerant piping length: 5·m  
Level difference: 0·m
- The air flow rate and bypass factor are mentioned in the table.

3D110077D

# 4 Capacity tables

## 4 - 1 Cooling/Heating Capacity Tables

4

**FTXM71R / RXM71R**

**Cooling**

-50-Hz · 220-240-V

AFR	15,95
BF	0,06

Indoor		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	7,27	5,06	1,80	6,94	4,90	1,97	6,61	4,74	2,14	6,48	4,69	2,21	6,28	4,61	2,32	5,95	4,48	2,49
16	22	7,60	4,88	1,81	7,27	4,72	1,98	6,94	4,57	2,15	6,81	4,51	2,22	6,61	4,42	2,33	6,28	4,29	2,50
18	25	7,93	5,02	1,82	7,60	4,88	1,99	7,27	4,75	2,16	7,13	4,70	2,23	6,94	4,63	2,34	6,61	4,52	2,51
19	27	8,09	5,28	1,82	7,76	5,16	2,00	7,43	5,05	2,17	7,30	5,01	2,24	7,10	4,95	2,34	6,77	4,88	2,52
22	30	8,58	4,89	1,84	8,25	4,76	2,01	7,92	4,65	2,19	7,79	4,60	2,25	7,59	4,54	2,36	7,26	4,45	2,53
24	32	8,91	4,64	1,85	8,58	4,52	2,02	8,25	4,40	2,20	8,12	4,35	2,27	7,92	4,29	2,37	7,59	4,19	2,54

**Heating**

-50-Hz · 220-240-V

AFR	17,35
-----	-------

Indoor		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		7		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	4,59	1,77	5,52	1,85	6,45	1,92	6,63	2,00	8,50	2,53	9,22	2,60	
20	4,31	1,81	5,24	1,88	6,16	1,95	6,38	2,07	8,20	2,57	8,94	2,64	
22	4,20	1,83	5,12	1,90	6,05	1,98	6,28	2,08	8,09	2,60	8,83	2,67	
24	4,08	1,84	5,01	1,92	5,94	1,99	6,17	2,11	7,97	2,61	8,71	2,68	
25	4,03	1,85	4,95	1,93	5,88	2,01	6,13	2,12	7,92	2,63	8,66	2,70	
27	3,91	1,86	4,84	1,94	5,77	2,01	6,02	2,14	7,80	2,64	8,54	2,71	

**Symbols**

- AFR: Air flow rate [m<sup>3</sup>/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Total capacity [kW]
- SHC: Sensible heat capacity [kW]
- PI: Power input [kW]

**Notes**


- 1) The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- 2) On the figure the  mark shows the rated capacity and rated coefficient of the power input.
- 3) The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- 4) In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- 5) The capacities are based on the following conditions:  
 Corresponding refrigerant piping length: ·5· m  
 Level difference: ·0·m
- 6) The air flow rate and bypass factor are mentioned in the table.

3D131703

# 5 Dimensional drawings


## 5 - 1 Dimensional Drawings

### RXM20-35R

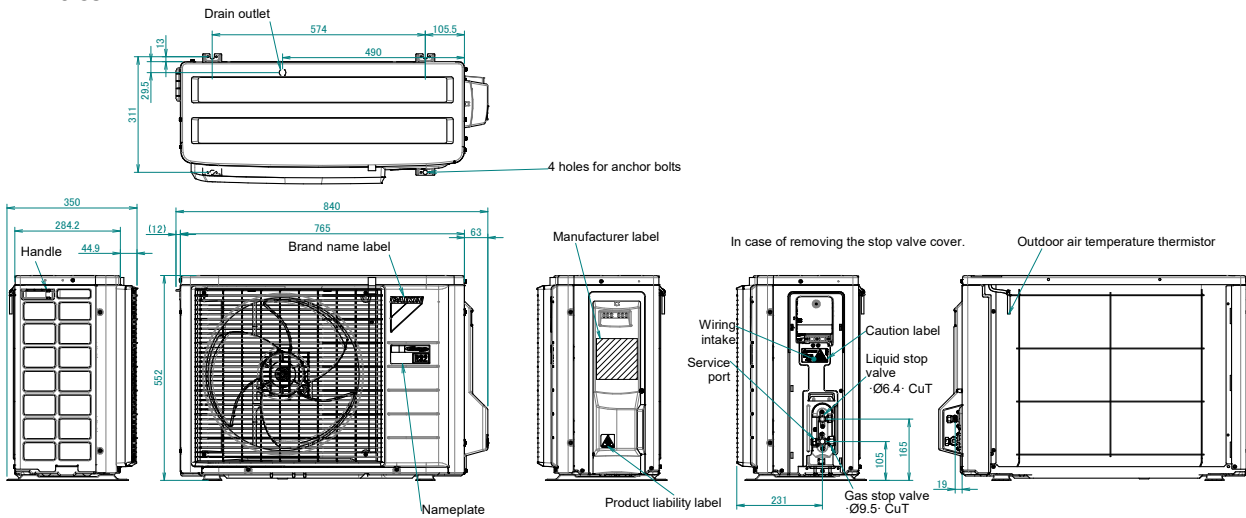



**Minimum space for air passage**

Wall height on air outlet side < 1200 mm

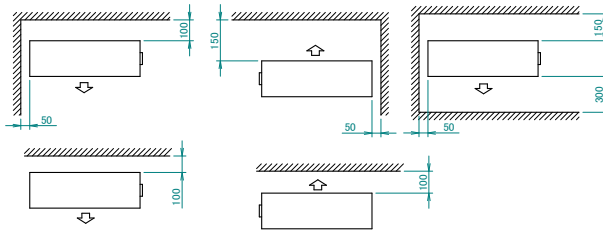


3D119881A

### RXM42-60R

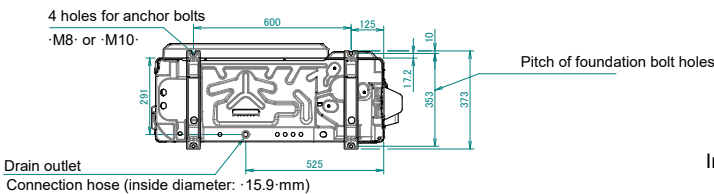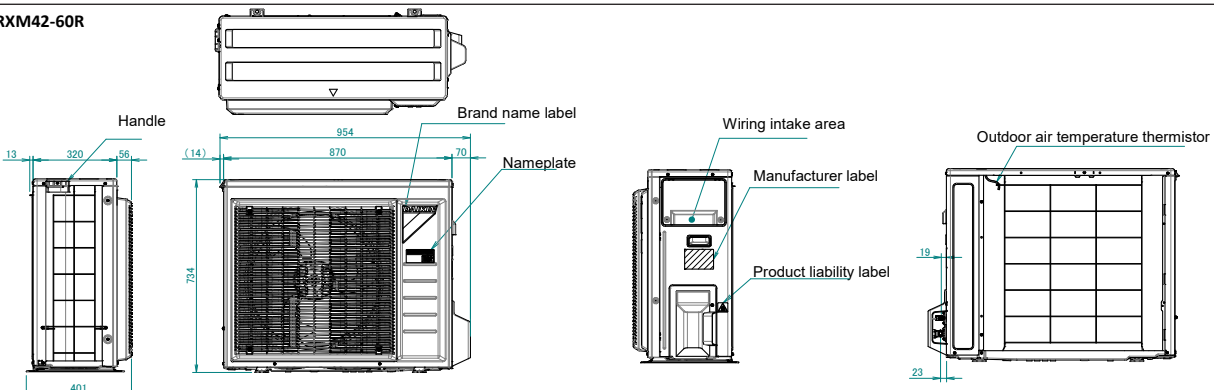


**Minimum space for air passage**

Wall height on air outlet side < 1200 mm

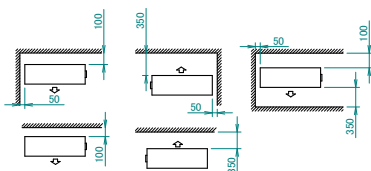

In case of removing the stop valve cover.

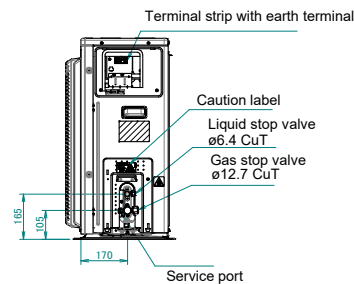


3D114108B

# 5 Dimensional drawings

## 5 - 1 Dimensional Drawings



5

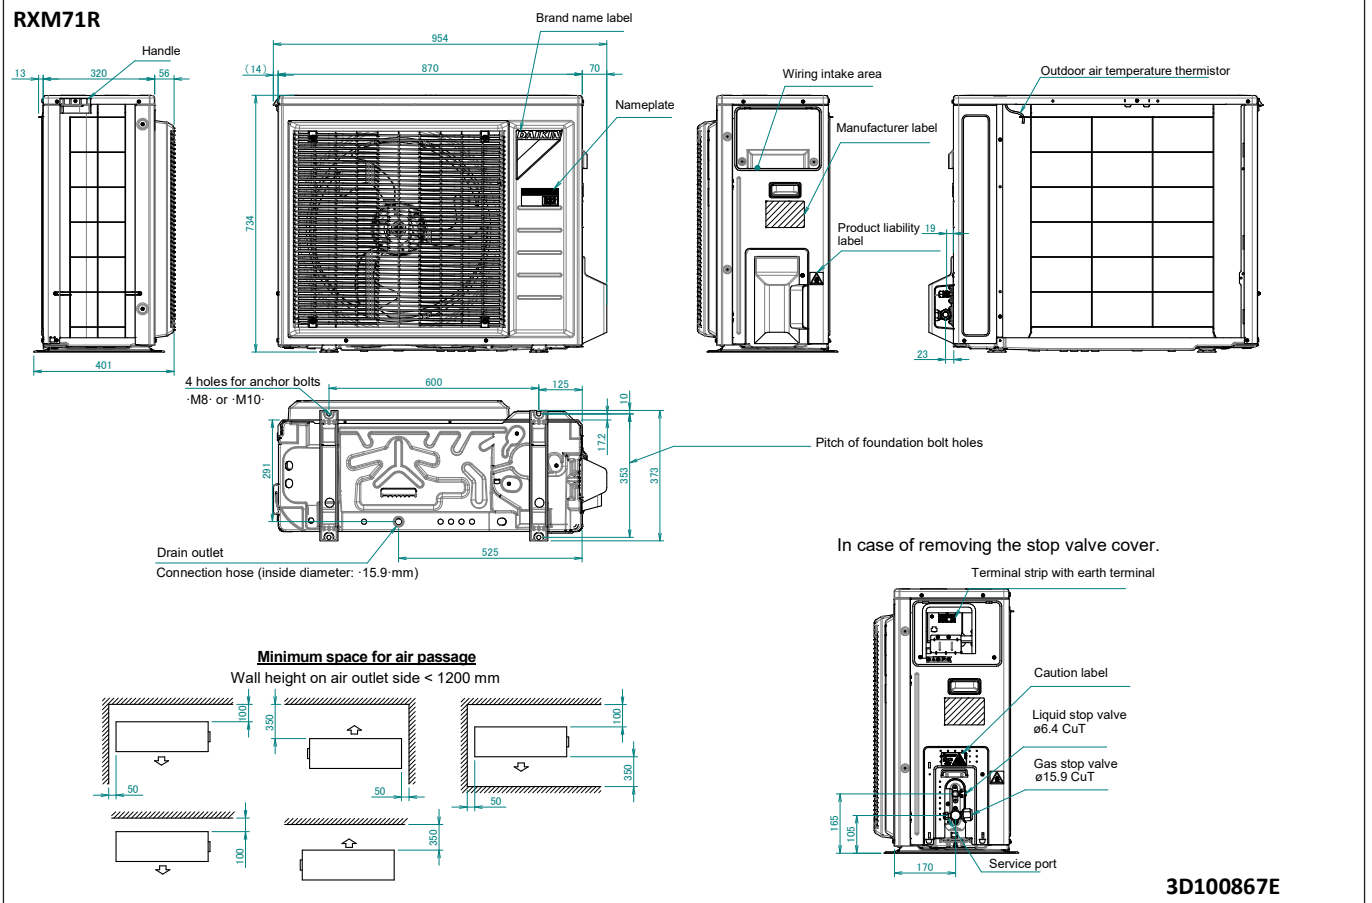



# 6 Centre of gravity

## 6 - 1 Centre of Gravity

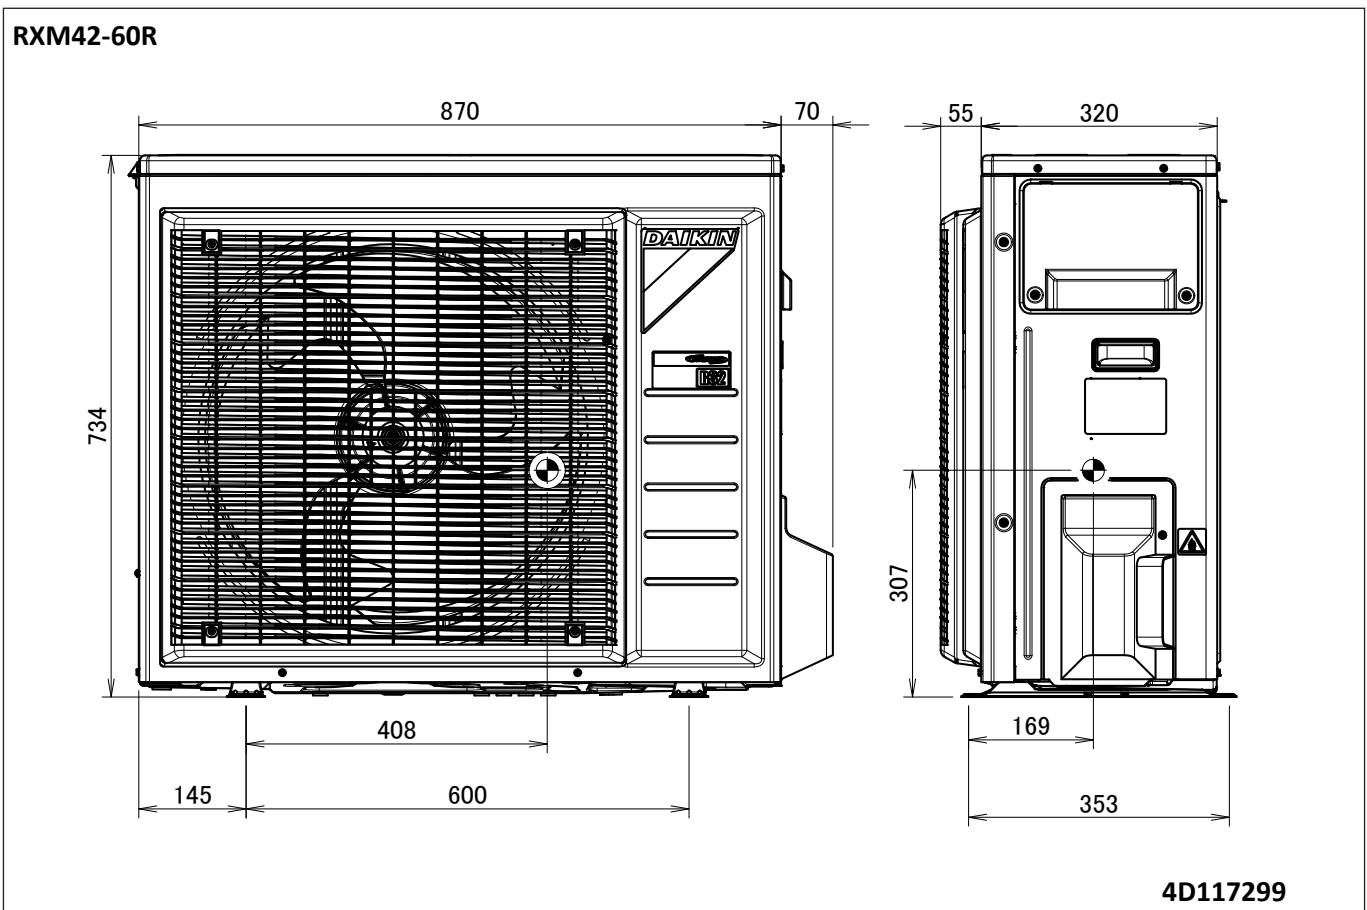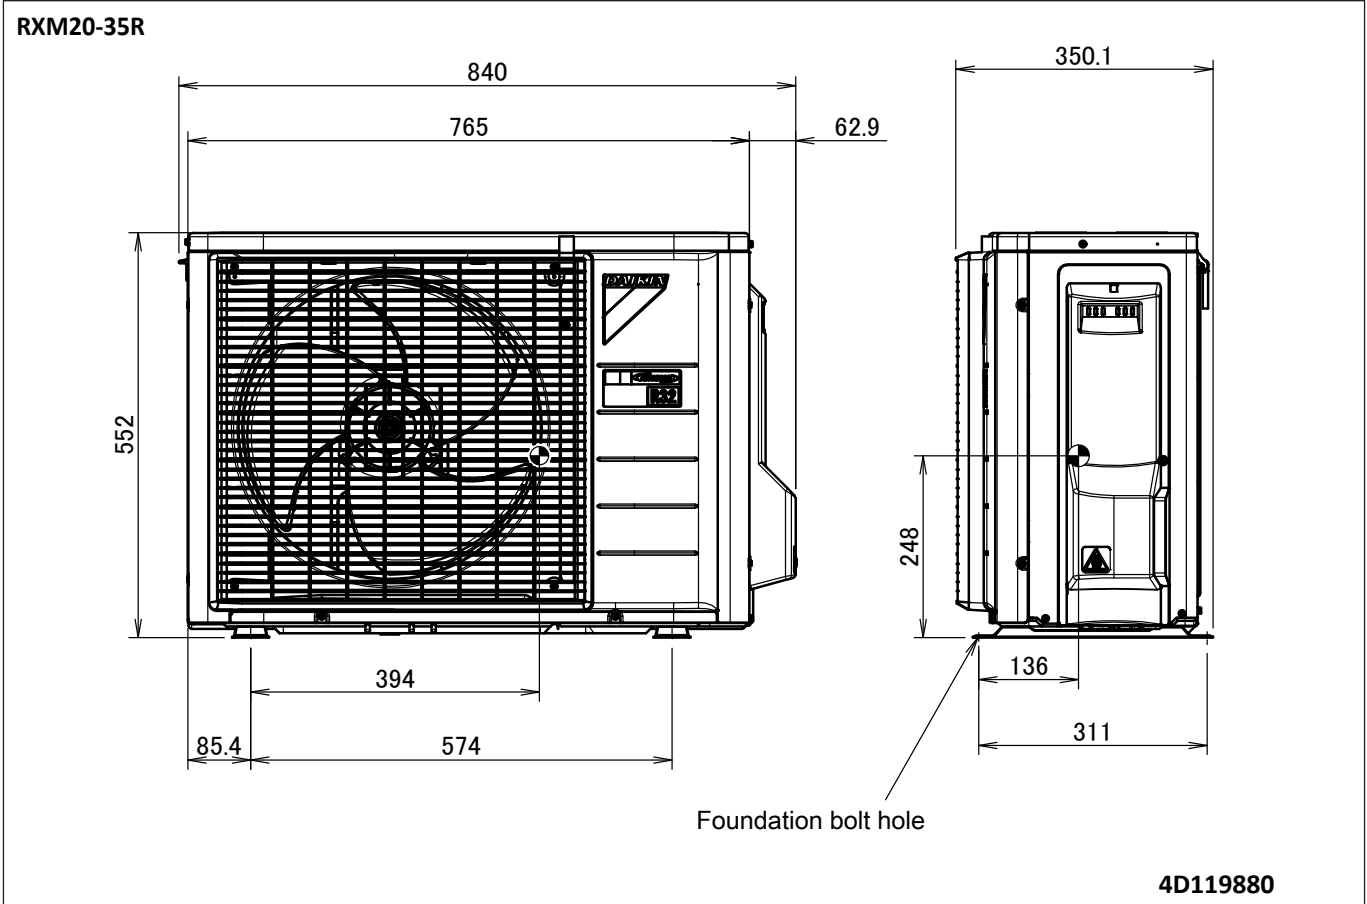


# 6 Centre of gravity

## 6 - 1 Centre of Gravity

RXM71R



6

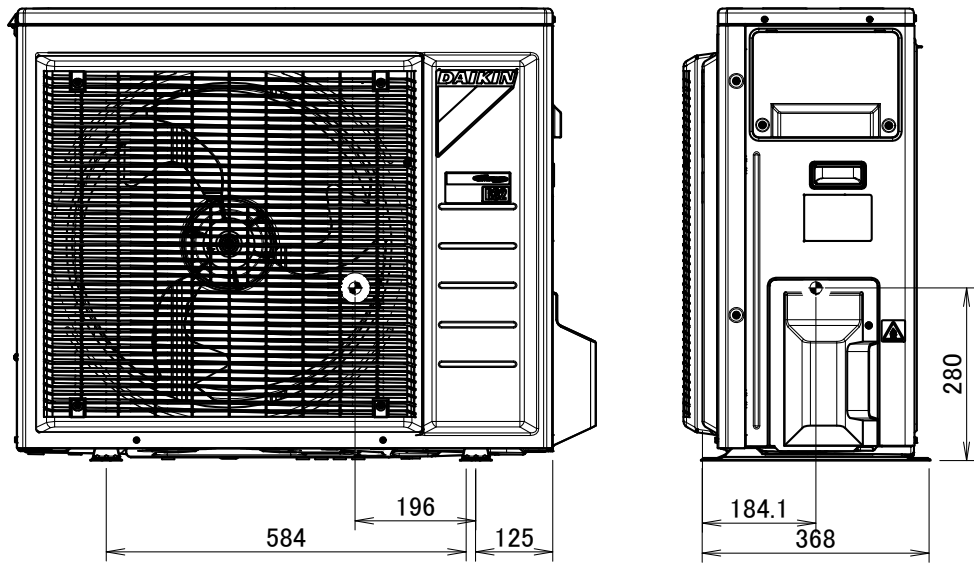

4D100855B

# 7 Piping diagrams



## 7 - 1 Piping Diagrams

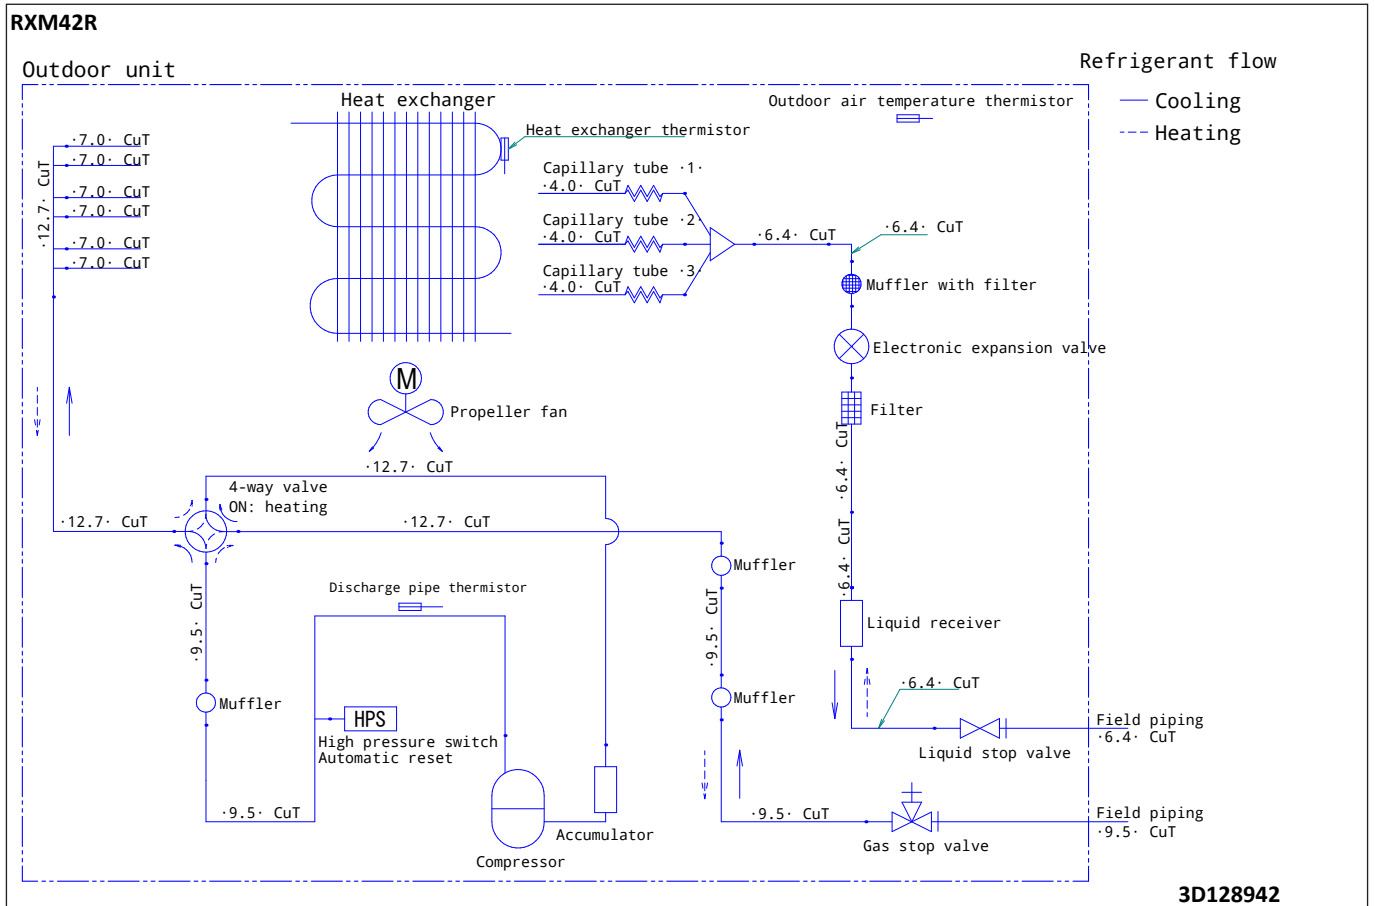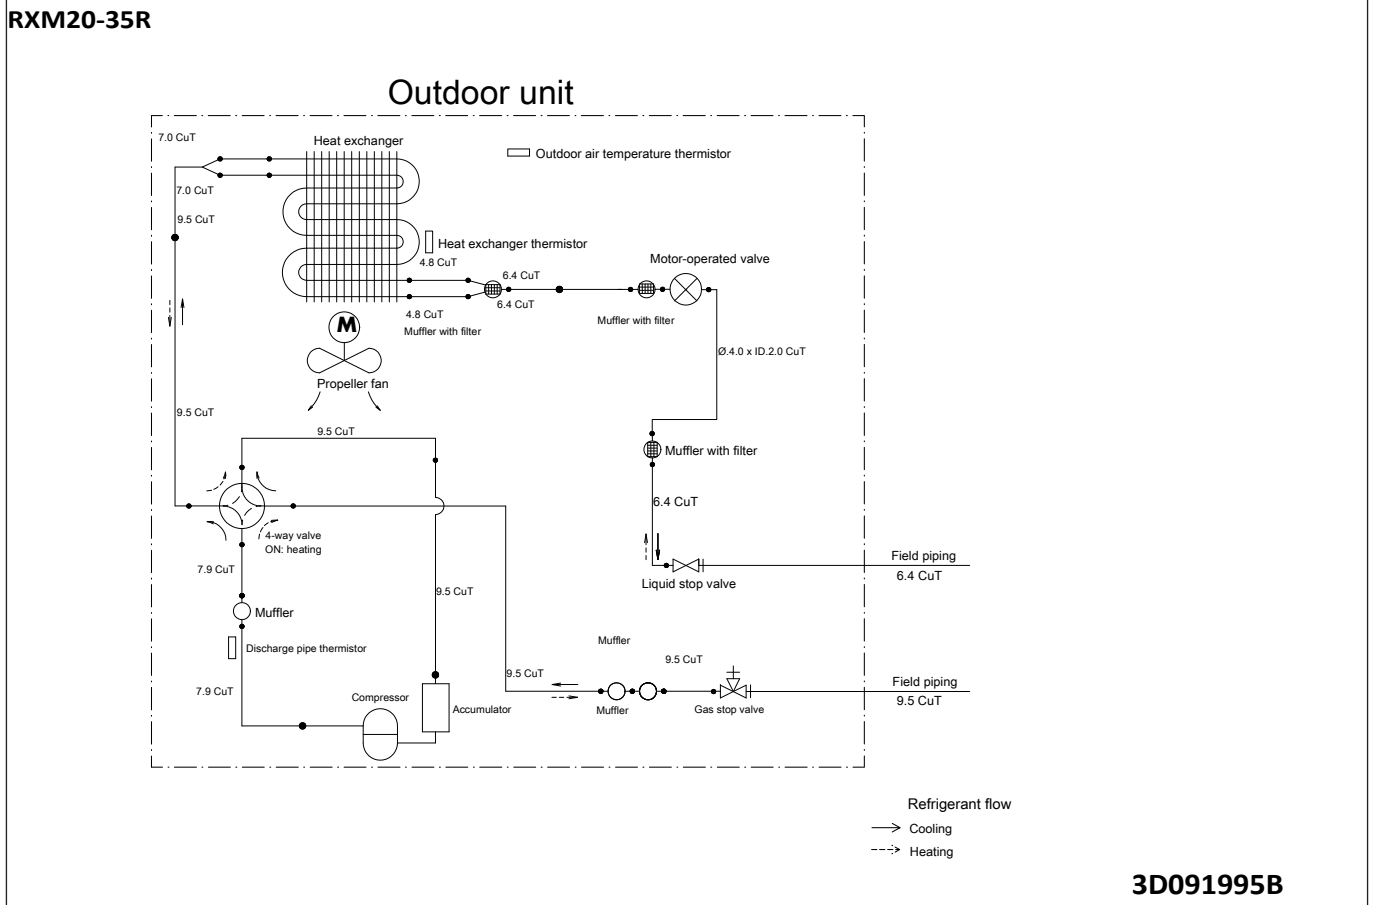

# 7 Piping diagrams

## 7-1 Piping Diagrams


7

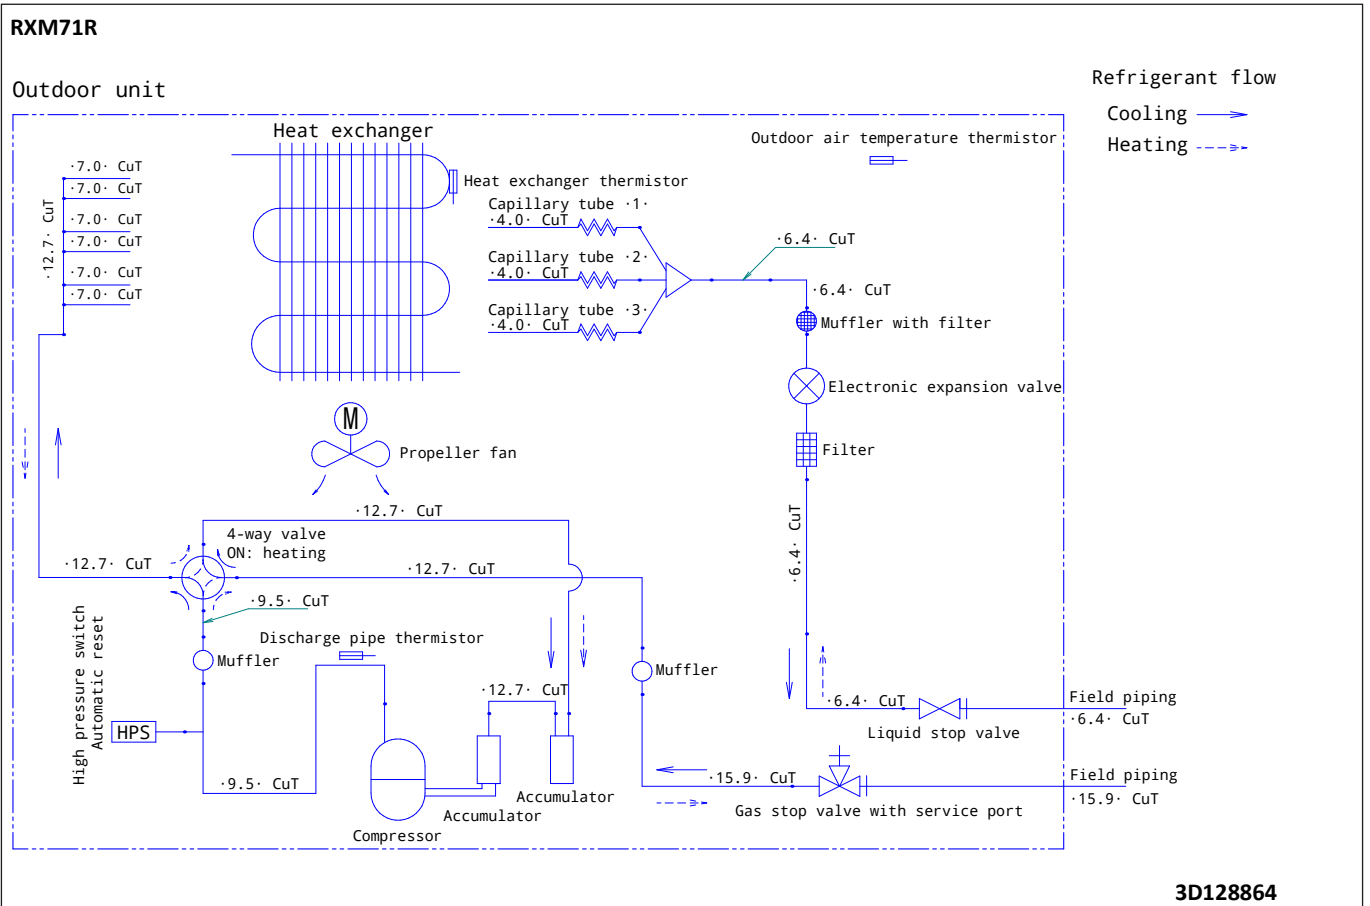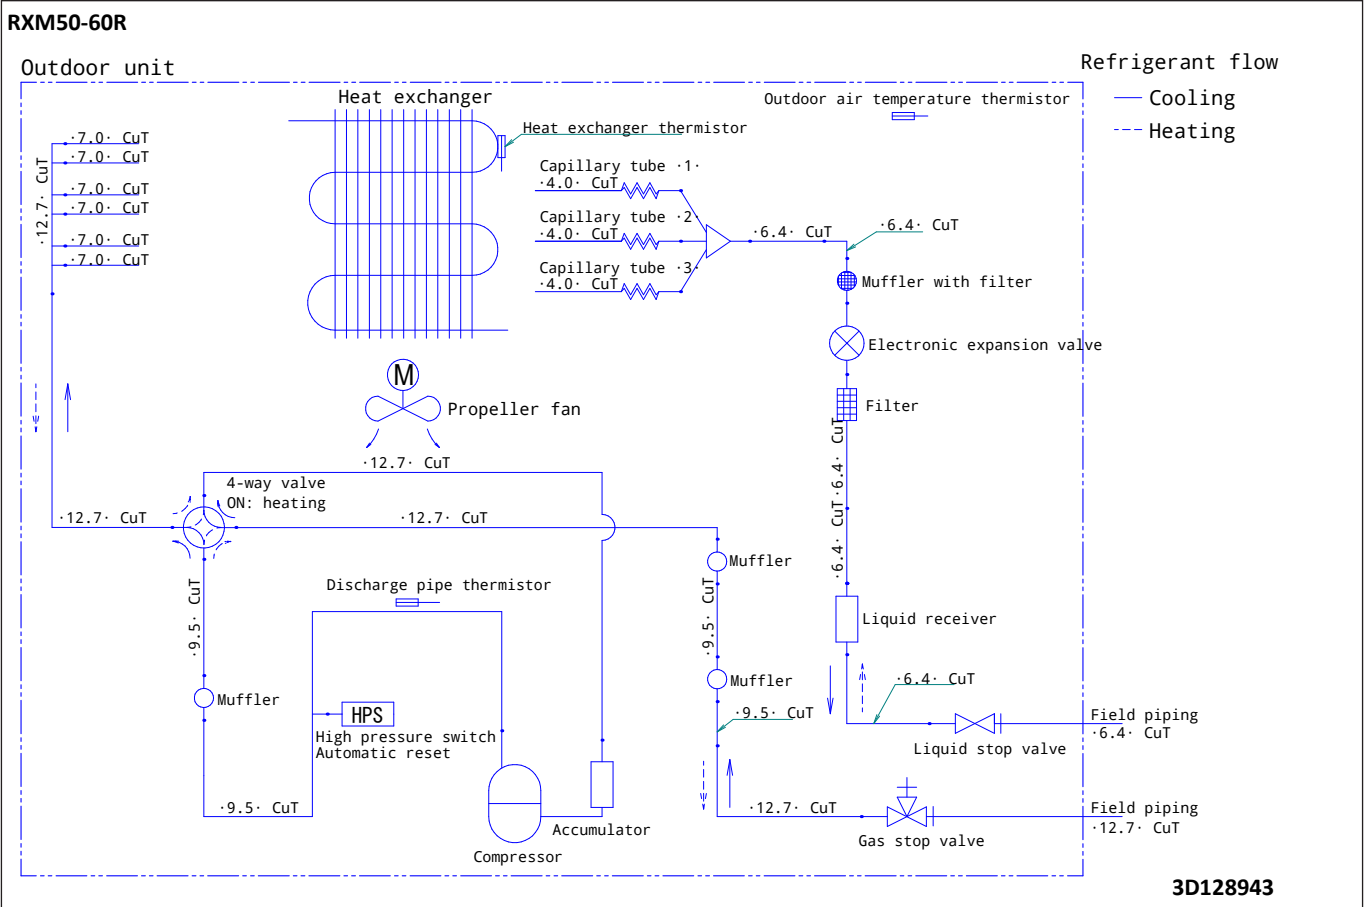

# 8 Wiring diagrams

## 8 - 1 Wiring Diagrams - Single Phase

### RXM20-35R

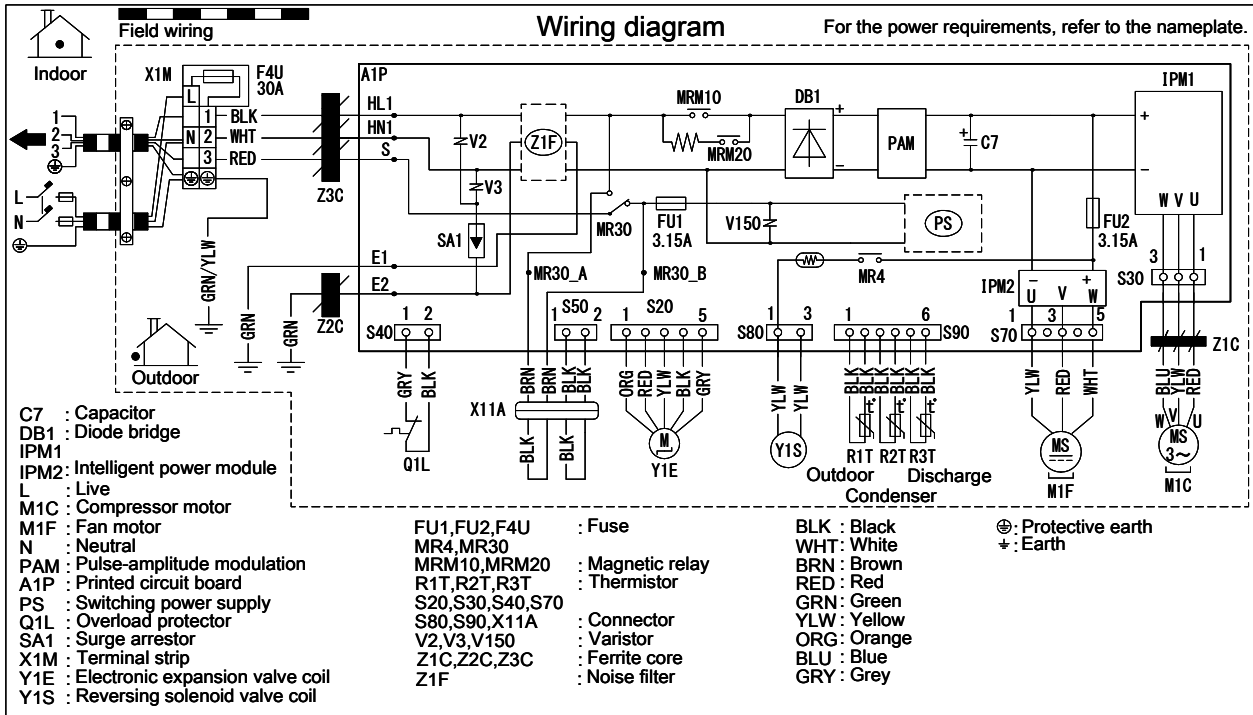


**Notes**

Size: 140 x 80

Refer to purchasing specification AS303002, unless otherwise specified.

4D120154

### RXM42R

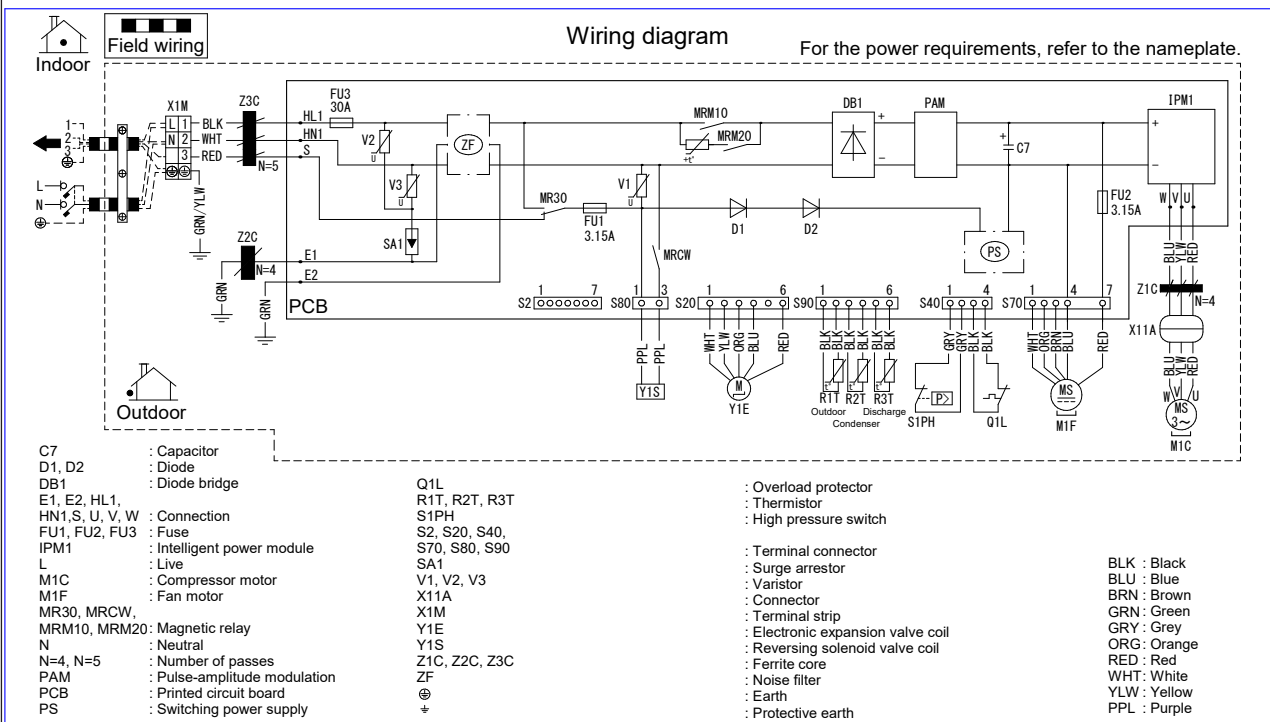


3D130905A

# 8 Wiring diagrams

## 8 - 1 Wiring Diagrams - Single Phase


8

RXM50-60R

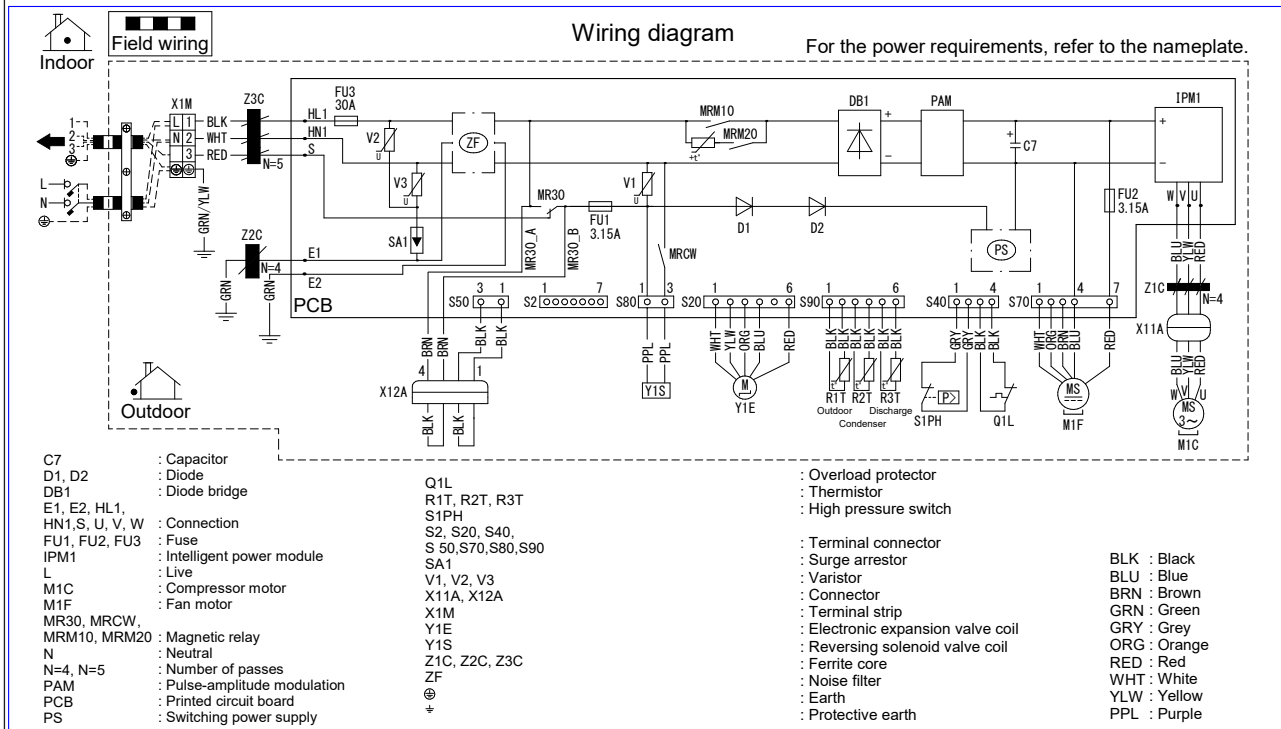

3D130906A

RXM71R

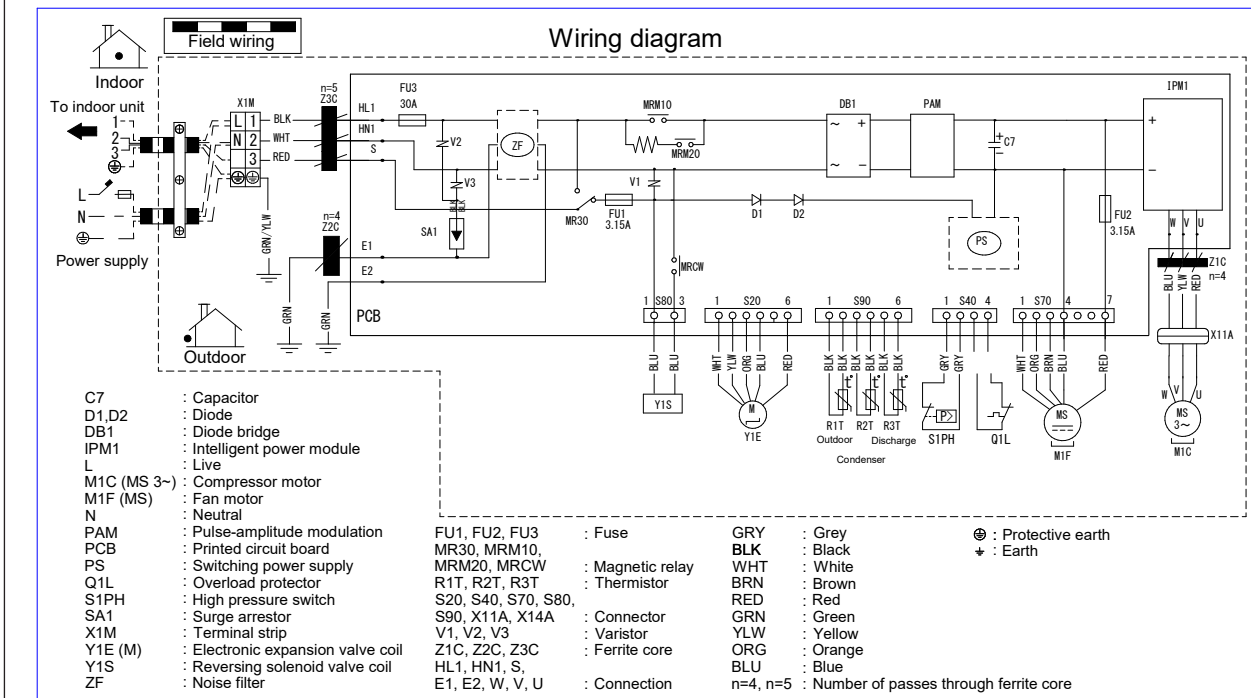


3D130907A

# 9 Sound data

## 9 - 1 Sound Pressure Spectrum

### RXM20R

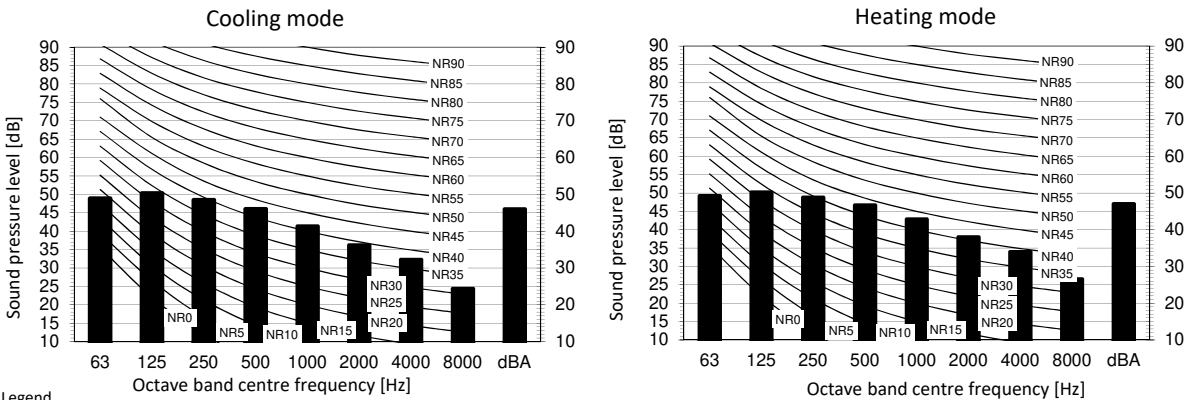


**Legend**

dBA = A-weighted sound pressure level (A scale according to IEC).

- A Scale
- B  Fan speed: High

**Location of microphone**



Cooling		Total dB
A	B	
dBA		46


Heating		Total dB
A	B	
dBA		47

**Notes**

- 1 Background noise already taken into account.
- 2 Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard
- 3 Operating noise varies depending on operation and ambient conditions.
- 4 The operation noise measuring method is in accordance with JISC9612.
- 5 Measuring location: anechoic chamber

3D110121A

### RXM25R

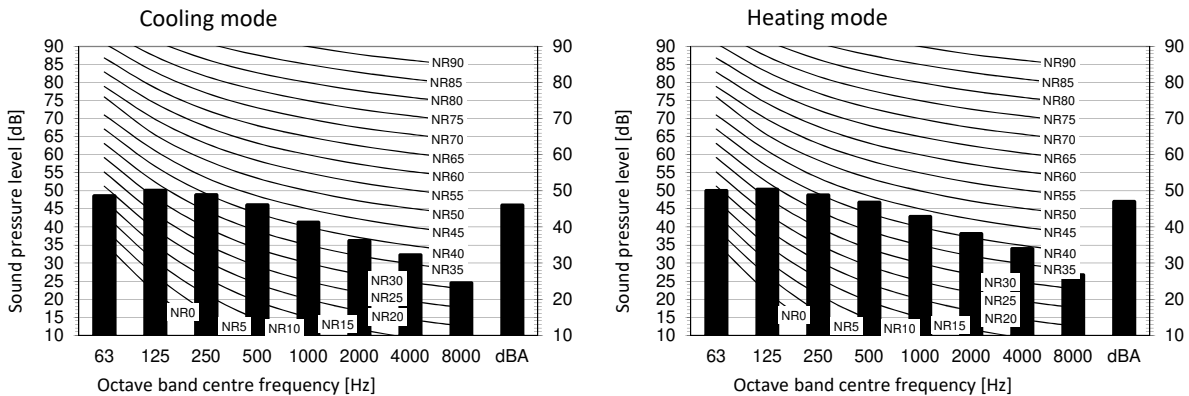


**Legend**

dBA = A-weighted sound pressure level (A scale according to IEC).

- A Scale
- B  Fan speed: High

**Location of microphone**



**Notes**

- 1 Background noise already taken into account.
- 2 Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard
- 3 Operating noise varies depending on operation and ambient conditions.
- 4 The operation noise measuring method is in accordance with JISC9612.
- 5 Measuring location: anechoic chamber

Cooling		Total dB
A	B	
dBA		46

Heating		Total dB
A	B	
dBA		47


3D110122A

# 9 Sound data

## 9 - 1 Sound Pressure Spectrum

9

### RXM35R

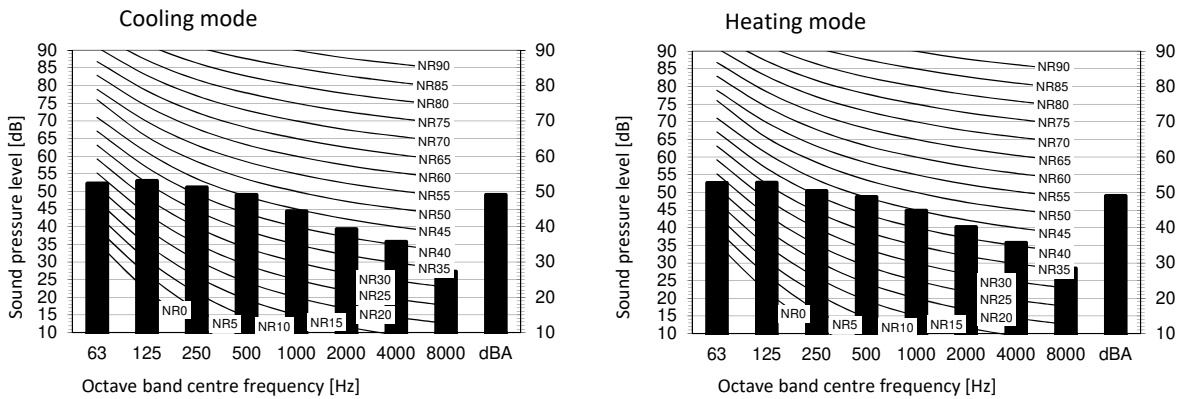

**Legend**


dBA = A-weighted sound pressure level (A scale according to IEC).

- A Scale
- B  Fan speed: High

**Notes**

- 1 Background noise already taken into account.
- 2 Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard
- 3 Operating noise varies depending on operation and ambient conditions.
- 4 The operation noise measuring method is in accordance with JISC9612.
- 5 Measuring location: anechoic chamber

**Location of microphone**




Cooling		Total dB
A	B	
dBA		49

Heating		Total dBA
A	B	
dBA		49

3D110123A

### RXM42R

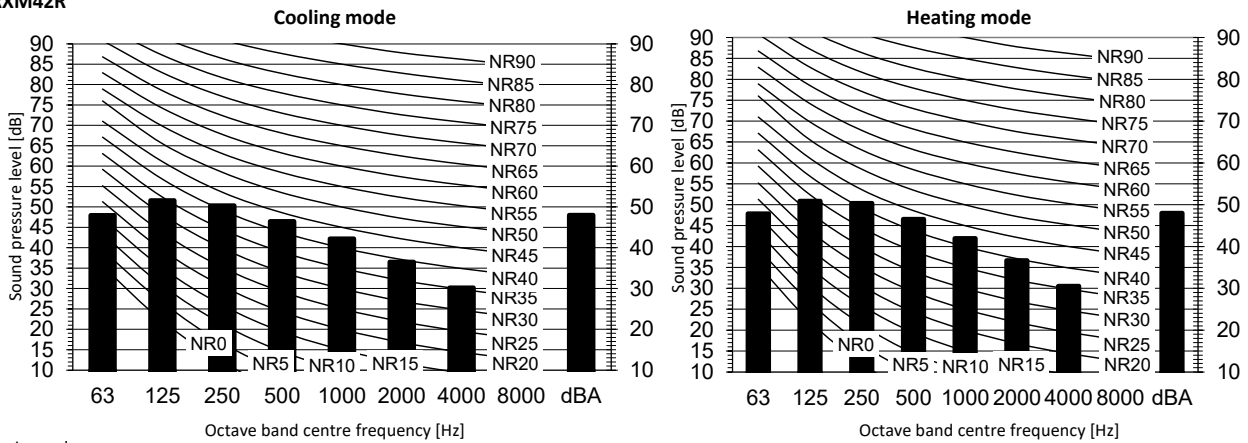


**Legend**

dBA = A-weighted sound pressure level (A scale according to IEC).

- A Scale
- B  Fan speed: High

**Location of microphone**



**Notes**

1. Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard
2. Background noise already taken into account.
3. Operating noise varies depending on operation and ambient conditions.
4. The operation noise measuring method is in accordance with JISC9612.
5. Measuring location: anechoic chamber

Cooling		Total dBA
A	B	
dBA		48



Heating		Total dBA
A	B	
dBA		48

3D131717



# 9 Sound data


## 9 - 1 Sound Pressure Spectrum

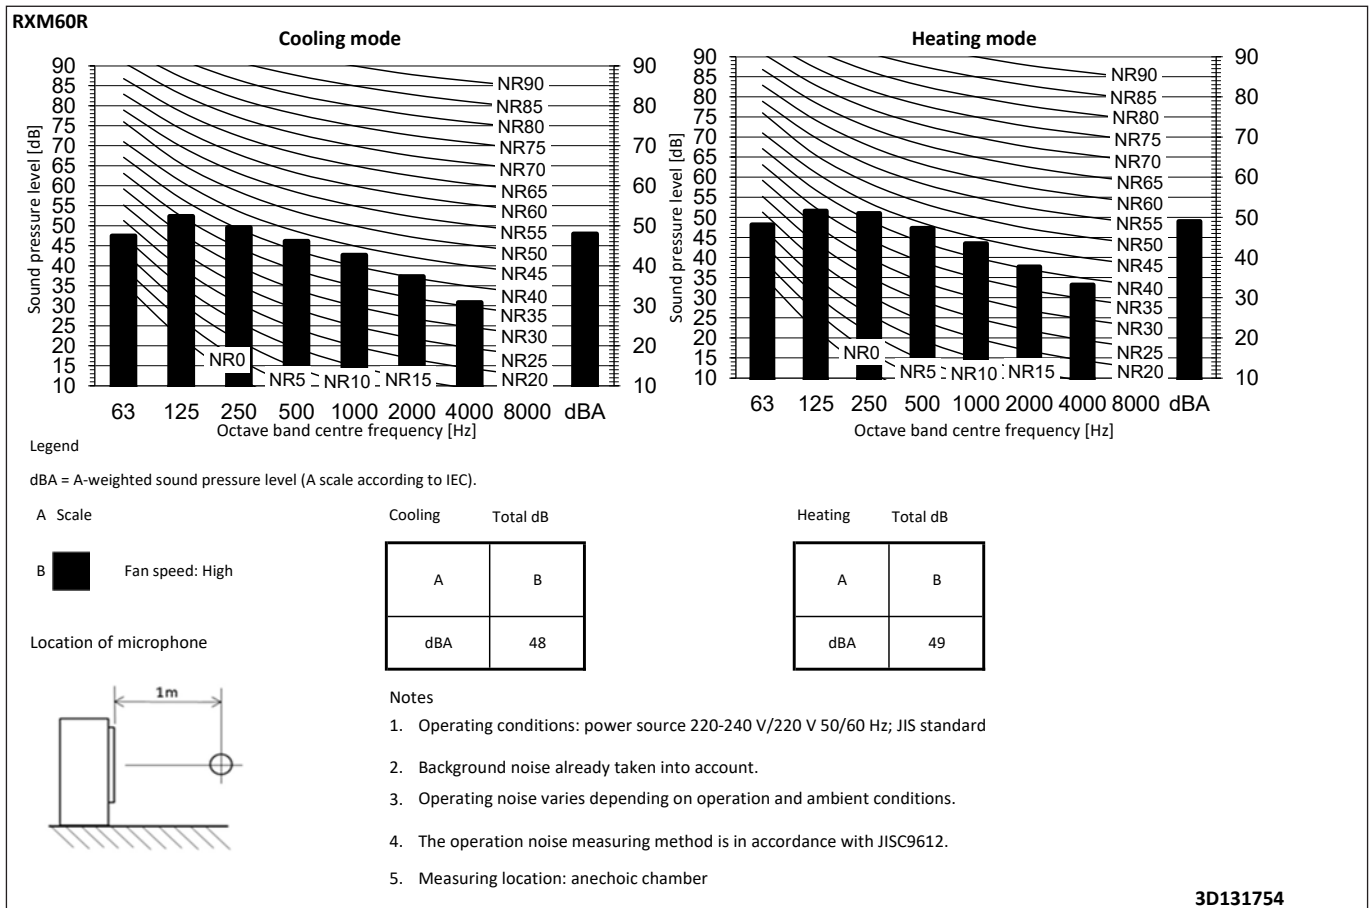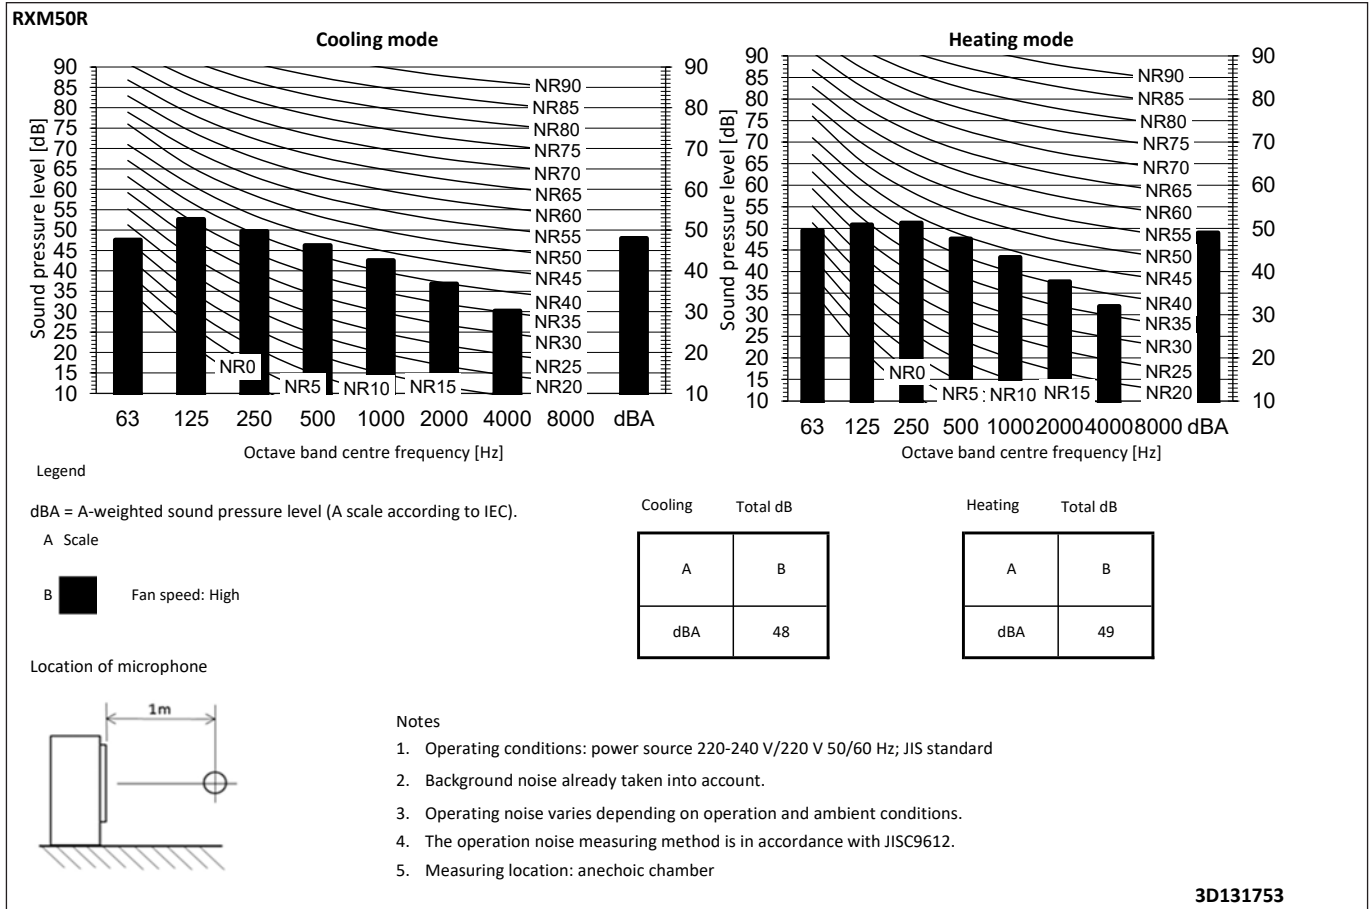

# 9 Sound data

## 9 - 1 Sound Pressure Spectrum



9

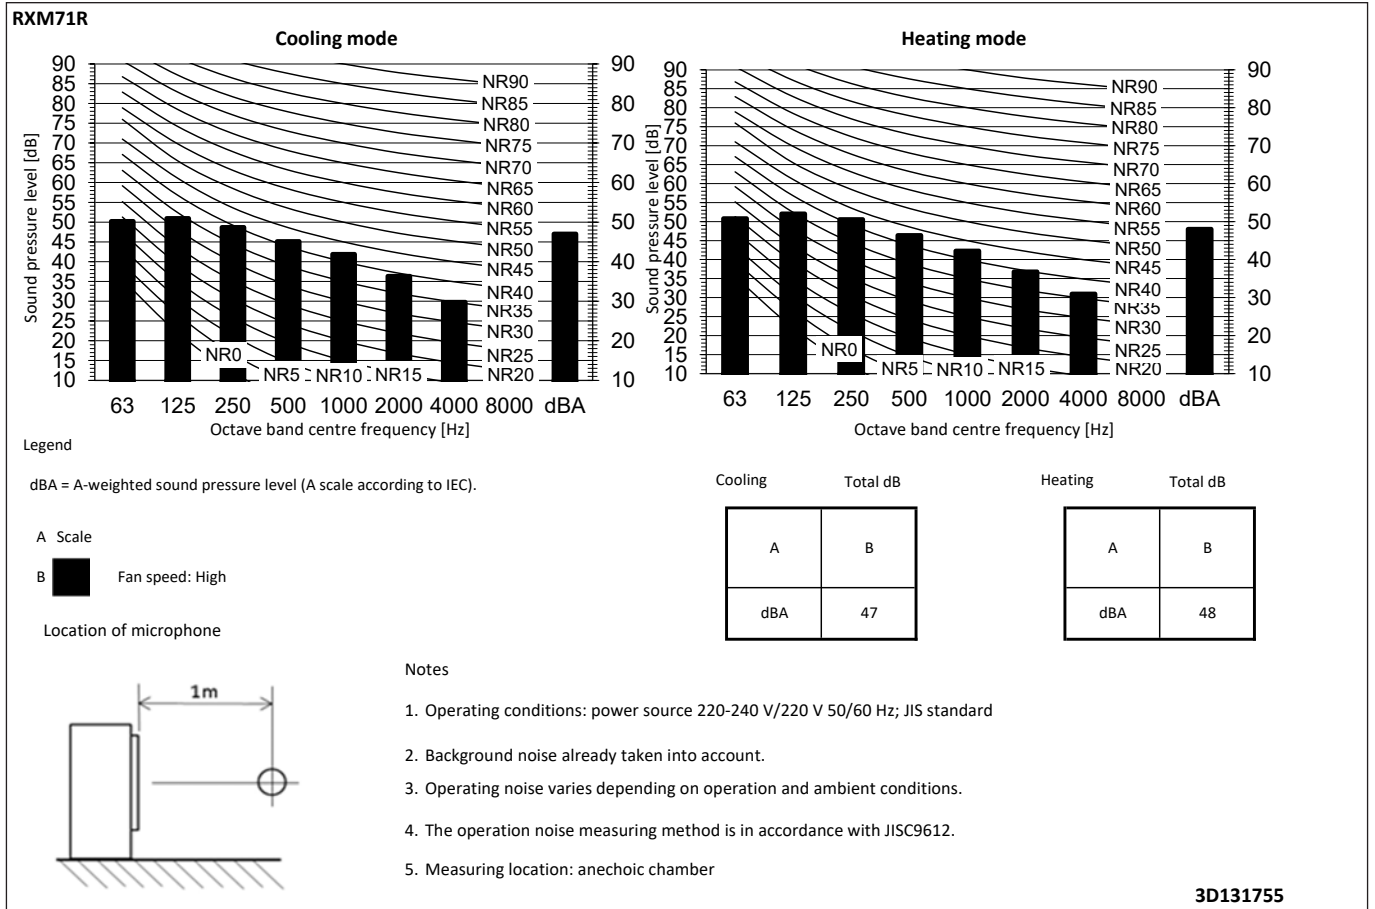

# 10 Operation range



## 10 - 1 Operation Range

ARXM25-35R  
RXM20-60R

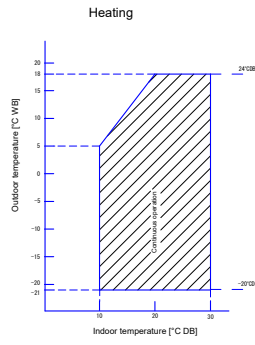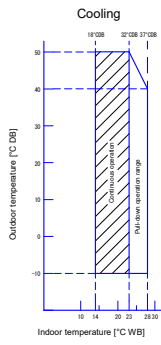

Notes  
1. The graph is based on the following conditions.  
Corresponding refrigerant piping length: 5 m  
Level difference: 0 m  
Air flow rate High

Only possible in combination with ·ATXM\*N2V1B, FTXM\*N2V1B, ATXM\*R2V1B, ATXM\*R5V1B, FTXM\*R2V1B, FTXM\*R5V1B

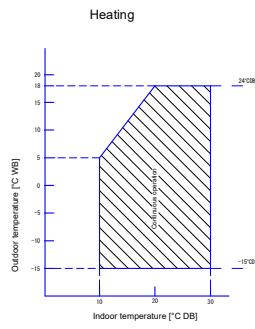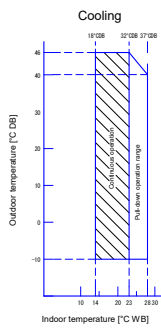

Only possible in combination with ·ATXM\*N2V1B, FTXM\*N2V1B, FVXM\*FV1B, FCAG\*AVEB, FFA\*A2VEB9, FBA\*A2VEB9, FHA\*AVEB9, FDXM\*F3V1B9, FNA\*A2VEB9, ADEA\*A2VEB, FVXM\*A2V1B

3D119882E


# 10 Operation range

## 10 - 1 Operation Range


10

**ARXM50R**  
**RXM42-60R**

### Cooling

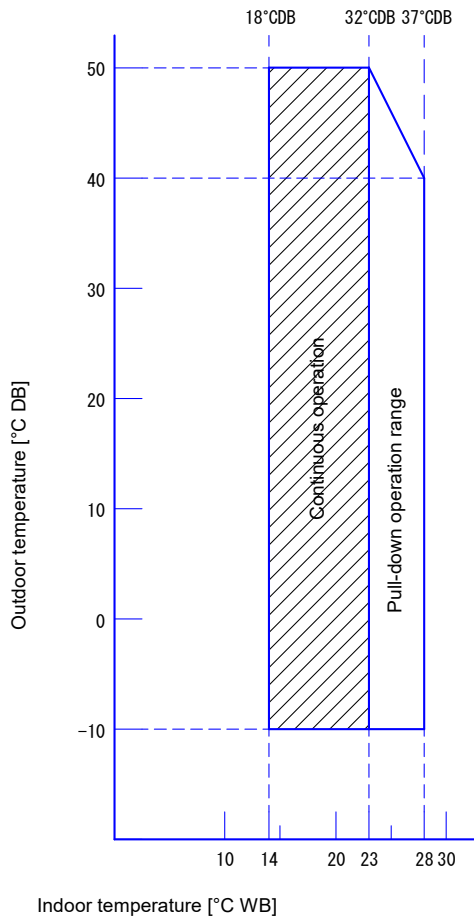

### Heating

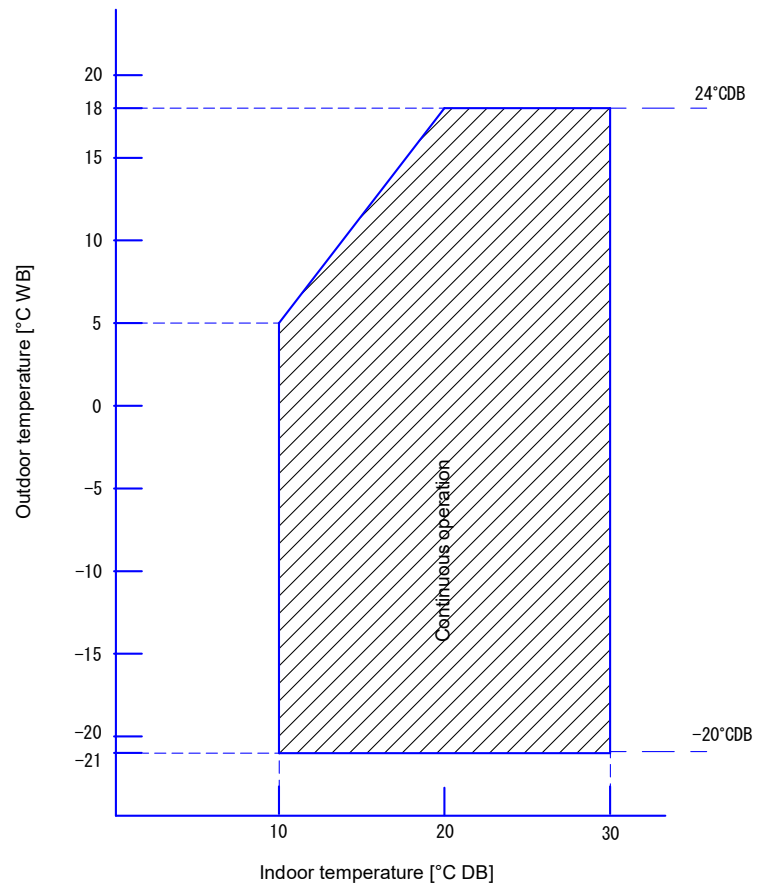

### Notes



- The graph is based on the following conditions.  
 Corresponding refrigerant piping length: 5 m  
 Level difference: 0  
 Air flow rate High

**4D132631**

# 10 Operation range

## 10 - 1 Operation Range

### RXM71R

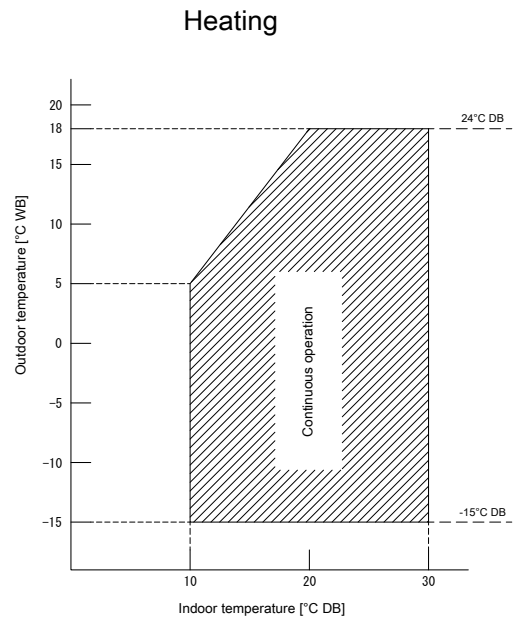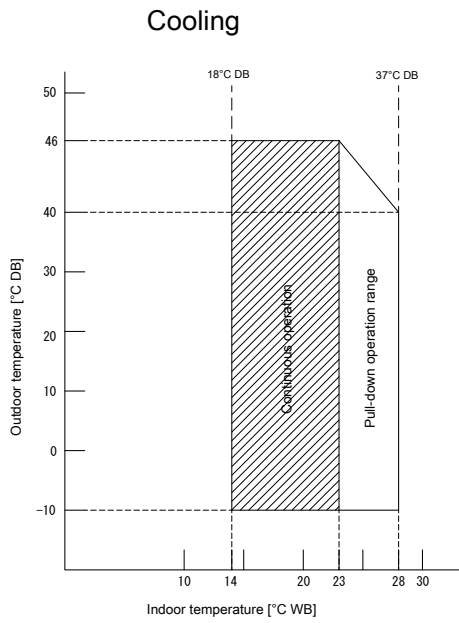


**Notes**

- The graphs is based on the following conditions.  
 Corresponding refrigerant piping length: 5 m  
 Level difference: 0m  
 Air flow rate      High

**3D120207**

---

**Daikin Europe N.V.** Naamloze Vennootschap · Zandvoordestraat 300 · 8400 Oostende · Belgium · BE 0412 120 336 · RPR Oostende (Responsible Editor)



Daikin Europe N.V. participates in the Eurovent Certified Performance programme for Fan Coil Units and Variable Refrigerant Flow systems. Check ongoing validity of certificate:

EEDEN21A

06/2021



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.