
Photo

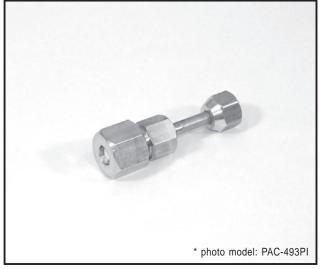

Descriptions


A part to connect refrigerant pipes of the different diameter. (Unit ϕ 9.52 $\rightarrow \phi$ 12.7)

Applicable Models

■ MXZ-2D53V	A2 ■ MXZ-4E72\	/A ■ MXZ-2E53VAHZ
MXZ-2D53V	AH2 ■ MXZ-4E83\	/A ■ MXZ-4E83VAHZ
MXZ-3E54VA	A MXZ-5E102	2VA MXZ-3DM50VA
MXZ-3E68VA	A ■ MXZ-6D122	2VA2 🔳 MXZ-3F68VF3
MXZ-2F53VF		/F3 MXZ-4F80VF3
MXZ-2F53VF	-3H ■ MXZ-4F72V	/A3 📕 MXZ-4F83VF
		MXZ-5F102VF
		MXZ-6F122VF

Specifications

Pipe	diameter	Φ 9.52
Pipe	material	C 1220T - OL

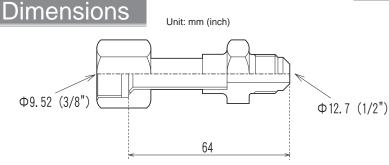

How to Use / How to Install

Unit side

Make sure that you have all the following parts, in addition to this manual in this box:

Joint Pipe PAC-SG76RJ-E (unit side:ø9.52 diameter, onsite pipe side:ø15.88 diameter) PAC-493PI (unit side:ø6.32 diameter, onsite pipe side:ø9.52 diameter) MAC-A454JP-E (unit side:ø1.27 diameter, onsite pipe side:ø1.27 diameter) MAC-A455JP-E (unit side:ø1.27 diameter, onsite pipe side:ø1.28 diameter) MAC-A456JP-E (unit side:ø1.27 diameter, onsite pipe side:ø1.28 diameter) MAC-A456JP-E (unit side:ø1.27 diameter, onsite pipe side:ø1.28 diameter)

Onsite piping side

Installation procedure (carefully read the following before installing.)

This optional part is used to connect indoor/outdoor unit to onsite pipes of different diameters.

When installing this optional part, be sure to read "Refrigerant pipe connection" in the installation manual attached to outdoor unit.

1) Apply flare processing to onsite pipes to adapt to R410A, according to the table on the right. Use optional accessory flare nut at this time. % Check the installation manual attached to the outdoor unit for advisability on whether or not onsite (existing) pipes can be used.

В		B size	e (mm)		When flare w	rocessing for	Q () ((
D	Pipe diameter	R410A flare tool				410A is applied		er of Processing size of	
77777 7 7777 (mm)		Clutch type			using current tool, refer to		copper pipe (mr	n) flare section (mm)	
	0.05(4/45)			the table above. B size can		ø6.35	8.7 - 9.1	$45^\circ \pm 2^\circ$	
1/m	ø 6.35(1/4")	0 - 0.5	1.0 - 1	1.5 be secured		be secured using copper	ø9.52	12.8 - 13.2	
dies	ø 9.52(3/8")	0 - 0.5	1.0 - 1						
φ	ø12.70(1/2")	0 - 0.5	1.0 - 1	1.5	pipe gauge f	or margin	ø12.70	16.2 - 16.6	8 R0.4~R0.8
Copper pipe	ø15.88(5/8")	0-05	10-1	15	adjustment.		ø15.88	19.3 - 19.7	
 2) Remove caps (both ends) for protection against 3) mixing of foreign materials from optional part, wr and thinly apply refrigerat or oil (locally procured) on flare surface. 				vrench (Proper Outer coppe	Securely tighten flare nut usin nch according to the table or oper tightening torque using to uter diameter of Tightening to		() the right. rque wrench torque N•m •cm) 40 - 180) 40 - 420) 90 - 610) 80 - 820)	 After refrigerant pipe is connected, be sure to perform gas leakage inspection for onsite connection pipes (including this optional part) and indoor/outdoor unit. Heat insulation is necessary for this optional part: Wrap heat insulator (locally procured) around the onsite pipes and also the optional part (for dewdrop dripping prevention). Perform test run according to the 	

6) Perform test run according to the installation manual of the unit, making sure to also perform operation check.